



BS 6387 : 1994

Performance Requirements for Cables required to Maintain Circuit Integrity under Fire Conditions

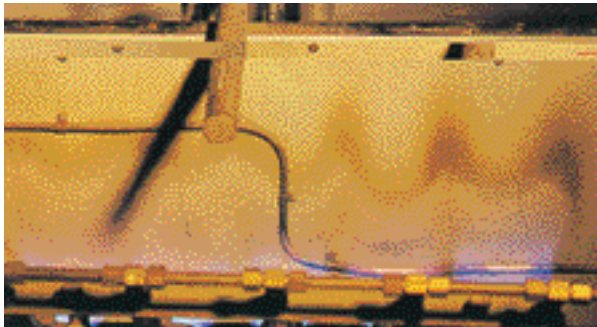

Resistance to Fire

Exposure to gas burner flames

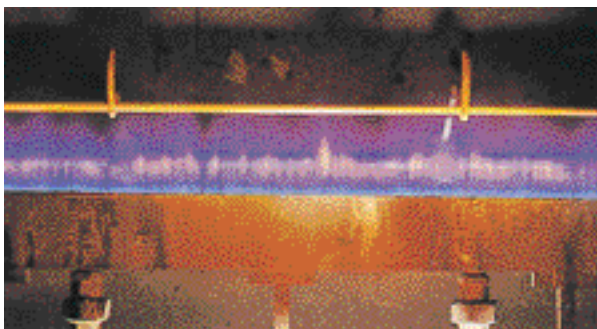

Resistance to Fire with Water Spray

650 15 15
Exposure to flames at 650 for 15 minutes then exposure to water spray and fire for 15 minutes



Resistance to Fire with Mechanical Shock

30 15
Exposure to flames whilst mounting panel is struck with a steel bar at 30 second intervals for 15 minutes

