



MI Cable Installatoin Drawing

ONE RUN OF CABLE

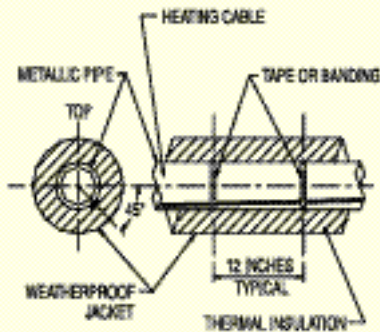


NOTE: CABLE LOCATED AT NOMINAL 45° BELOW HORIZONTAL CENTERLINE

TWO RUNS OF CABLE

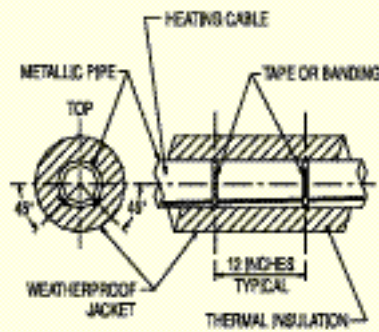


NOTE: CABLE LOCATED AT NOMINAL 45° BELOW HORIZONTAL CENTERLINE ON EITHER SIDE

ONE RUN OF CABLE AT PIPE ELBOW

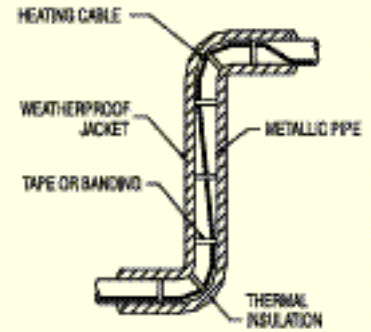


NOTE: HEATING CABLE IS APPLIED TO THE OUTSIDE (LONG) RADIUS OF THE PIPE BELOW.

WELDED PIPE SUPPORT

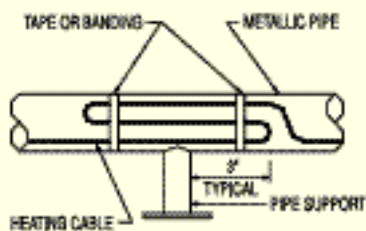


NOTE: PIPE SUPPORT TO BE INSULATED TWO FEET BELOW PIPE WEATHERSEALED. ALL PIPING MUST BE INSULATED AND WEATHERSEALED.

SHOE SUPPORT

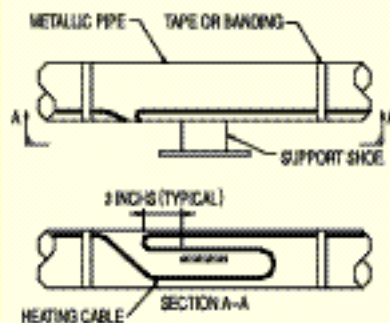


NOTE: INSULATE AND WEATHERSEAL SUPPORT. ALL PIPING MUST BE INSULATED AND WEATHERSEAL.

VALVE

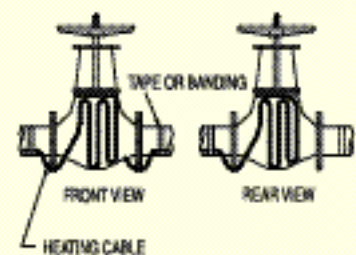


NOTE: INSULATE AND WEATHERSEAL SUPPORT. ALL PIPING MUST BE INSULATED AND WEATHERSEAL.

END SEAL

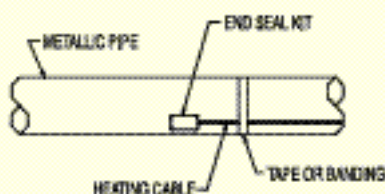

NOTE: ALL PIPING MUST BE INSULATED AND WEATHERSEALED

POWER CONNECTION KIT

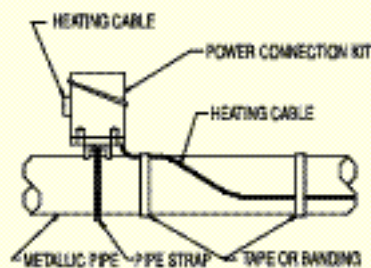

NOTE: ALL PIPING MUST BE INSULATED AND WEATHERSEALED

