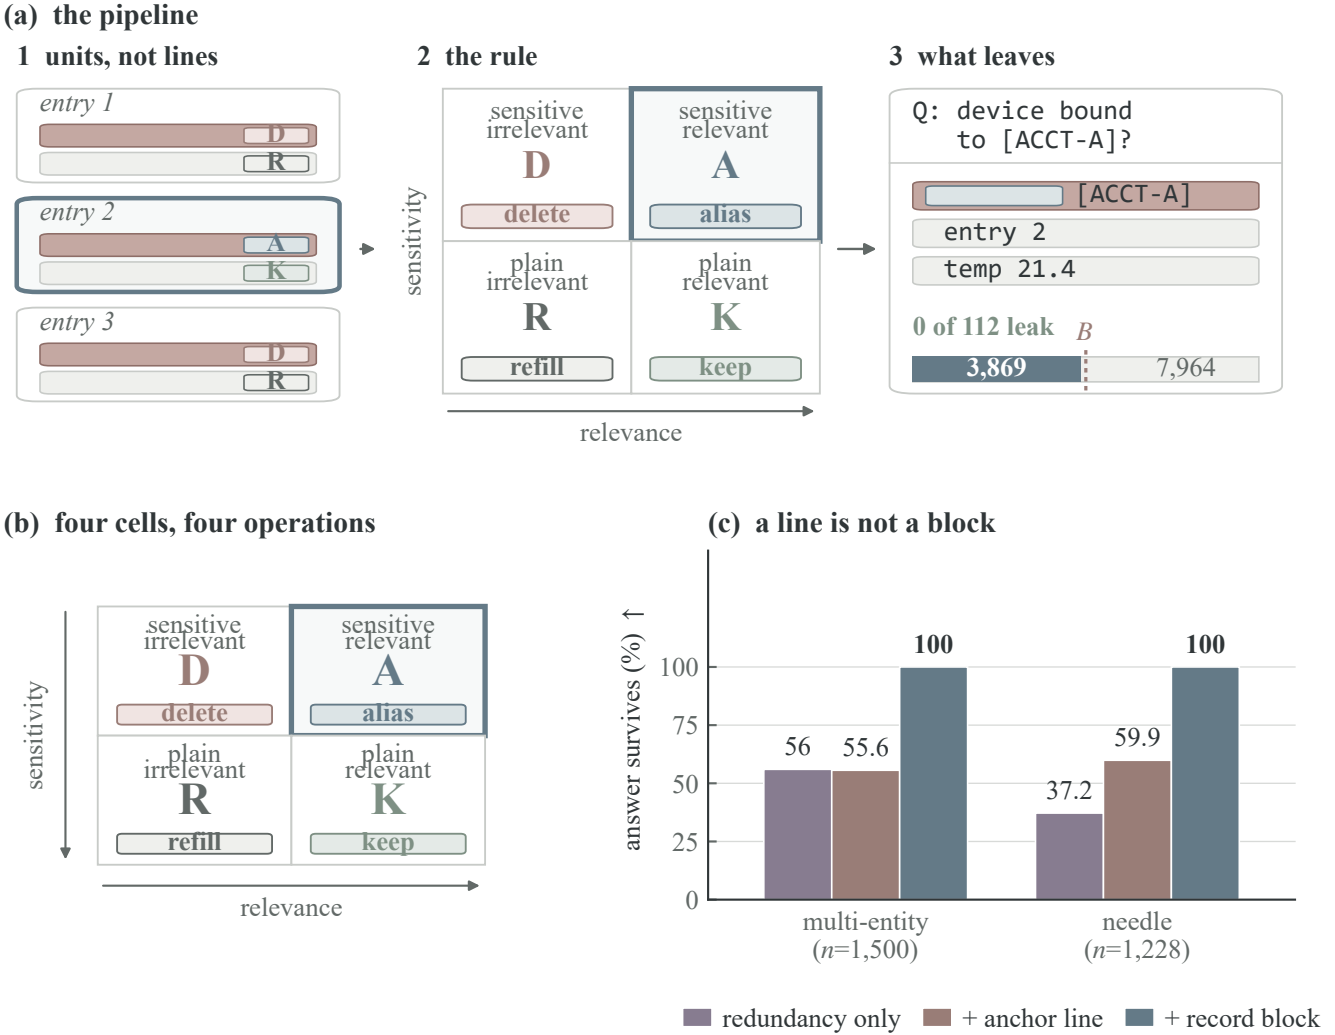

(a) the pipeline
1 units, not lines
entry 1
D
R
entry 2
A
K
entry 3
D
R
2 the rule
sensitive irrelevant
D
delete
sensitive relevant
A
alias
plain irrelevant
R
refill
plain relevant
K
keep
sensitivity
relevance
3 what leaves
Q: device bound to [ACCT-A]?
[ACCT-A]
entry 2
temp 21.4
0 of 112 leak
B
3,869
7,964
(b) four cells, four operations
sensitive irrelevant
D
delete
sensitive relevant
A
alias
plain irrelevant
R
refill
plain relevant
K
keep
sensitivity
relevance
(c) a line is not a block
answer survives (%) ↑
100
75
50
25
0
56
55.6
100
37.2
59.9
100
multi-entity (n=1,500)
needle (n=1,228)
redundancy only
+ anchor line
+ record block