McFLURRY®, SHAKE AND SUNDAE MACHINES—WEEKLY

WEEKLY

SUPPLIES:



KAY® SolidSense™ All Purpose Super Concentrate



KAY® Rapid Multi Surface Disinfectant Cleaner Solution




KAY-5® Sanitizer/Cleaner




Clean Sanitizer-Soaked Towels

Other supplies needed:
Shake Machine Brushes
Syrup Hole Plugs
Valve Cap
(4) Small Clean Containers
Flat Head Screwdriver


McFLURRY CANDY DISPENSER

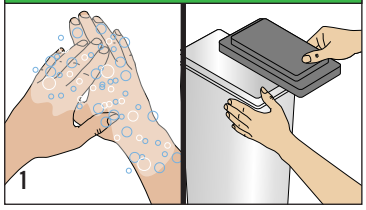

- **WASH** hands
- **REMOVE** candy dispenser lid and empty each topping into a clean cold drink cup

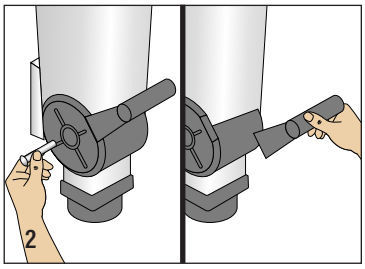


- **REMOVE** adapter cup
- **ROTATE** pivot pin to unlock position and remove pin and handle

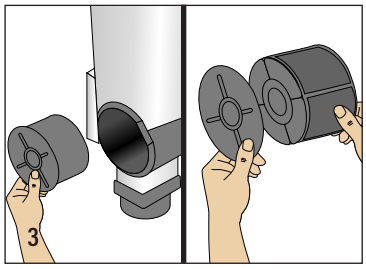

- **REMOVE** cylinder, friction pad and portion trays



- **TAKE** all parts of candy dispenser to 3-compartment sink
- **WASH, RINSE, SANITIZE** for 1 minute; allow to fully air dry

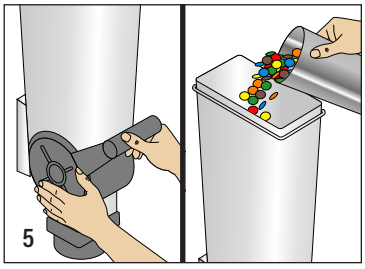


- **WASH** hands
- **REASSEMBLE** clean and dry dispenser
- **REFILL** candy dispensers
- **PLACE** correct food rotation labels on dispensers

NOTE: Do not wash candy dispenser parts in the warewash machine


SHAKE AND SUNDAE MACHINE



- **PREPARE** cleaning supplies
- **PREPARE** bucket of KAY-5 Sanitizer/Cleaner Solution by mixing 1 packet to 2.5 gallons of **lukewarm** (85-105°F) water
- **POUR** some of the Solution into a small container to clean the syrup valve plunger

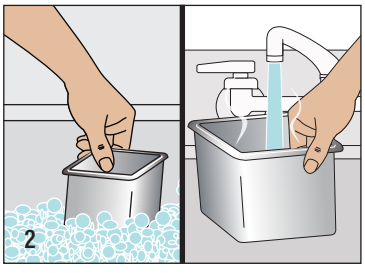

- **FILL** a second, small container with **hot** APSC Solution from 3-compartment sink
- **FILL** a third, small container with hot, clean water from the 3-compartment sink

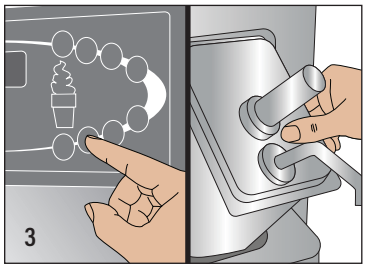

- **TURN OFF** water bath heaters
- **REMOVE** topping pumps and containers and set aside
- **ALLOW** water bath to **cool** for 10 minutes

CAUTION: Water may be **hot**


57579.02 MCD US 57579/8002/1025 ©2025 Ecolab USA Inc. All rights reserved.

ECOLAB®
Kay Chemical Company
8300 Capital Drive
Greensboro, NC 27409-9790, USA
CUSTOMER SERVICE 800.529.5458

McFLURRY®, SHAKE AND SUNDAE MACHINES—WEEKLY (CONTINUED)


WEEKLY

SHAKE AND SUNDAE MACHINE (CONTINUED)

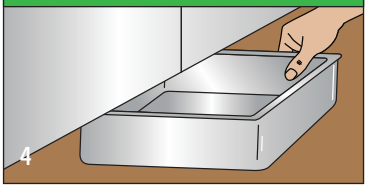

- **REMOVE** plugs from bottom of syrup baths
- **PLACE** empty pan under machine and allow water baths to drain into pan
- **DISCARD** water from pan


CAUTION: Water may be **hot**

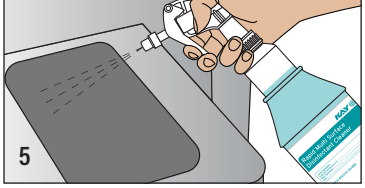


- **SPRAY** inside water baths with Rapid MSDC Solution
- **WIPE** with a sanitizer-soaked towel
- **SPRAY** again with Rapid MSDC Solution
- Allow to **AIR DRY** to sanitize



- **DISCARD** toppings from container
- **DISASSEMBLE** topping pump and container at 3-compartment sink; wash, rinse and sanitize
- **ALLOW** to air dry
- **REINSTALL** plugs in syrup baths
- **REINSTALL** topping pump and container

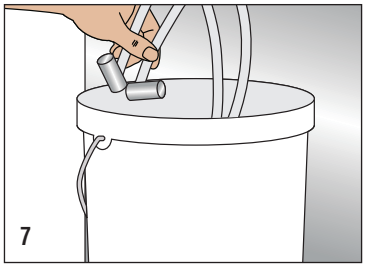


- **PLACE** empty container under shake door area
- **REMOVE** syrup lines from shake door and let them hang in the empty container

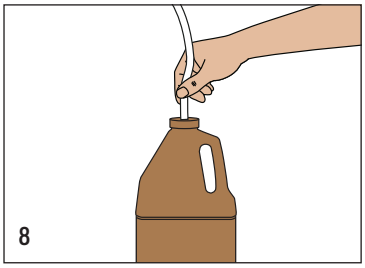


- **REMOVE** syrup feed tubes from syrup containers
- **WIPE** outside of feed tubes with a sanitizer-soaked towel


NOTE: Cover syrup containers with plastic wrap to avoid contamination

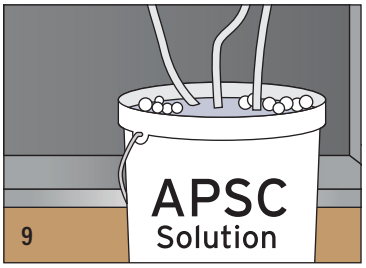


- **PLACE** syrup lines in container of APSC Solution
- **PRESS** CALIBRATE button; **SELECT** PRIME SYRUP LINE button
- **SELECT** desired FLAVOR button to begin flow of Solution
- **WHEN** syrup line is flowing clear Solution, **PRESS** FLAVOR button again to stop flow of Solution
- **REPEAT** process again for remaining flavors

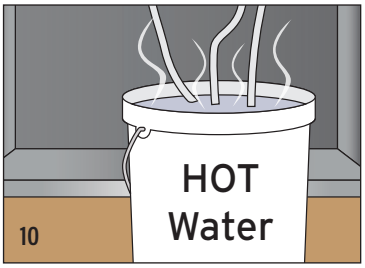

- **PLACE** syrup feed tubes into a bucket of clean, **hot** (110-120°F) water
- **FLUSH** water through lines to rinse

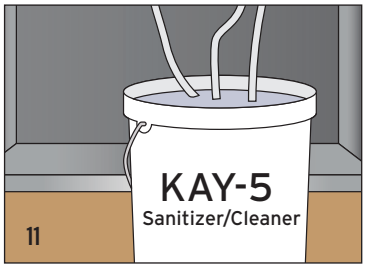

- **PLACE** syrup feed tubes into a bucket of clean KAY-5 Sanitizer/Cleaner Solution
- **FLUSH** Sanitizer Solution through each line for 1 minute to sanitize

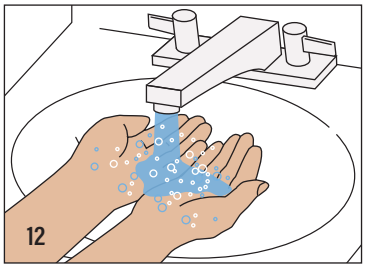

- **WASH** hands

ECOLAB®

Kay Chemical Company
8300 Capital Drive
Greensboro, NC 27409-9790, USA

CUSTOMER SERVICE 800.529.5458

57579.02 MCD US 57579/8002/1025 ©2025 Ecolab USA Inc. All rights reserved.


McFLURRY®, SHAKE AND SUNDAE MACHINES—WEEKLY (CONTINUED)

WEEKLY


SHAKE AND SUNDAE MACHINE (CONTINUED)




- **REMOVE** each syrup feed tube from bucket and allow to drain
- **INSTALL** syrup feed tubes into appropriate syrup containers

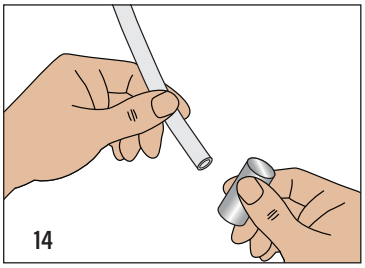


- **REMOVE** syrup valve plunger cap and syrup valve plunger from each syrup line

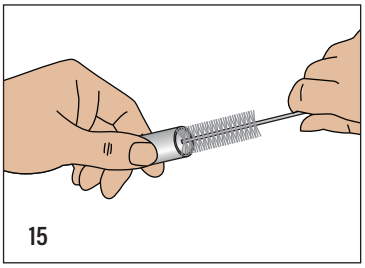


- **CLEAN** each syrup valve plunger by gently wiping with a sanitizer-soaked towel
- **DIP** a shake brush into small container of KAY-5 Sanitizer/Cleaner Solution and scrub inside of each syrup line and valve body
- **PLACE** all syrup valves into Sanitizer Solution and let it sit for 1 minute

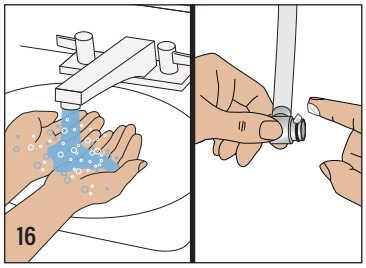


- **WASH** hands
- **LUBRICATE** each syrup valve plunger o-ring
- **INSTALL** clean syrup valve plungers into each syrup line

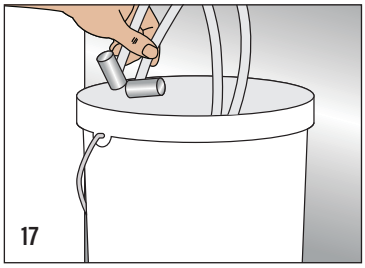

- **PRIME** all syrup lines
- **PLACE** syrup valves in an empty, clean container
- **PRESS CAL**, then **WASH** button to start flow of syrup for priming; when steady flow of syrup, press CAL again to stop
- **REPEAT** to prime all syrup flavors

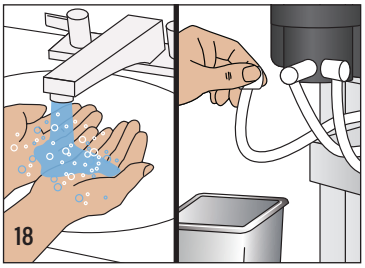

- **WASH** hands
- **RECONNECT** syrup lines to shake door

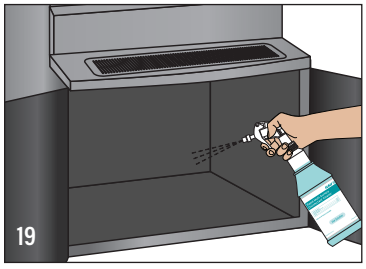

- **CLEAN** inside of syrup cabinet with Rapid MSDC Solution and a sanitizer-soaked towel

ECOLAB®

Kay Chemical Company
8300 Capital Drive
Greensboro, NC 27409-9790, USA

CUSTOMER SERVICE 800.529.5458

57579.02 MCD US 57579/8002/1025 ©2025 Ecolab USA Inc. All rights reserved.