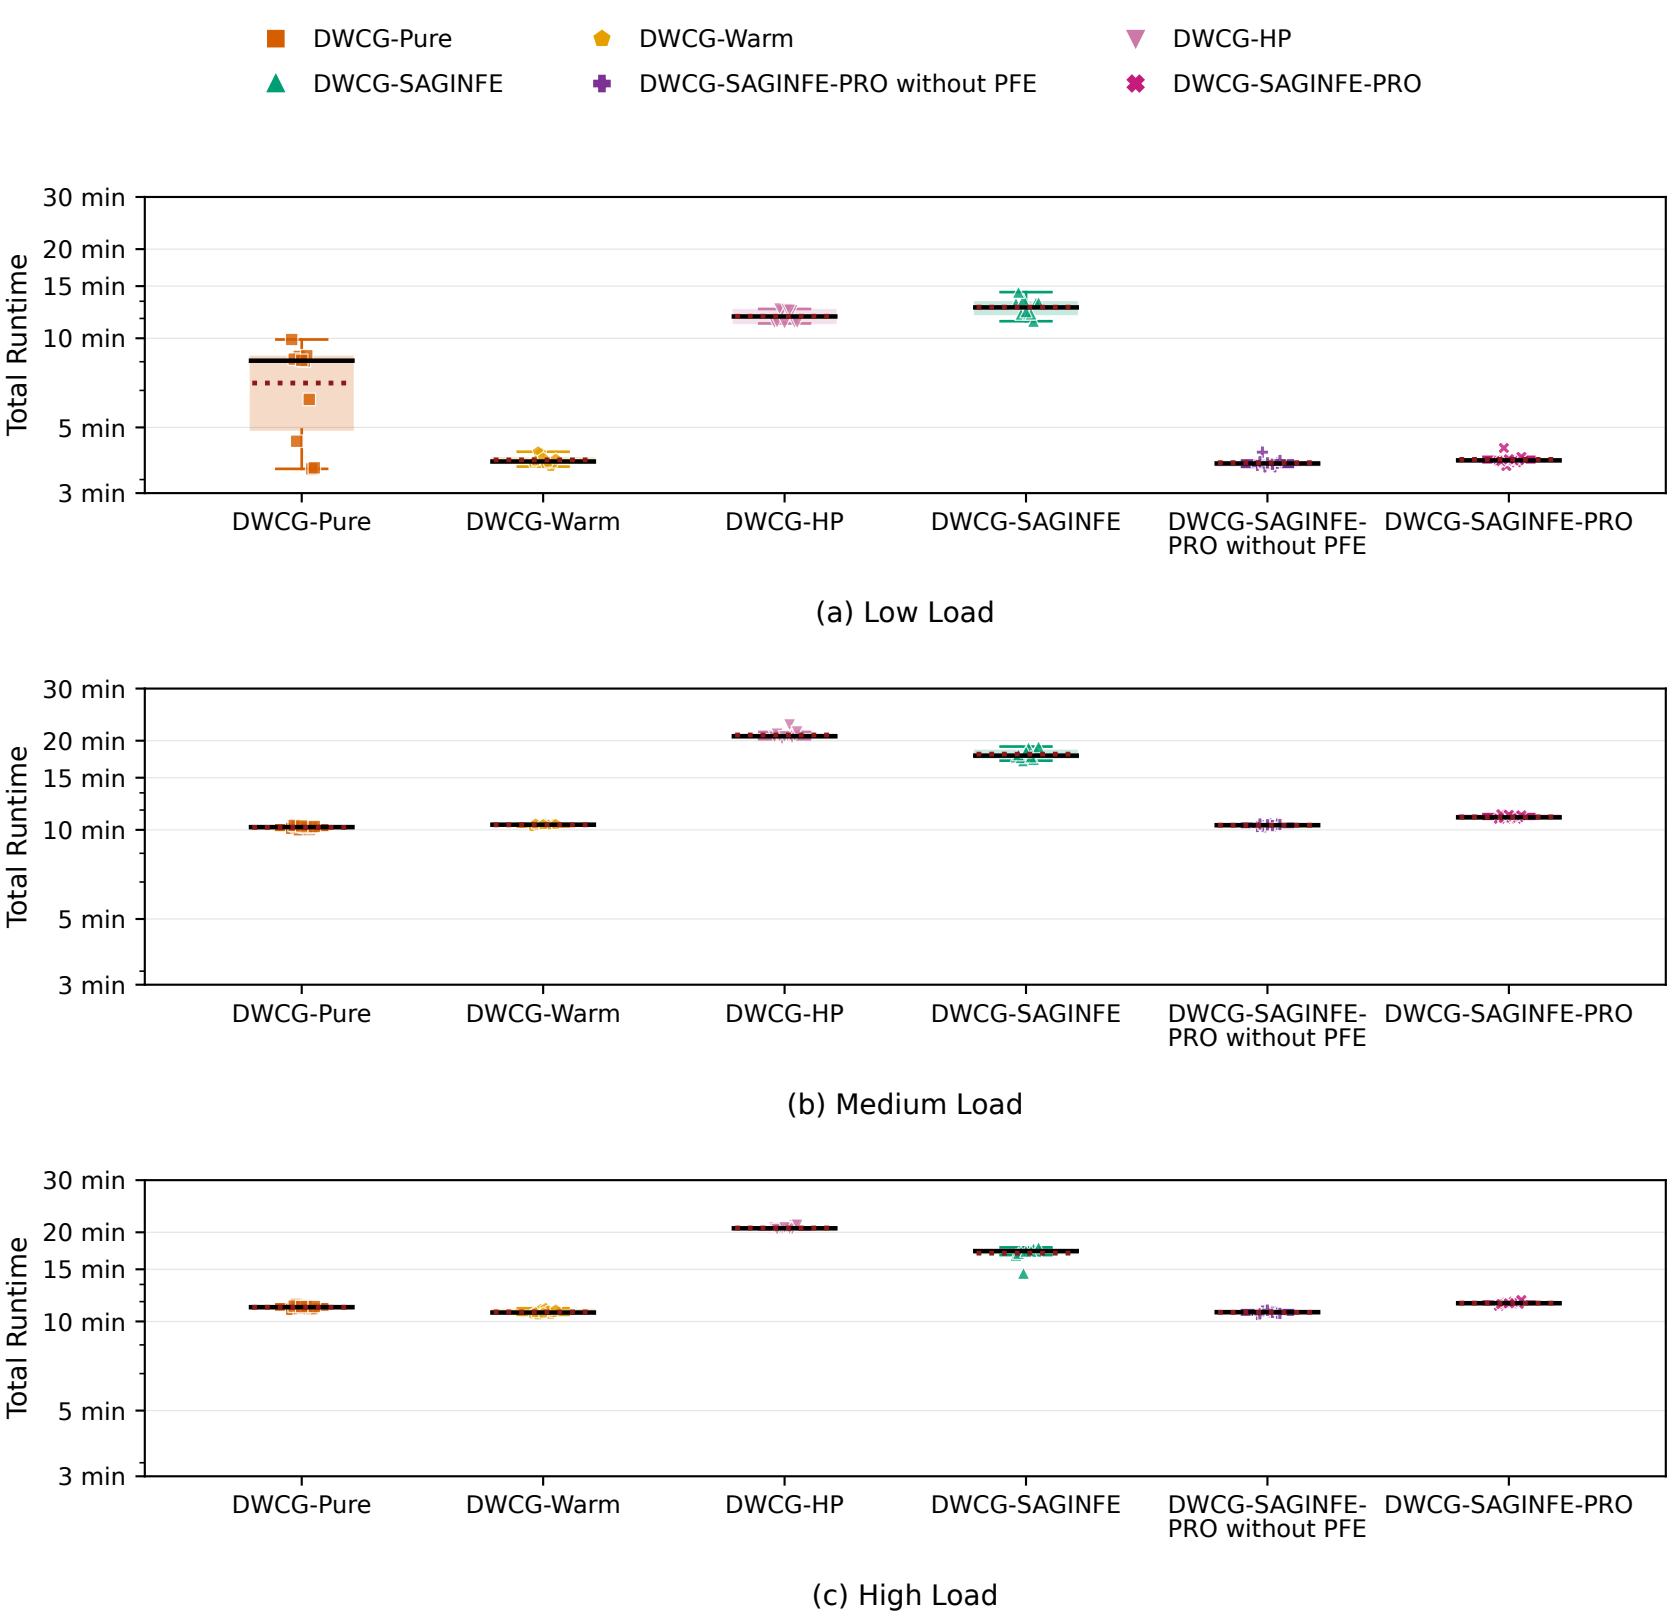

(a) Low Load

(b) Medium Load

(c) High Load

S40 (|T|=8, |R|=160) Component Ablation