


DR-DID Sample: Symmetric PS Trimming [0.01, 0.99]



Retained treated

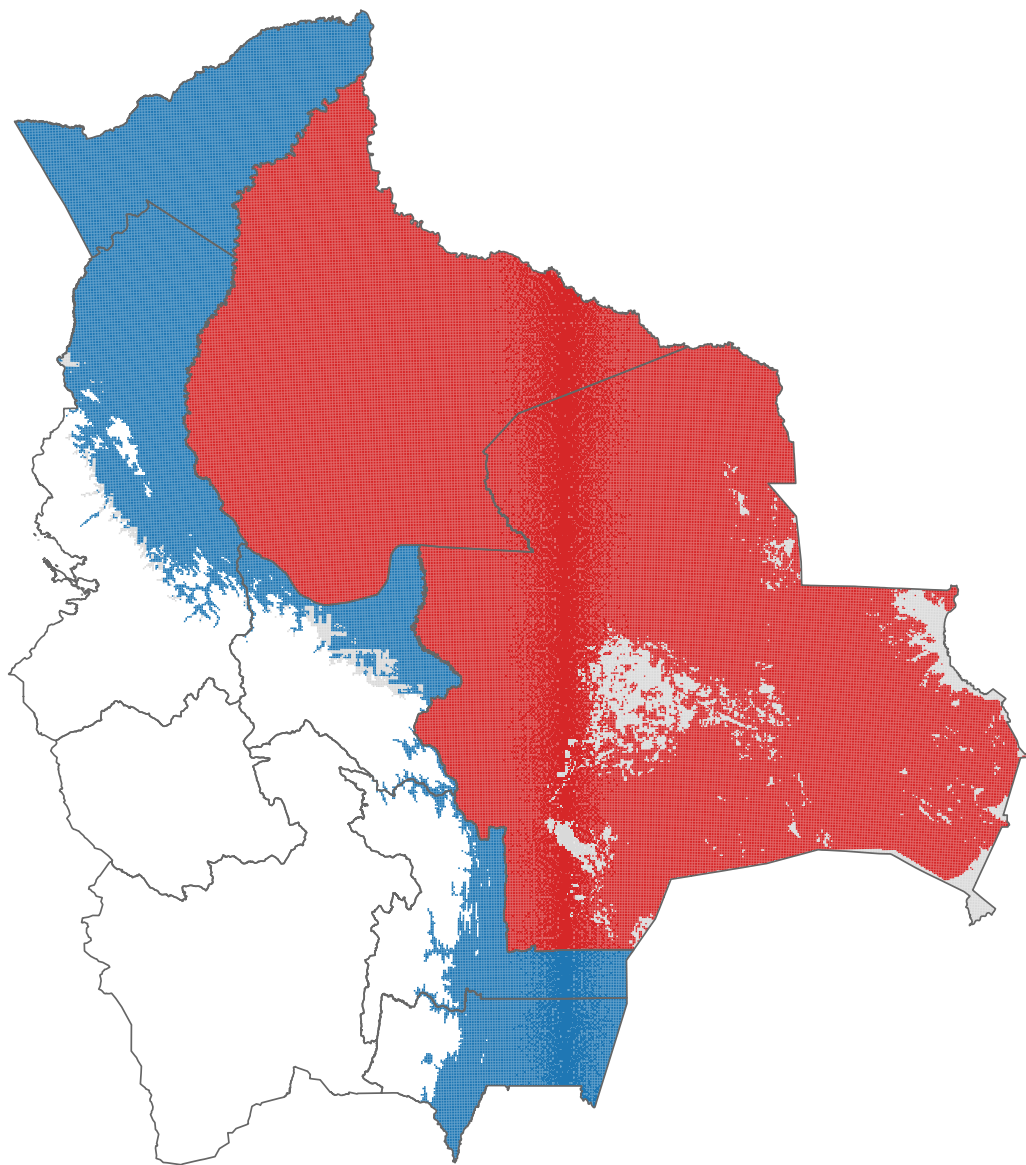

Retained control



Trimmed