


## NOTES

TS +/- use for controlling lv logic + measuring points outside of tractive box  
 TSMP +/- == TS +/- measuring points  
 Discharge +/- allows HV to flow once indicator has been given  
 Consider: Trace length = 30V/mil.

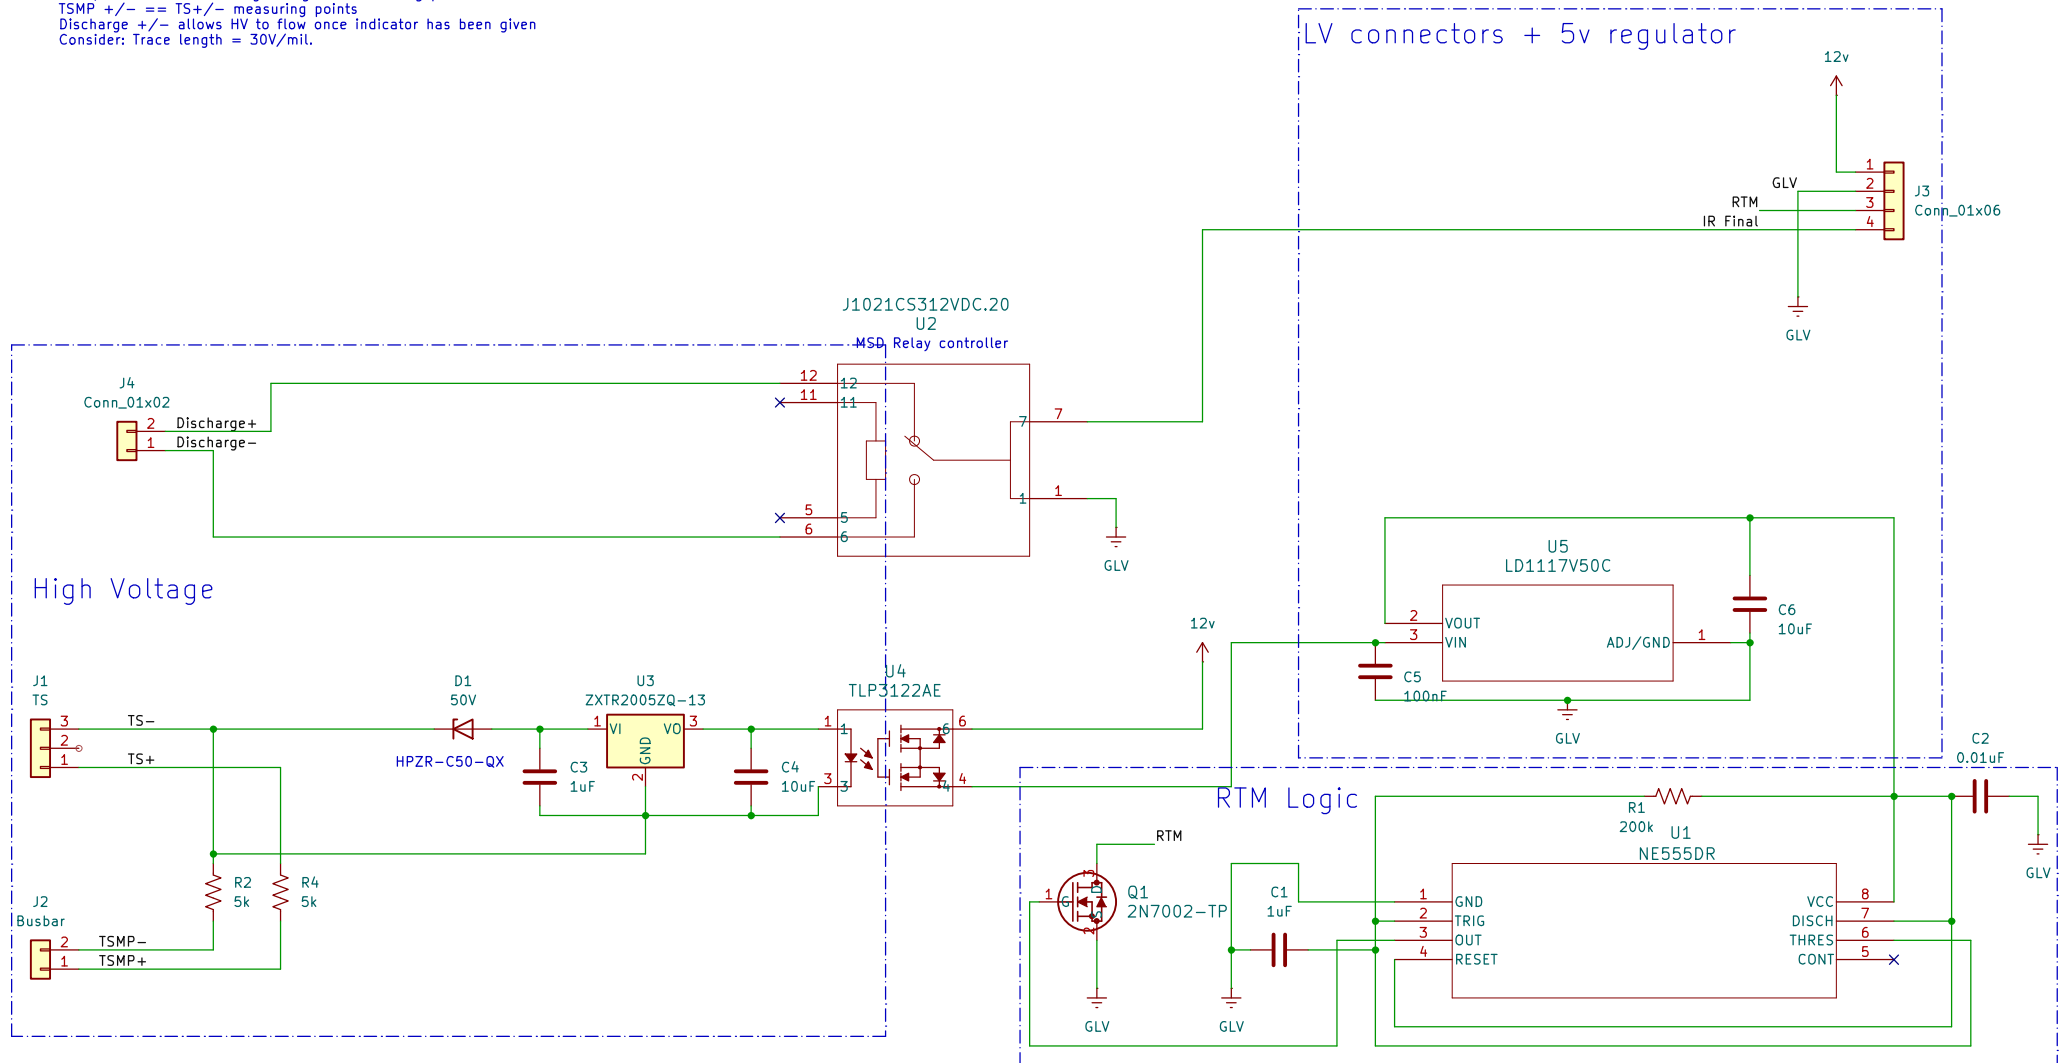

Discharge Schem, PN (Part Number): pending.

02/08/2025