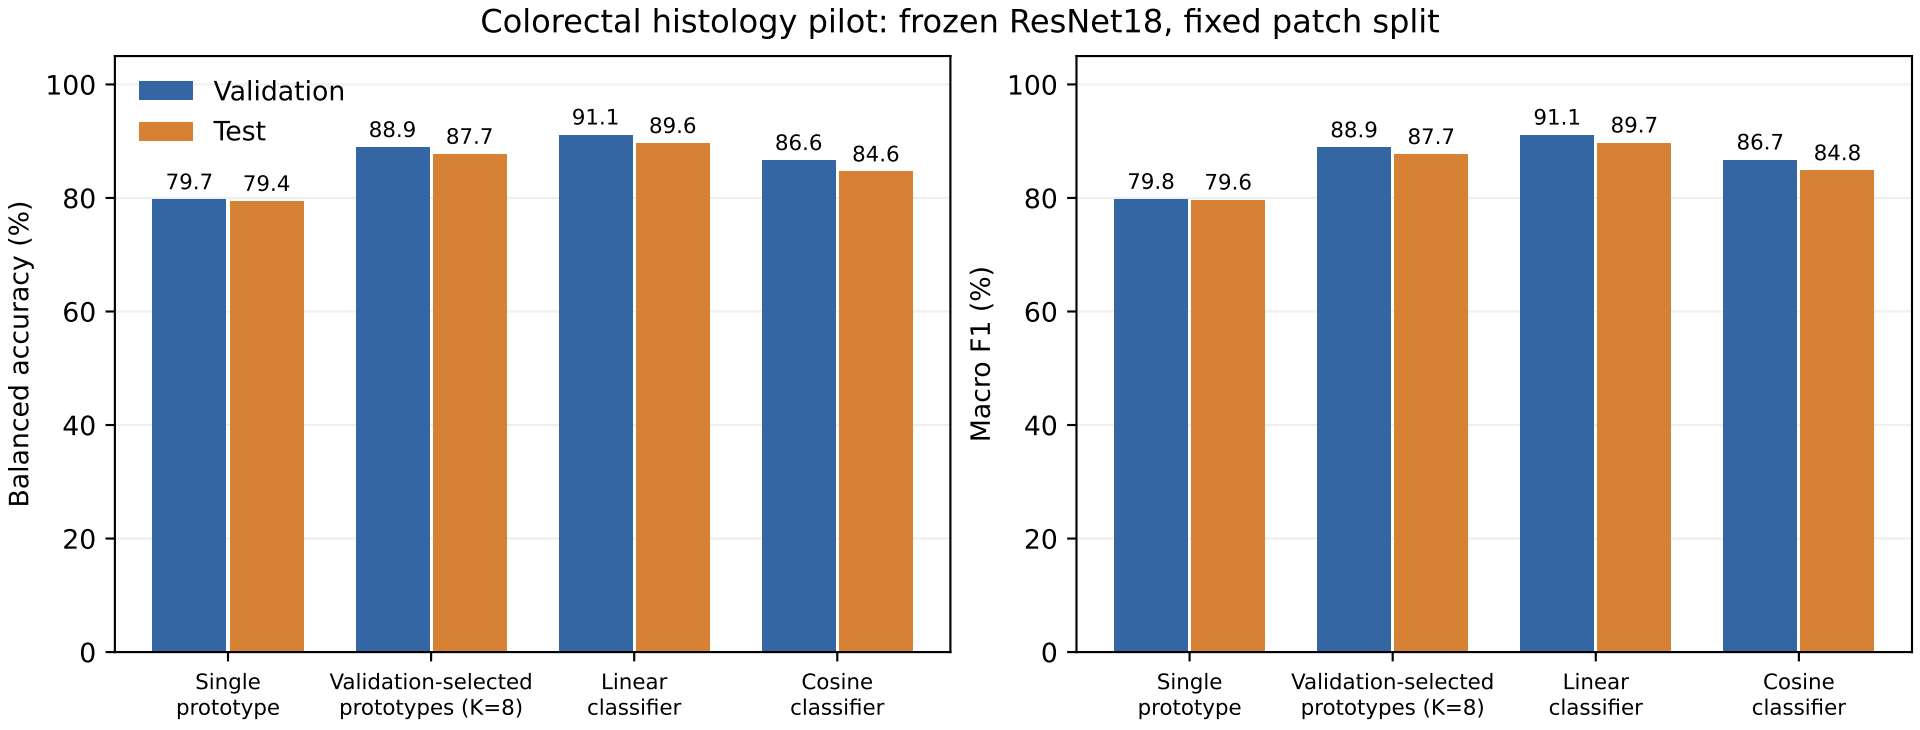
Colorectal histology pilot: frozen ResNet18, fixed patch split
Validation
Test
Balanced accuracy (%)
Macro F1 (%)
0
20
40
60
80
100
79.7
79.4
88.9
87.7
91.1
89.6
86.6
84.6
79.8
79.6
88.9
87.7
91.1
89.7
86.7
84.8
Single prototype
Validation-selected prototypes (K=8)
Linear classifier
Cosine classifier