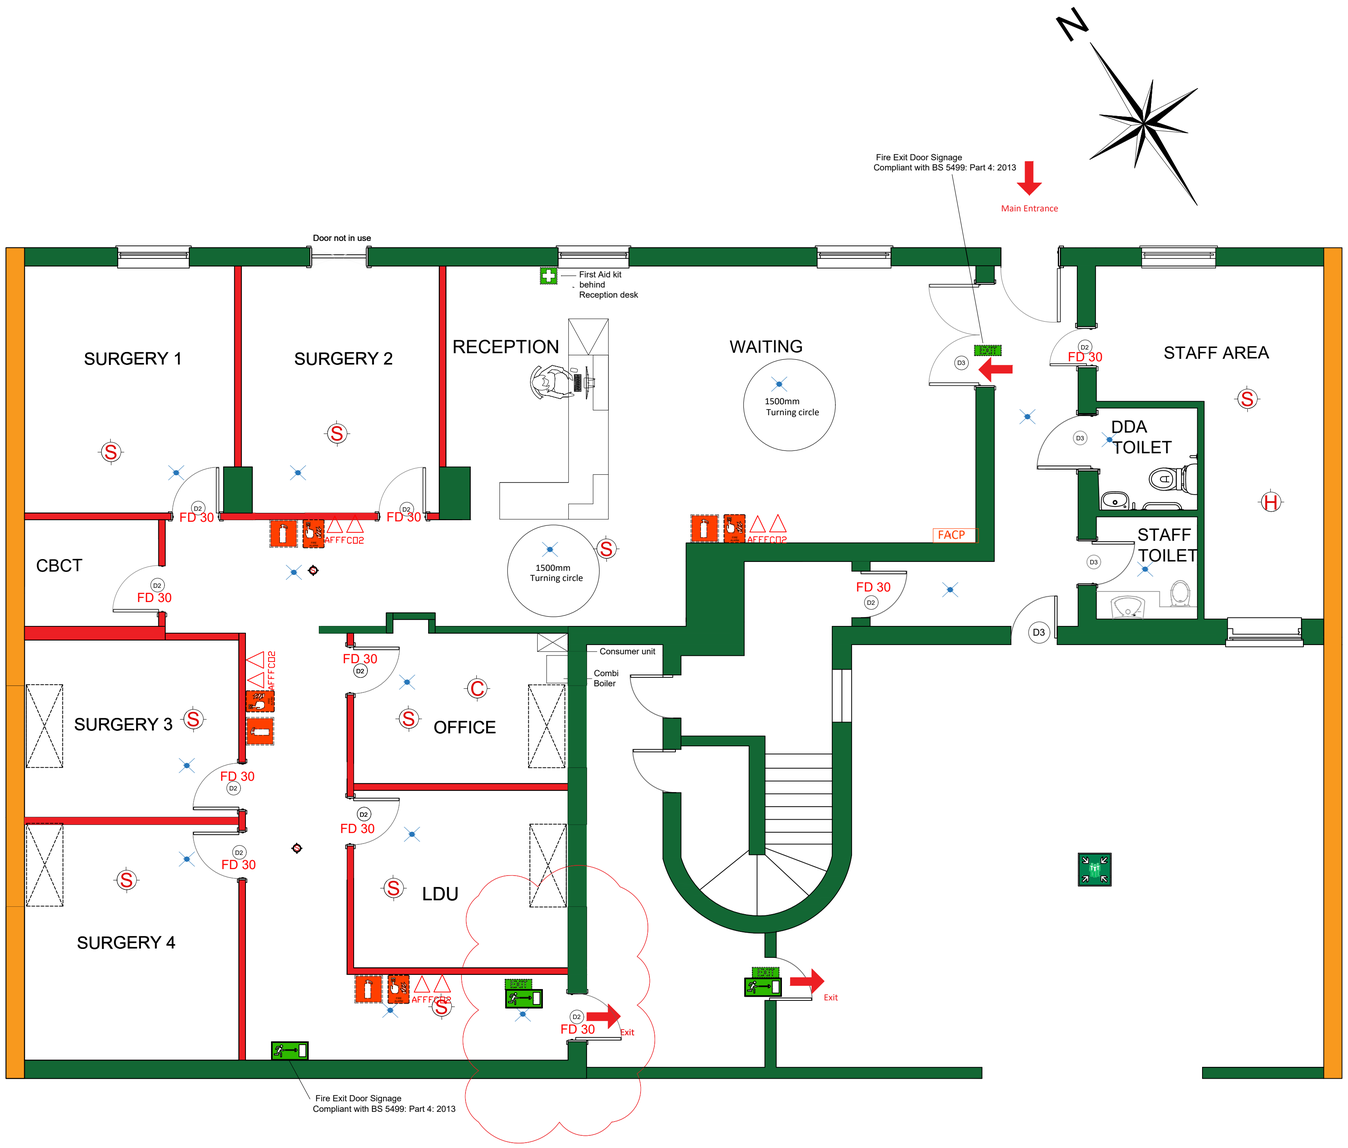


Fire Compartmentation Plan

Scale 1:50

Fire Strategy – General Notes:

FIRE RESISTING CONSTRUCTION NOTE

All fire resisting construction is to be provided in accordance with the Scottish Building Regulations Technical Handbook (Non-Domestic) and the approved fire strategy.
Fire resisting walls, floors, ceilings, and structural elements shall achieve the fire resistance periods indicated on the drawings 30 minutes including any required integrity and insulation performance.

All service penetrations, joints, and junctions through fire resisting elements shall be fully fire-stopped using tested and certified systems to maintain the required fire resistance.
Fire resisting construction shall be continuous to the full extent shown, including above ceilings and within service voids, and shall be installed strictly in accordance with manufacturer's instructions and third-party certification.

Proposed works comply with the Building (Scotland) Regulations and the Scottish Technical Handbooks (Non-Domestic). All works to be carried out in accordance with relevant British Standards and manufacturers' instructions. Refer to the specification sheet(s) for further information. All works subject to Building Control approval.

All works to comply with the Scottish Building Regulations Technical Handbook (Non-Domestic)

Fire resistance ratings as shown on drawings
All fire doors to be certified and self-closing
Fire stopping to all service penetrations

Escape routes to be kept clear and unobstructed
Final exits to discharge to safe place
Fire detection and alarm system to BS 5839-1: 2017
Emergency lighting to BS 5266: Part 1: 2016 as read in association with BS EN 1838: 2013.
Fire signage to BS 5499: Part 4: 2013

Fire detection to BS 5839-1 Category L3. Smoke detectors to escape routes and circulation areas. Heat detectors to LDU, kitchen. Layout subject to fire strategy and FRA.

FACP located at main entrance/reception, accessible and visible to Fire Service. BS 5839-1: 2017 compliant.

FIRE ESCAPE ROUTES LEGEND

Signage:

- Fire exit Direction sign
- Fire exit sign
- Fire Extinguisher
- Fire Alarm
- First aid box
- FACP — Fire Alarm Control Panel
- Fire Assembly point

Fire Door Legend:

- D2 — Internal FD 30
- D3 — NR (Non- rated, standard door)
- External FD 60

- Emergency Lighting
- S — Smoke Detector
- H — Heat Detector
- C — Carbon monoxide Detector

CO2 — 4.5lt CO2 Fire Extinguisher

AFFF — 6lt AFFF Multi–purpose foam Fire Extinguisher

First Floor D2 doors - 762mm x 1981mm

Existing walls

SCALE BAR: 1:50

0 1 2 3 4 5m

REV:	DRAWN BY:	DATE:	CHECKED BY:	DATE:	ISSUED BY:	DATE:
	Faizan Ali	07/04/26	Angbeen Najam	06/07/26	Angbeen Najam	06/07/26
	Angbeen Najam	22/09/26	Angbeen Najam	22/09/26	Angbeen Najam	22/09/26

SCALES @ A1	ISSUING OFFICE	INTERNAL PROJECT No.
1:50		

STATUS	PURPOSE OF ISSUE

PROJECT

Tolbooth st Kirkcaldy

DRAWING TITLE

Fire Compartmentation Plan

CLIENT

DRAWING NUMBER	REVISION
A-15	

PROJ | ORIGIN | ZONE | LEVEL | FILETYPE | ROLE | NO