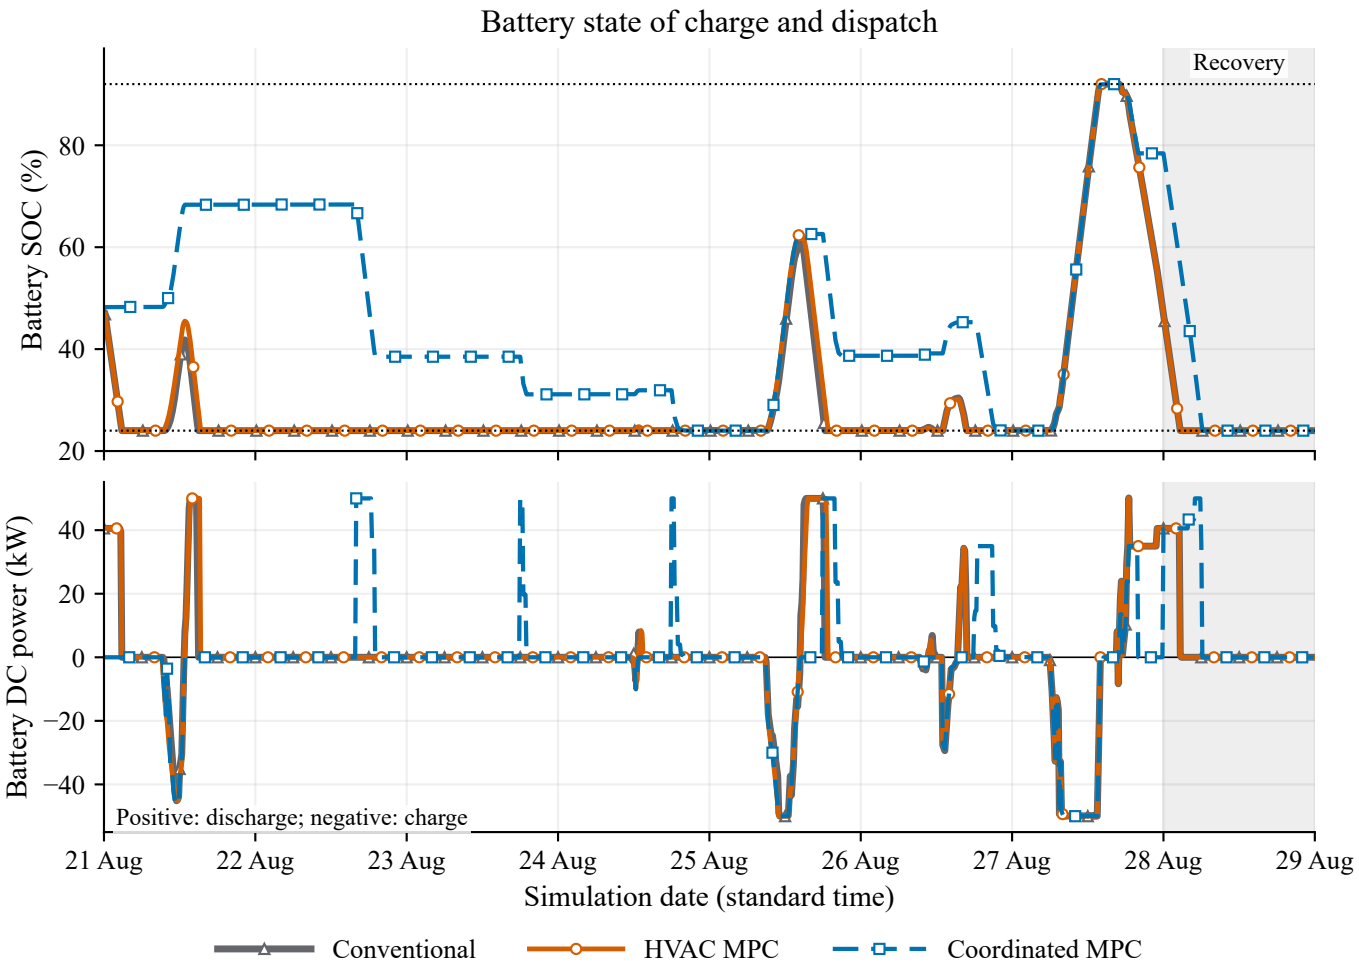
Battery state of charge and dispatch
Recovery
Battery SOC (%)
80
60
40
20
Battery DC power (kW)
40
20
0
−20
−40
Positive: discharge; negative: charge
21 Aug
22 Aug
23 Aug
24 Aug
25 Aug
26 Aug
27 Aug
28 Aug
29 Aug
Simulation date (standard time)
Conventional
HVAC MPC
Coordinated MPC