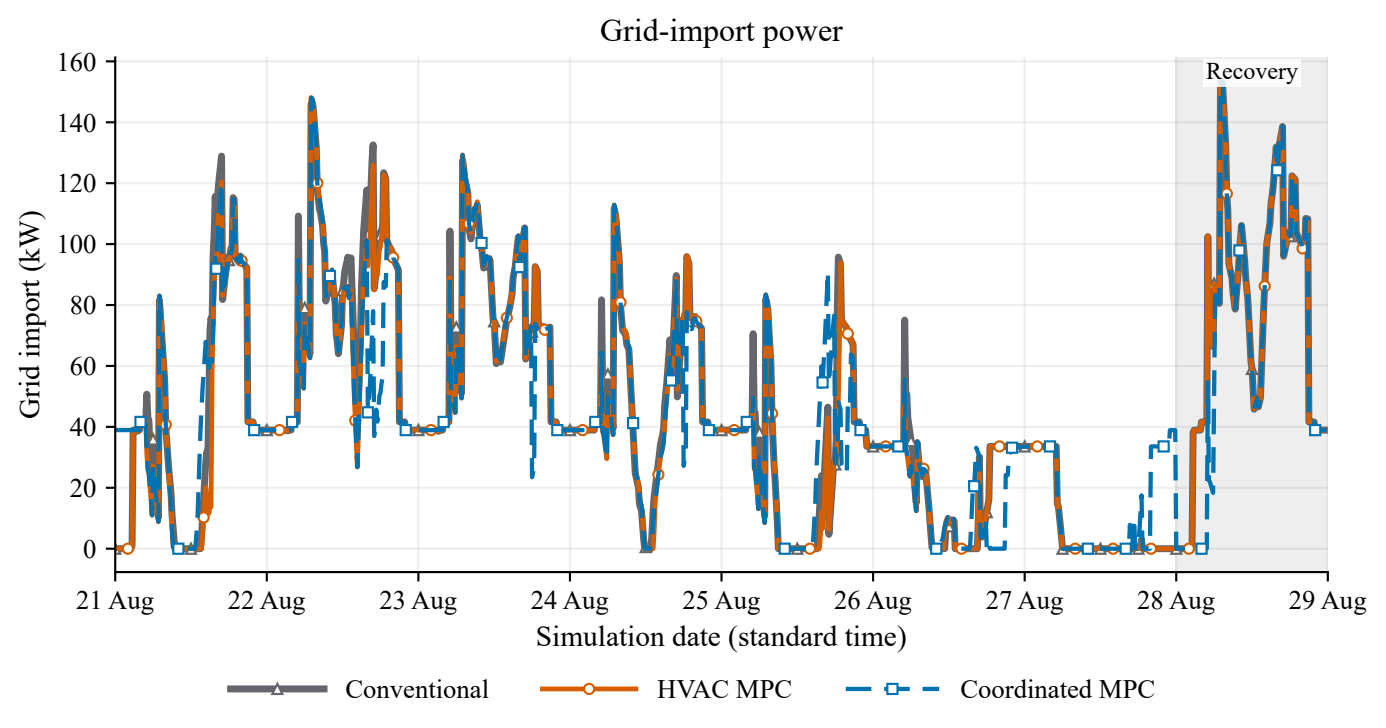
Grid-import power
Recovery
Grid import (kW)
160
140
120
100
80
60
40
20
0
21 Aug
22 Aug
23 Aug
24 Aug
25 Aug
26 Aug
27 Aug
28 Aug
29 Aug
Simulation date (standard time)
Conventional
HVAC MPC
Coordinated MPC