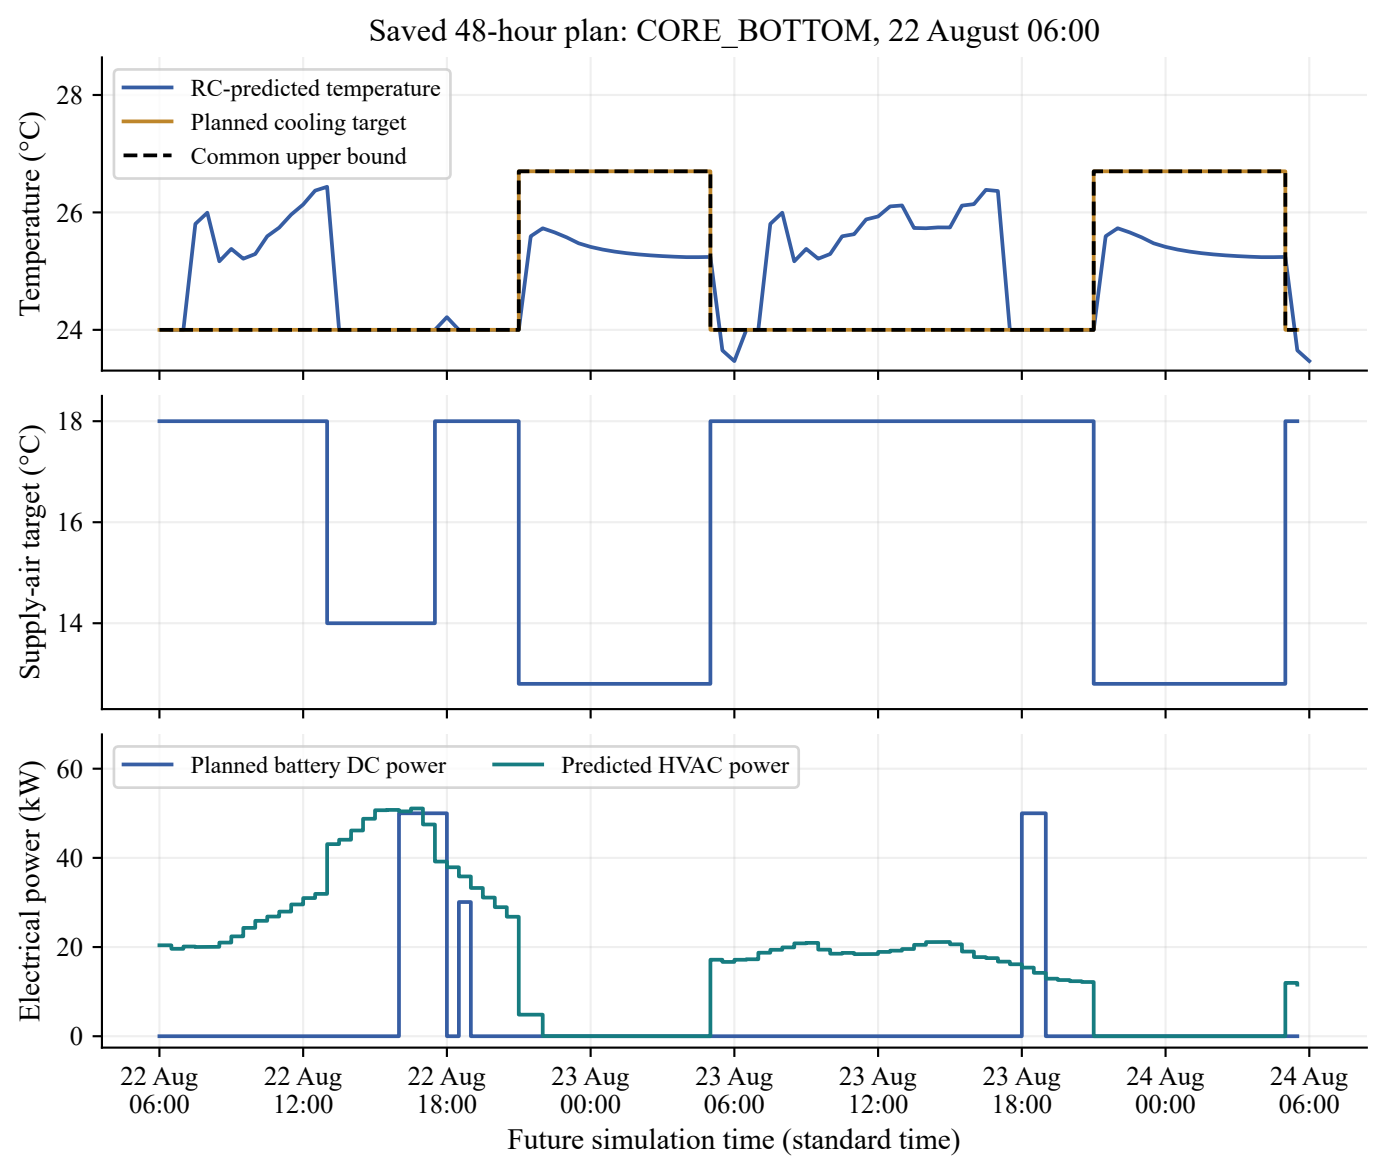
Saved 48-hour plan: CORE_BOTTOM, 22 August 06:00
RC-predicted temperature
Planned cooling target
Common upper bound
Temperature (°C)
28
26
24
Supply-air target (°C)
18
16
14
Planned battery DC power
Predicted HVAC power
Electrical power (kW)
60
40
20
0
22 Aug 06:00
22 Aug 12:00
22 Aug 18:00
23 Aug 00:00
23 Aug 06:00
23 Aug 12:00
23 Aug 18:00
24 Aug 00:00
24 Aug 06:00
Future simulation time (standard time)