
PLOT 83 / NEW CAIRO

B1 / BASEMENT -3.20 m


SCHEMATIC / CONSTRAINT STUDY

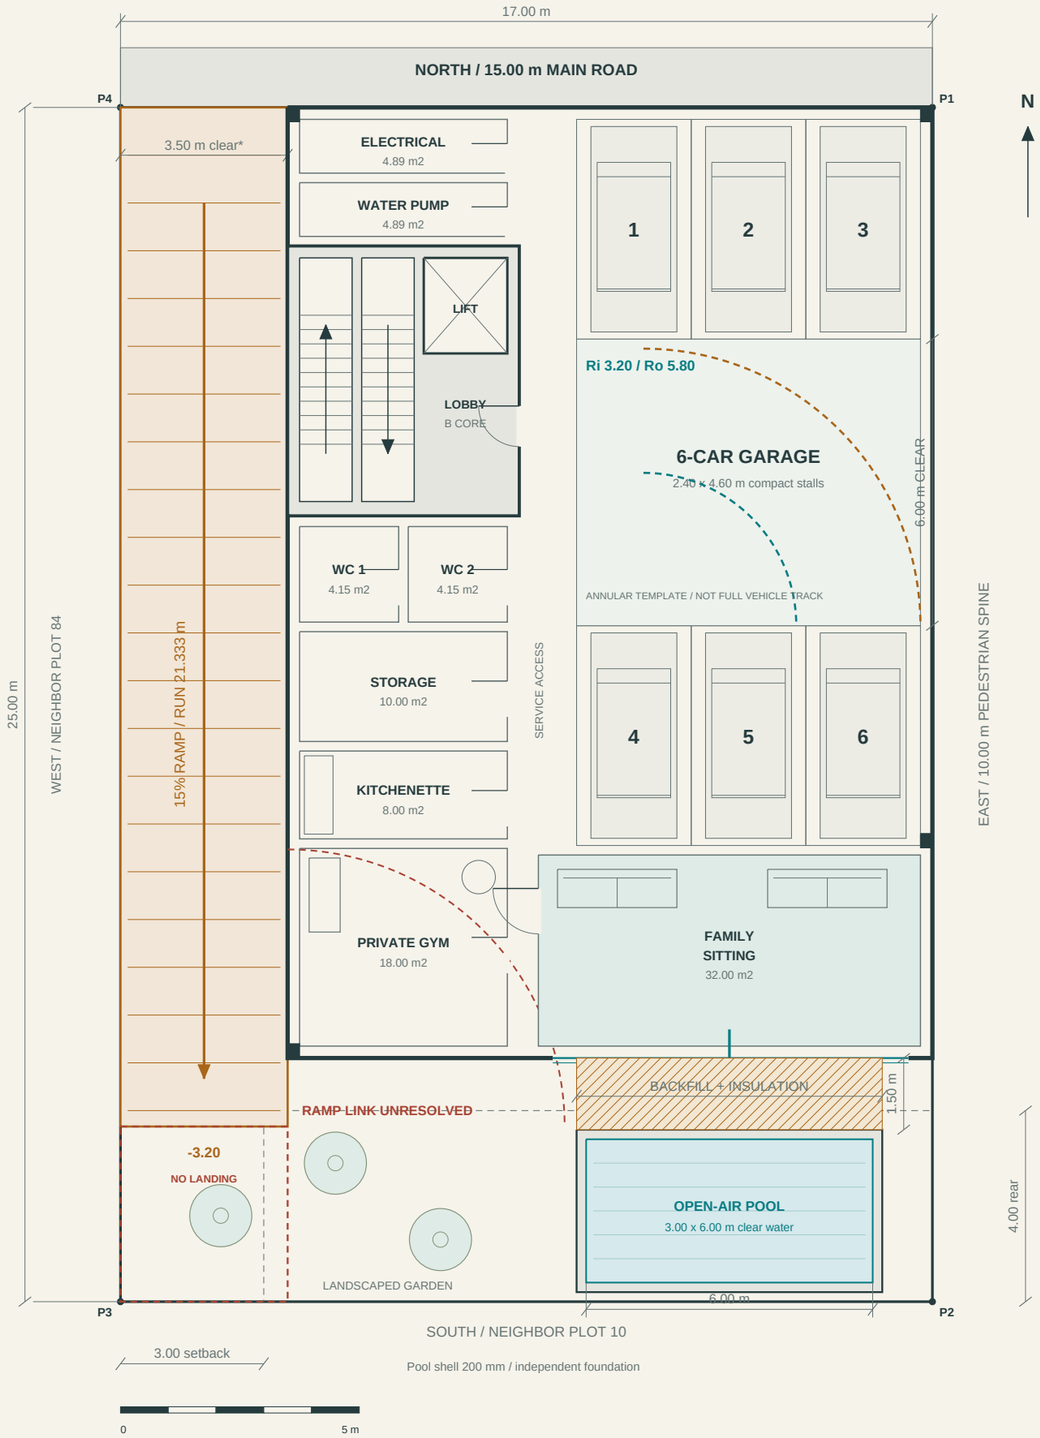

PLOT 83 / NEW CAIRO

00 / GROUND +0.45 m


SCHEMATIC / CONSTRAINT STUDY

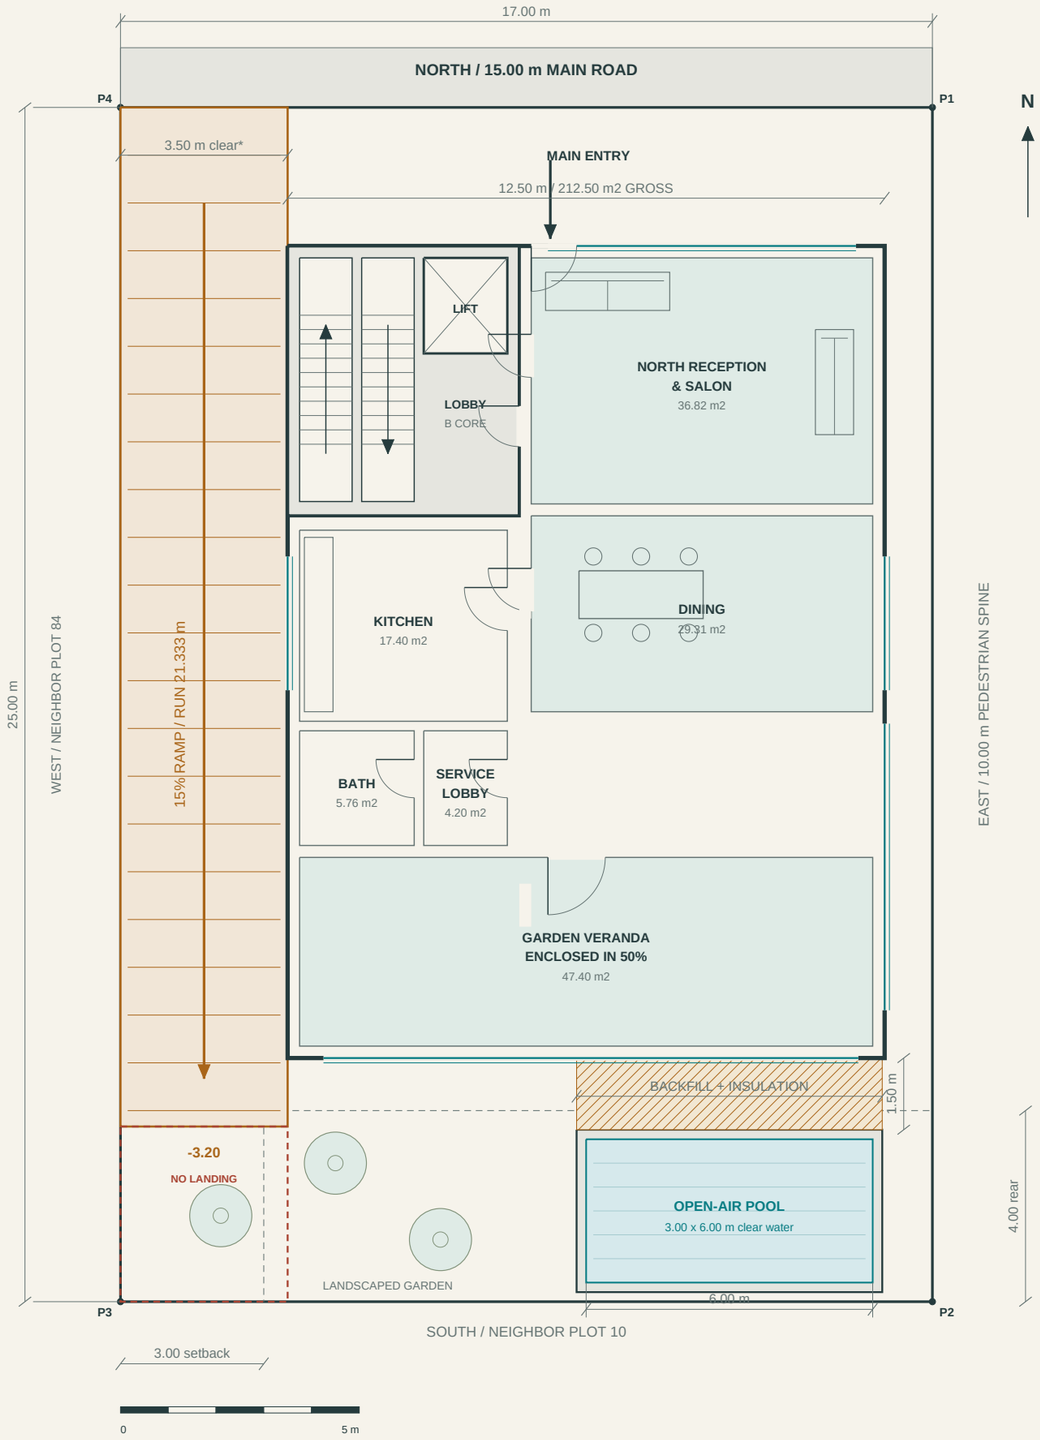

PLOT 83 / NEW CAIRO

01-03 / TYPICAL +3.75 / +7.05 / +10.35 m


SCHEMATIC / CONSTRAINT STUDY

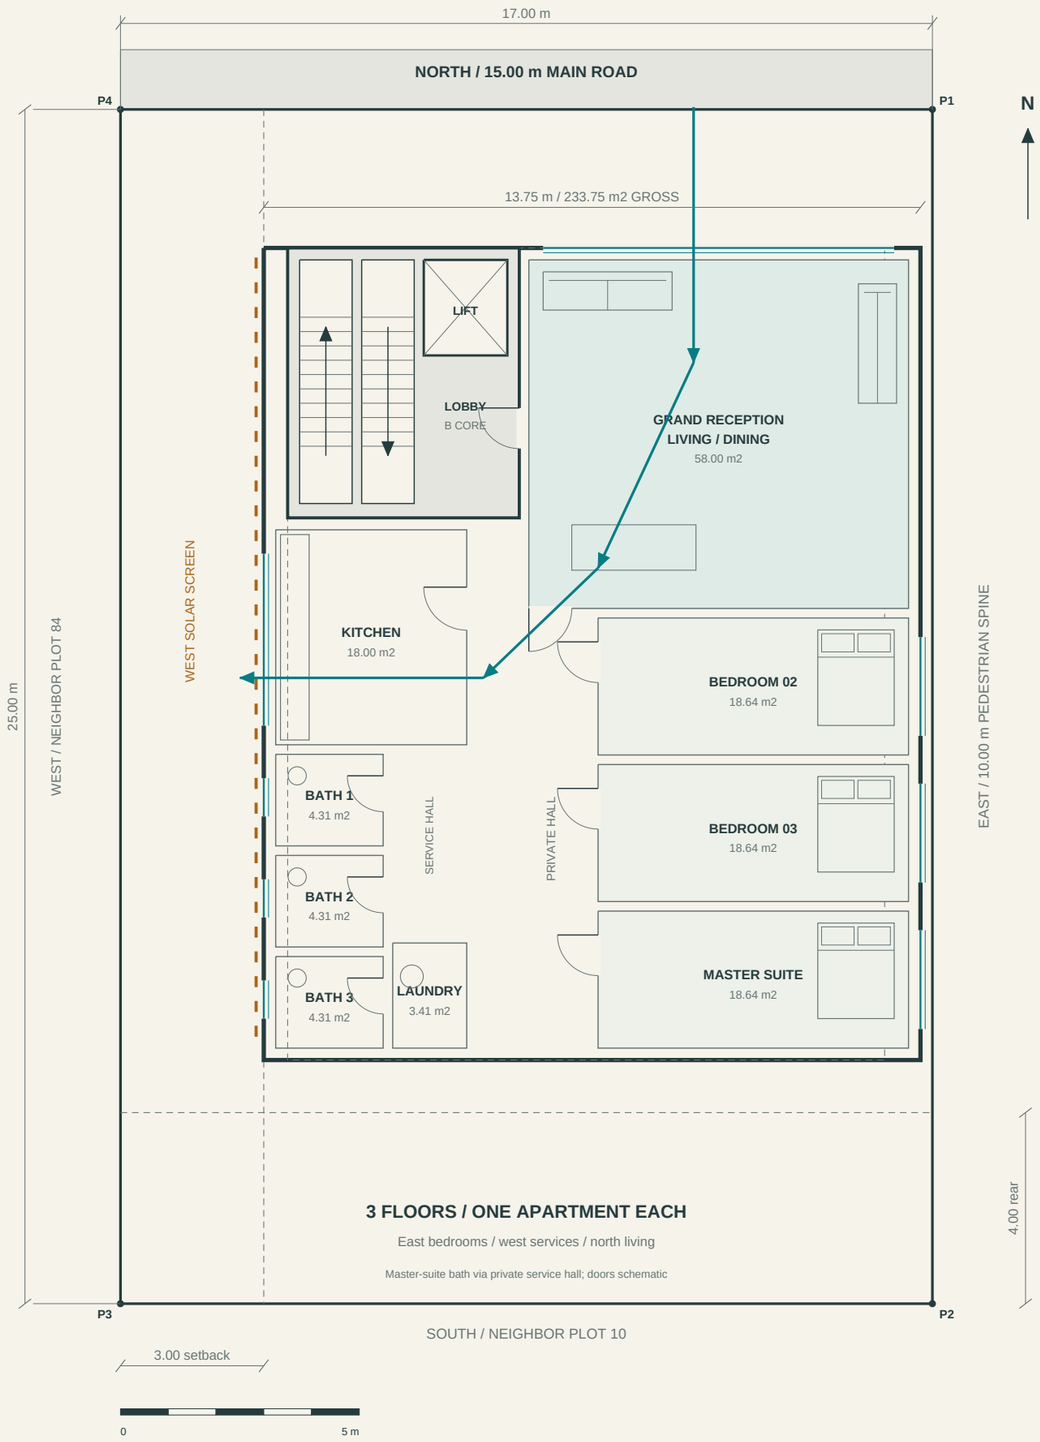

PLOT 83 / NEW CAIRO

R / ROOF +13.65 m


SCHEMATIC / CONSTRAINT STUDY

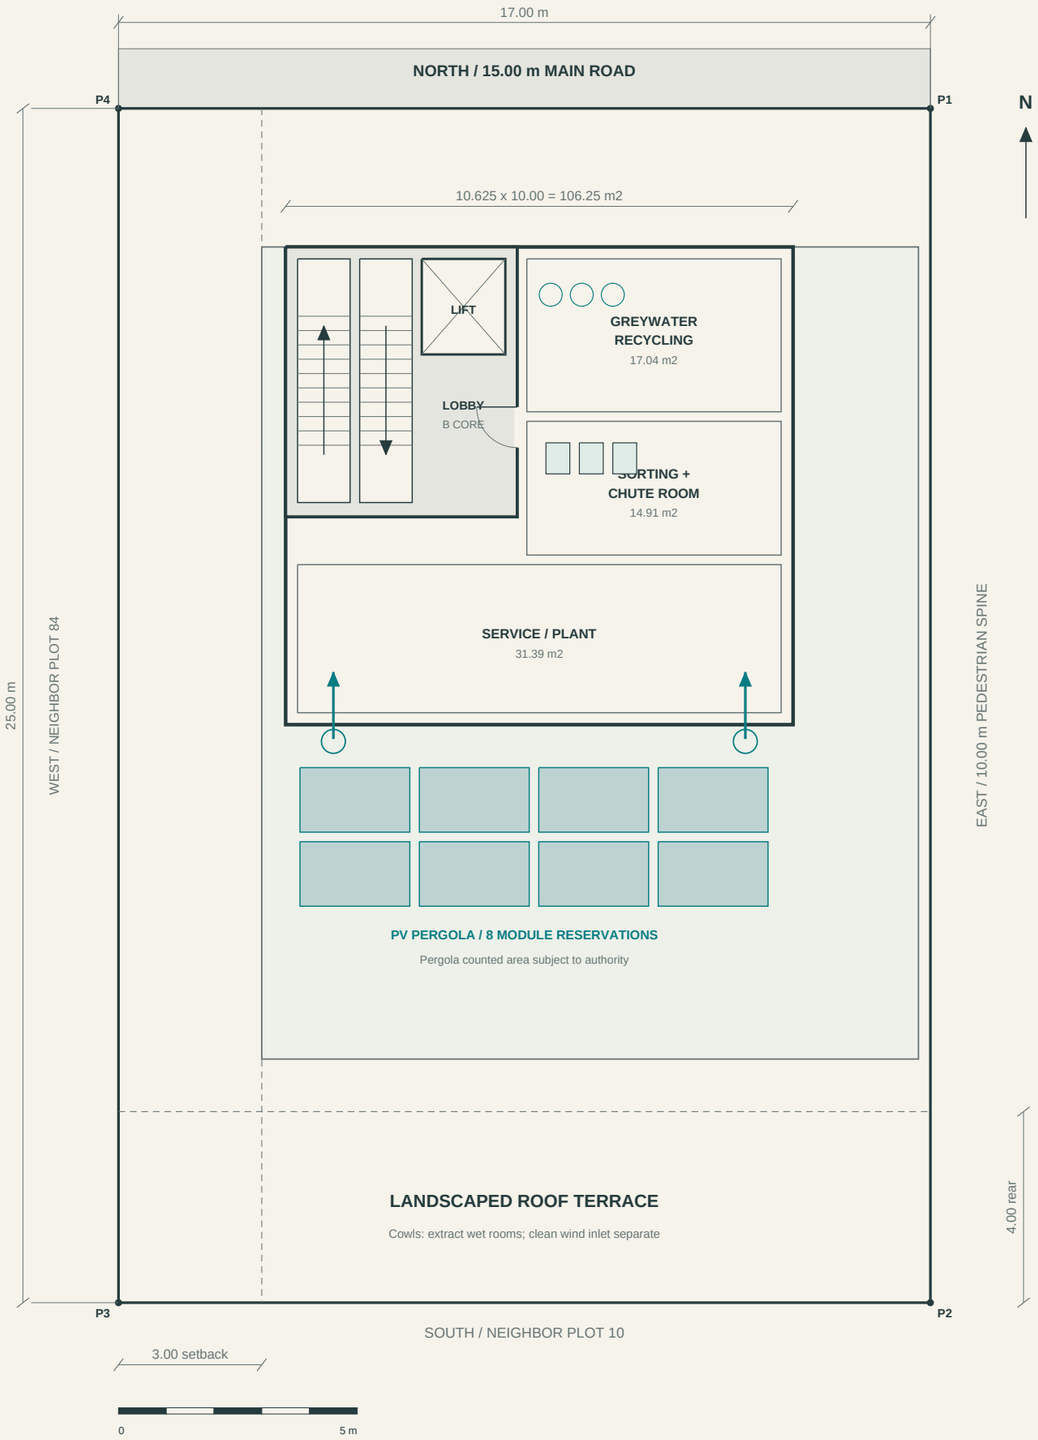

PLOT 83 / NEW CAIRO

A-A / NORTH-SOUTH ENVIRONMENTAL SECTION

SCHEMATIC / CONSTRAINT STUDY

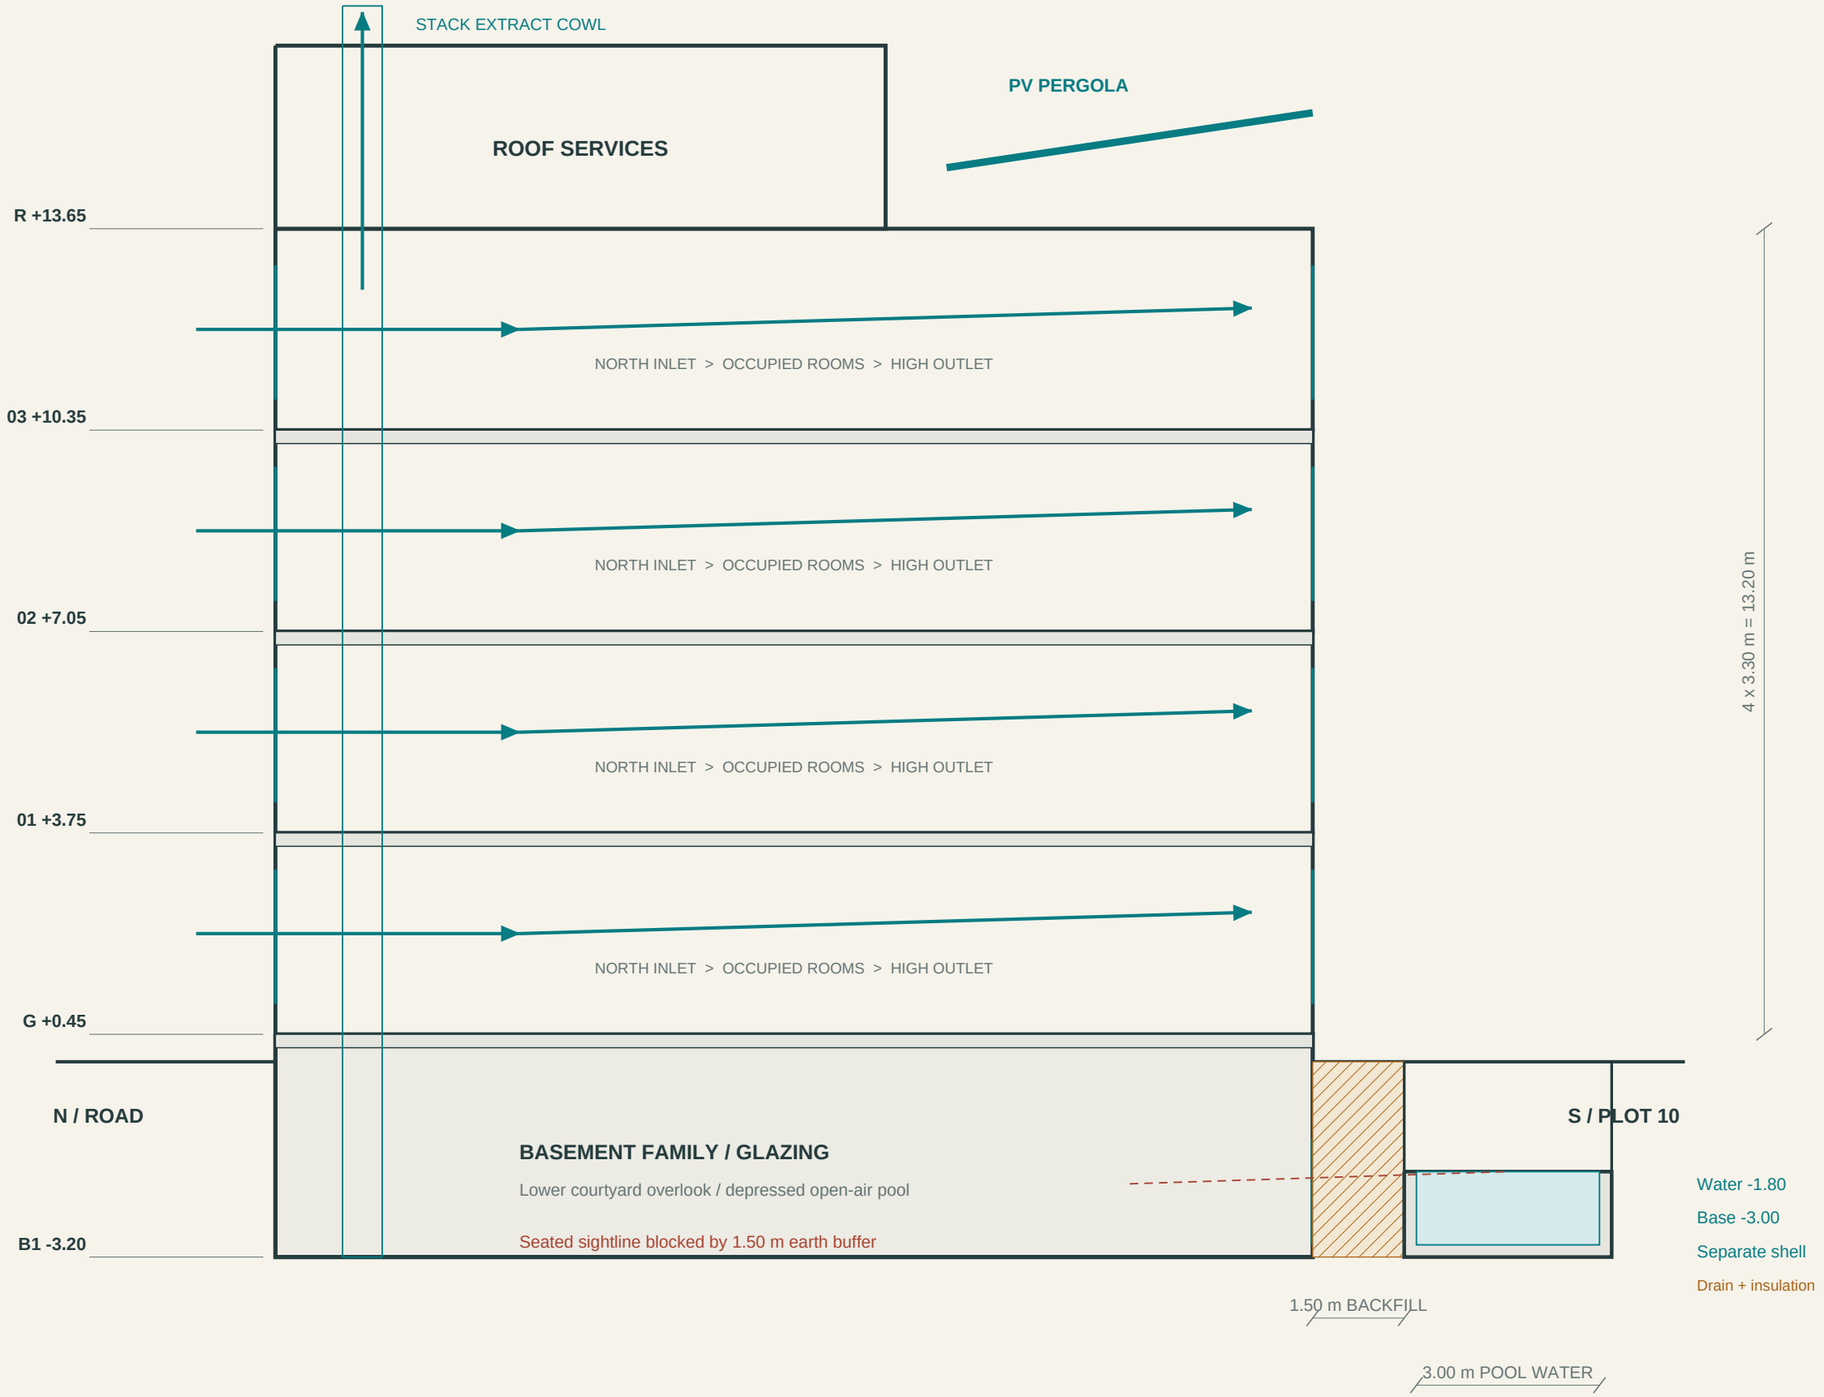


SECTION A-A: schematic structure; no certified spans, fire or MEP sizing

PLOT 83 / NEW CAIRO

P / PASSIVE SOLAR + WIND STUDY

SCHEMATIC / CONSTRAINT STUDY

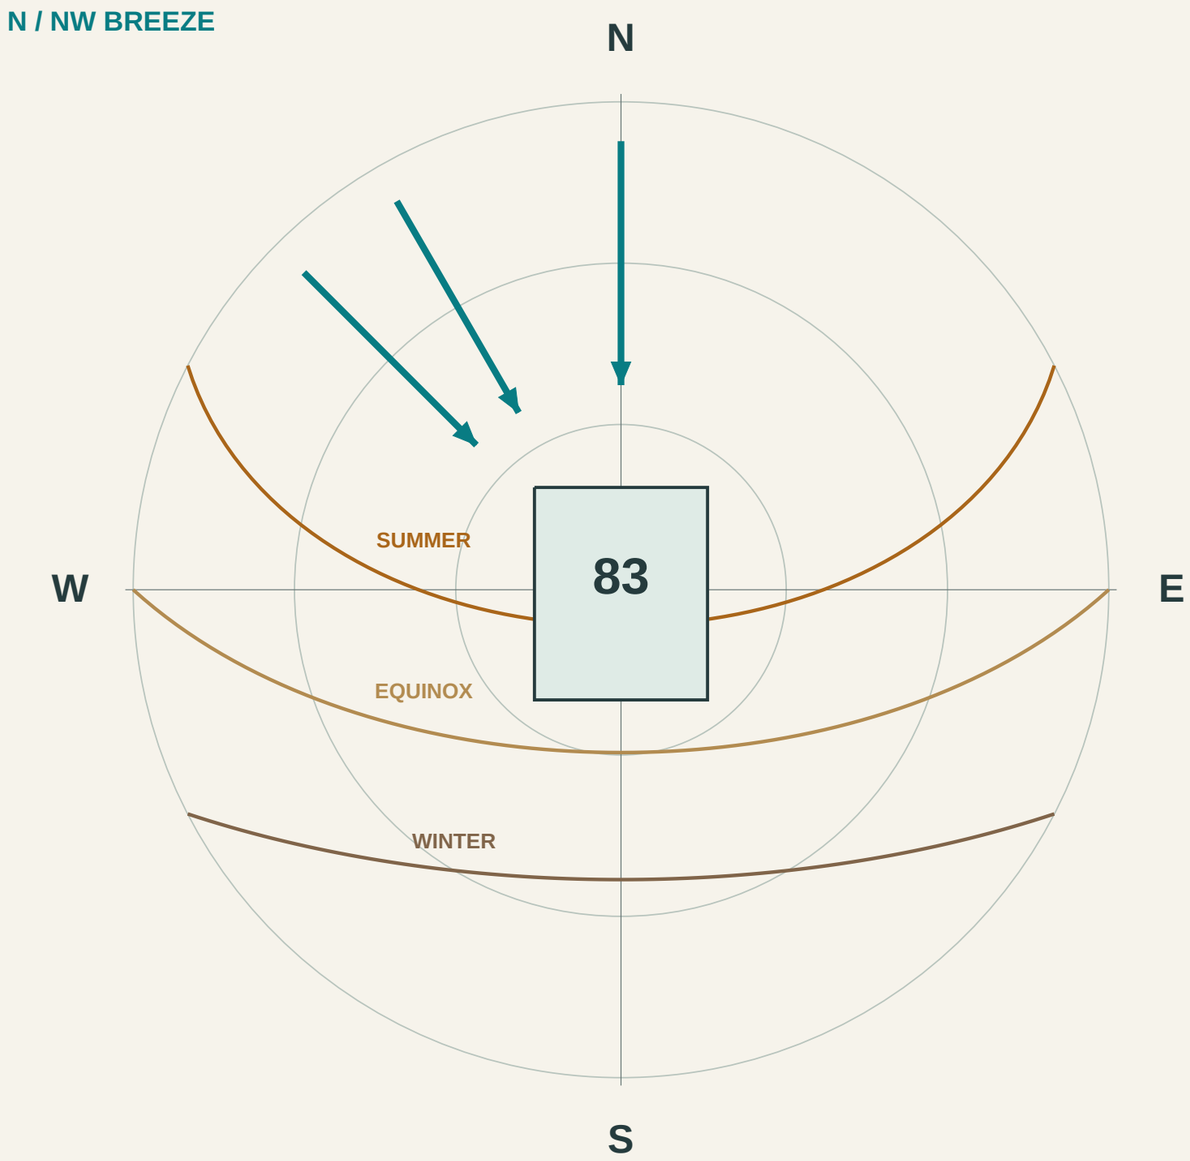


New Cairo latitude assumption: 30.03 N / true north

Jun: noon 83.41 deg **Mar/Sep: noon 59.97 deg** **Dec: noon 36.53 deg**

Directional wind study only; no measured frequency / wind-rose dataset.

West mashrabiya + east morning light + north cross-ventilation.


A / WRAPPED LIFT

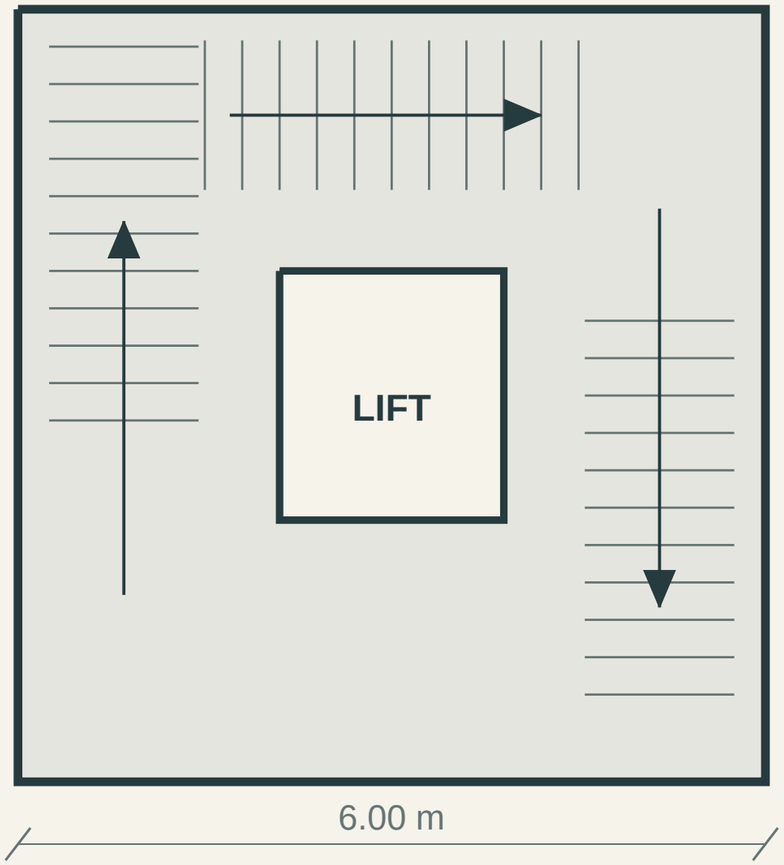

A core reservation: 37.20 m2

Multi-direction landings / more wall returns

B / ADJACENT U-STAIR

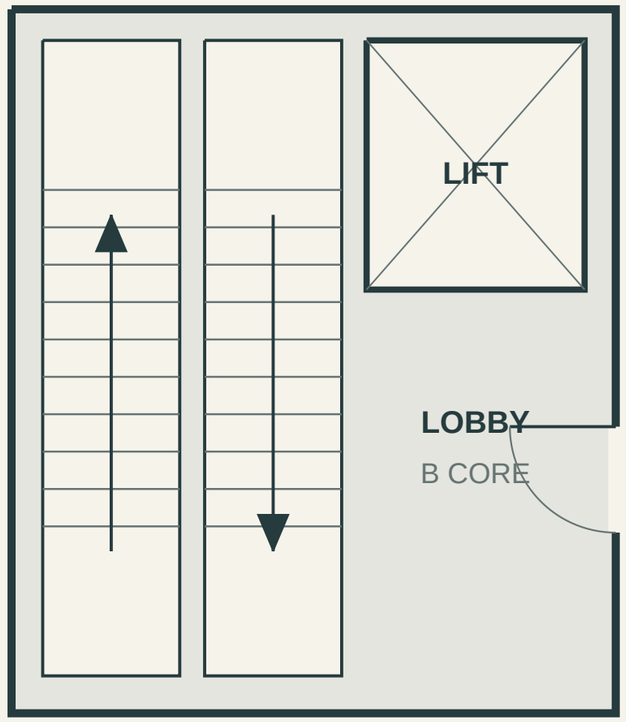

B core reservation: 27.40 m2

SELECTED / aligned shear-wall concept

Core-excluded gross proxy: A 84.09% / B 88.28% / relative gain 4.98%

14% NET-TO-GROSS GAIN IS A REQUESTED TARGET, NOT VERIFIED.

Identical gross denominator; partition, riser and wall deductions not included.

AREA / GROSS ENCLOSED FOOTPRINT

LAND	1 x 425.00 m2	100% of land
GROUND	1 x 212.50 m2	50% of land
TYPICAL	3 x 233.75 m2	55% of land
ROOF	1 x 106.25 m2	25% of land

TOTAL ABOVE GROUND: 1020.00 m2 / basement excluded

HOLD POINTS / DO NOT ISSUE FOR CONSTRUCTION

H01 / RAMP WIDTH / SETBACK

3.50 m clear ramp exceeds 3.00 m west setback; wall thickness additional.

H02 / RAMP CONNECTION / SWEPT PATH

21.333 m at 15% leaves 3.667 m; landing and 5.80 m outer turn do not fit.

H03 / POOL OVERLOOK / EARTH BUFFER

A grade-height earth buffer obstructs basement full-height glazing and a seated pool view.

H04 / CORE PERFORMANCE CLAIM

Option B selected; the requested 14% net-to-gross advantage is not demonstrated.

H05 / CODE / STRUCTURE / SERVICES

No structural, Egyptian-code, fire, accessibility, mechanical or local-authority certification.

H06 / CONTEST ELIGIBILITY

Employer brief states: AI-generated results are not accepted. No submission performed.