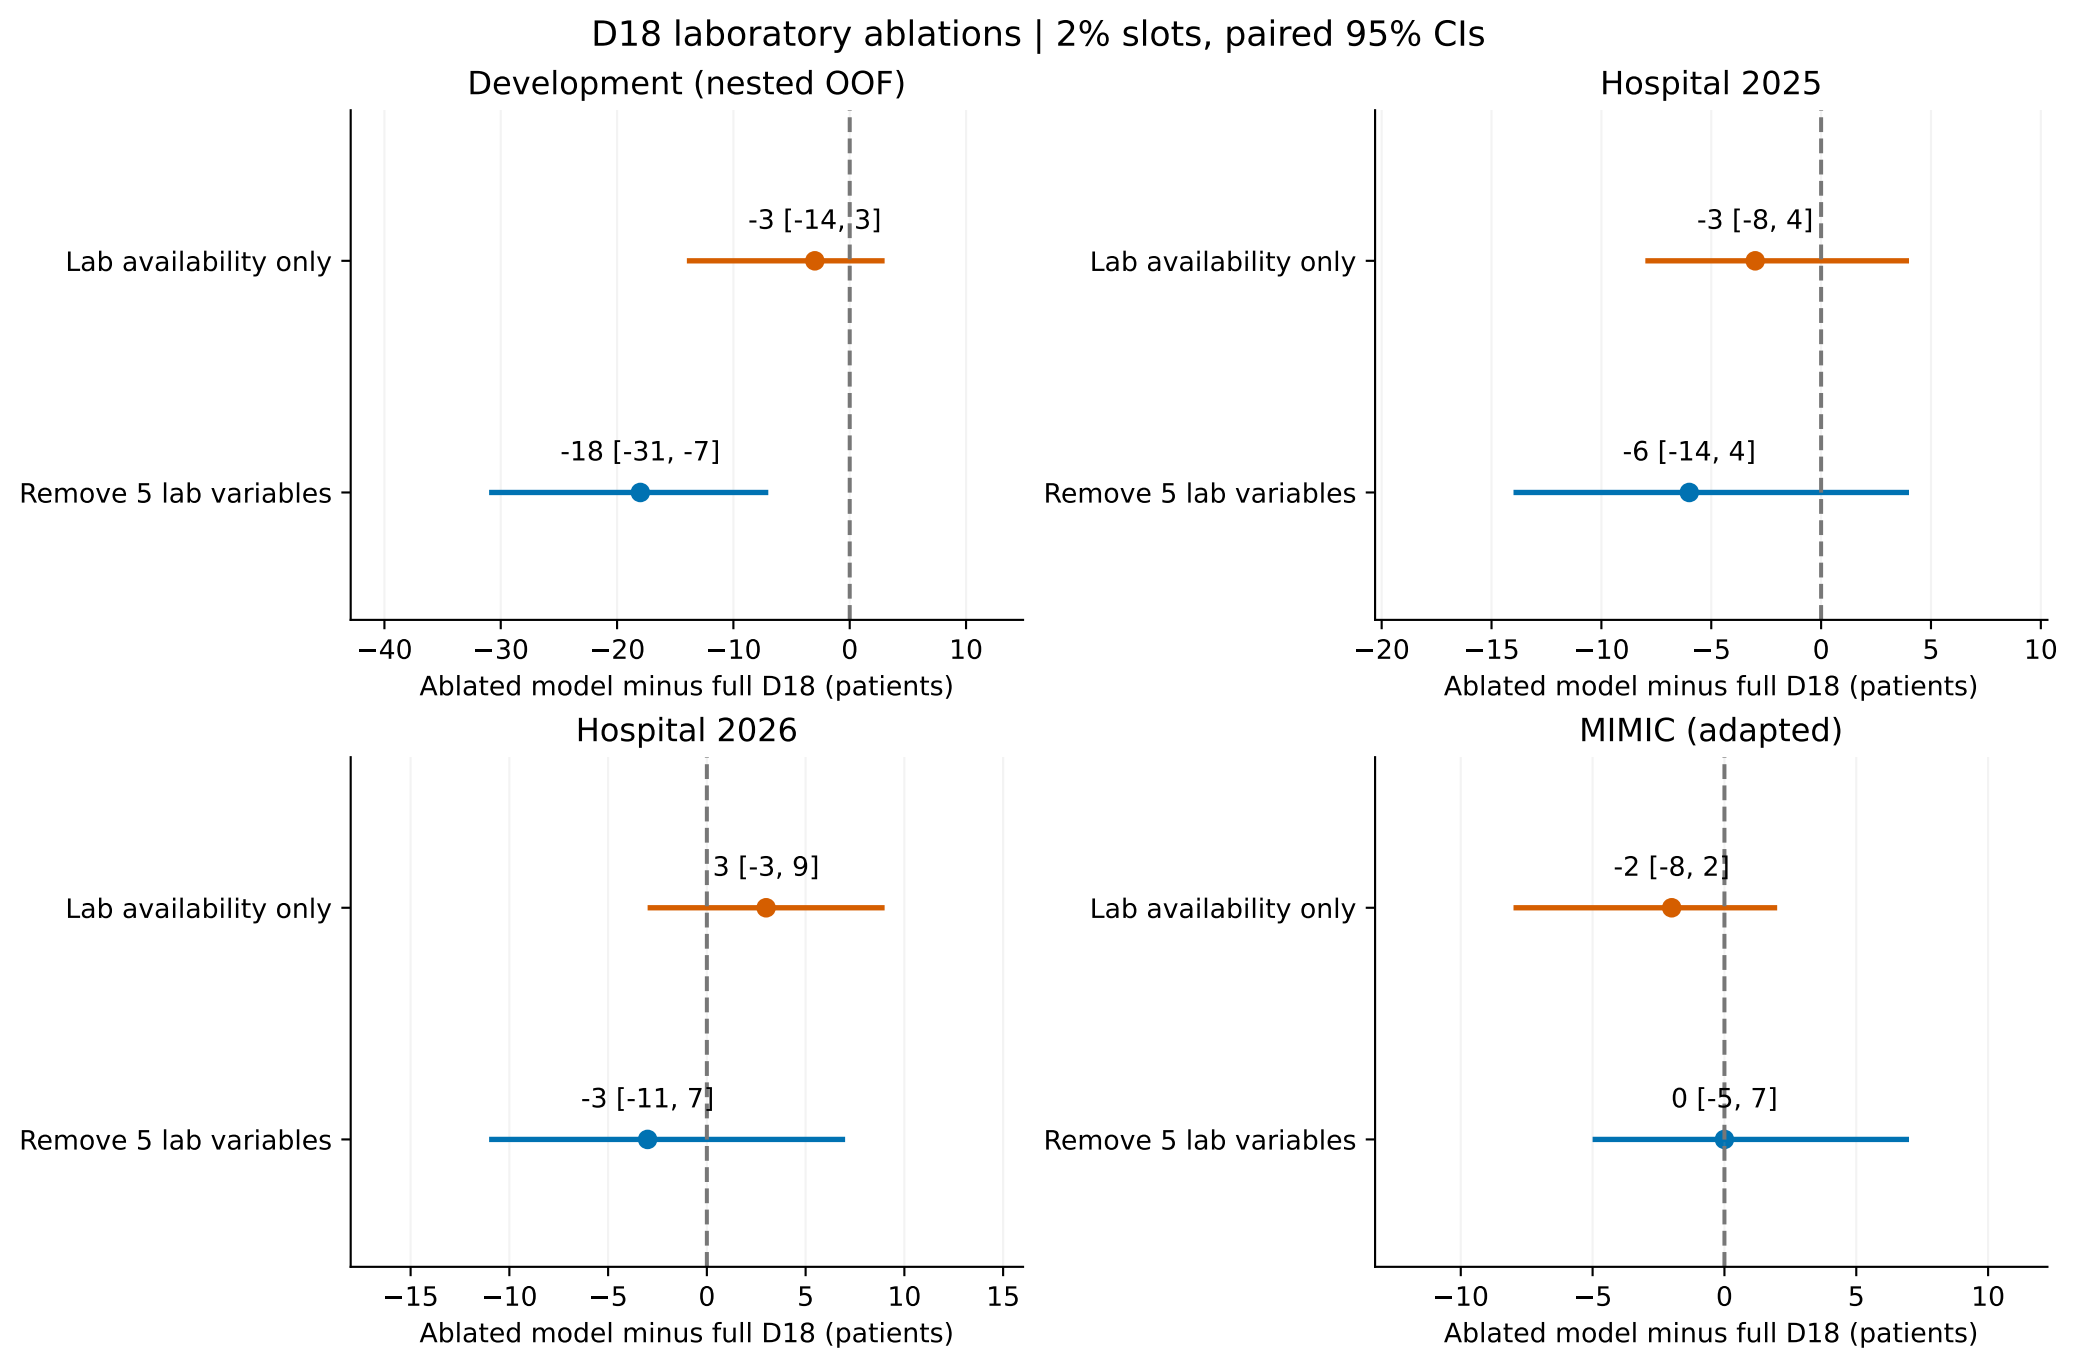
D18 laboratory ablations | 2% slots, paired 95% CIs
Development (nested OOF)
Lab availability only
Remove 5 lab variables
-3 [-14, 3]
-18 [-31, -7]
−40
−30
−20
−10
0
10
Ablated model minus full D18 (patients)
Hospital 2025
Lab availability only
Remove 5 lab variables
-3 [-8, 4]
-6 [-14, 4]
−20
−15
−10
−5
0
5
10
Ablated model minus full D18 (patients)
Hospital 2026
Lab availability only
Remove 5 lab variables
3 [-3, 9]
-3 [-11, 7]
−15
−10
−5
0
5
10
15
Ablated model minus full D18 (patients)
MIMIC (adapted)
Lab availability only
Remove 5 lab variables
-2 [-8, 2]
0 [-5, 7]
−10
−5
0
5
10
Ablated model minus full D18 (patients)