

Sensors and actuators used:

- Pressure: PT660
- Flow rate: FT581
- Valve: FV640, FV641, FV642, FV643
- Control valve: CV601, CV602, CV581
- Level: LI660 (LT660+LT661), LI670 (LT670+LT671)


The user chooses:

- Level: LI660setpoint, LI660mini, LI660Maxi, LI670setpoint, LI670mini, LI670Maxi
- Pressure: PT660setpoint
- Flow: FT581limit
- Control valve: CV601%opening, CV602%opening, CV581%opening
- Mode: Regulation or Intermittent

Initial conditions:

- Liquid or Vacuum insert selected
- Sequences from 1 to 3 stopped
- Sequences from 12 to 13 stopped
- Sequences 6 & 8 in operation

Vacuum mode

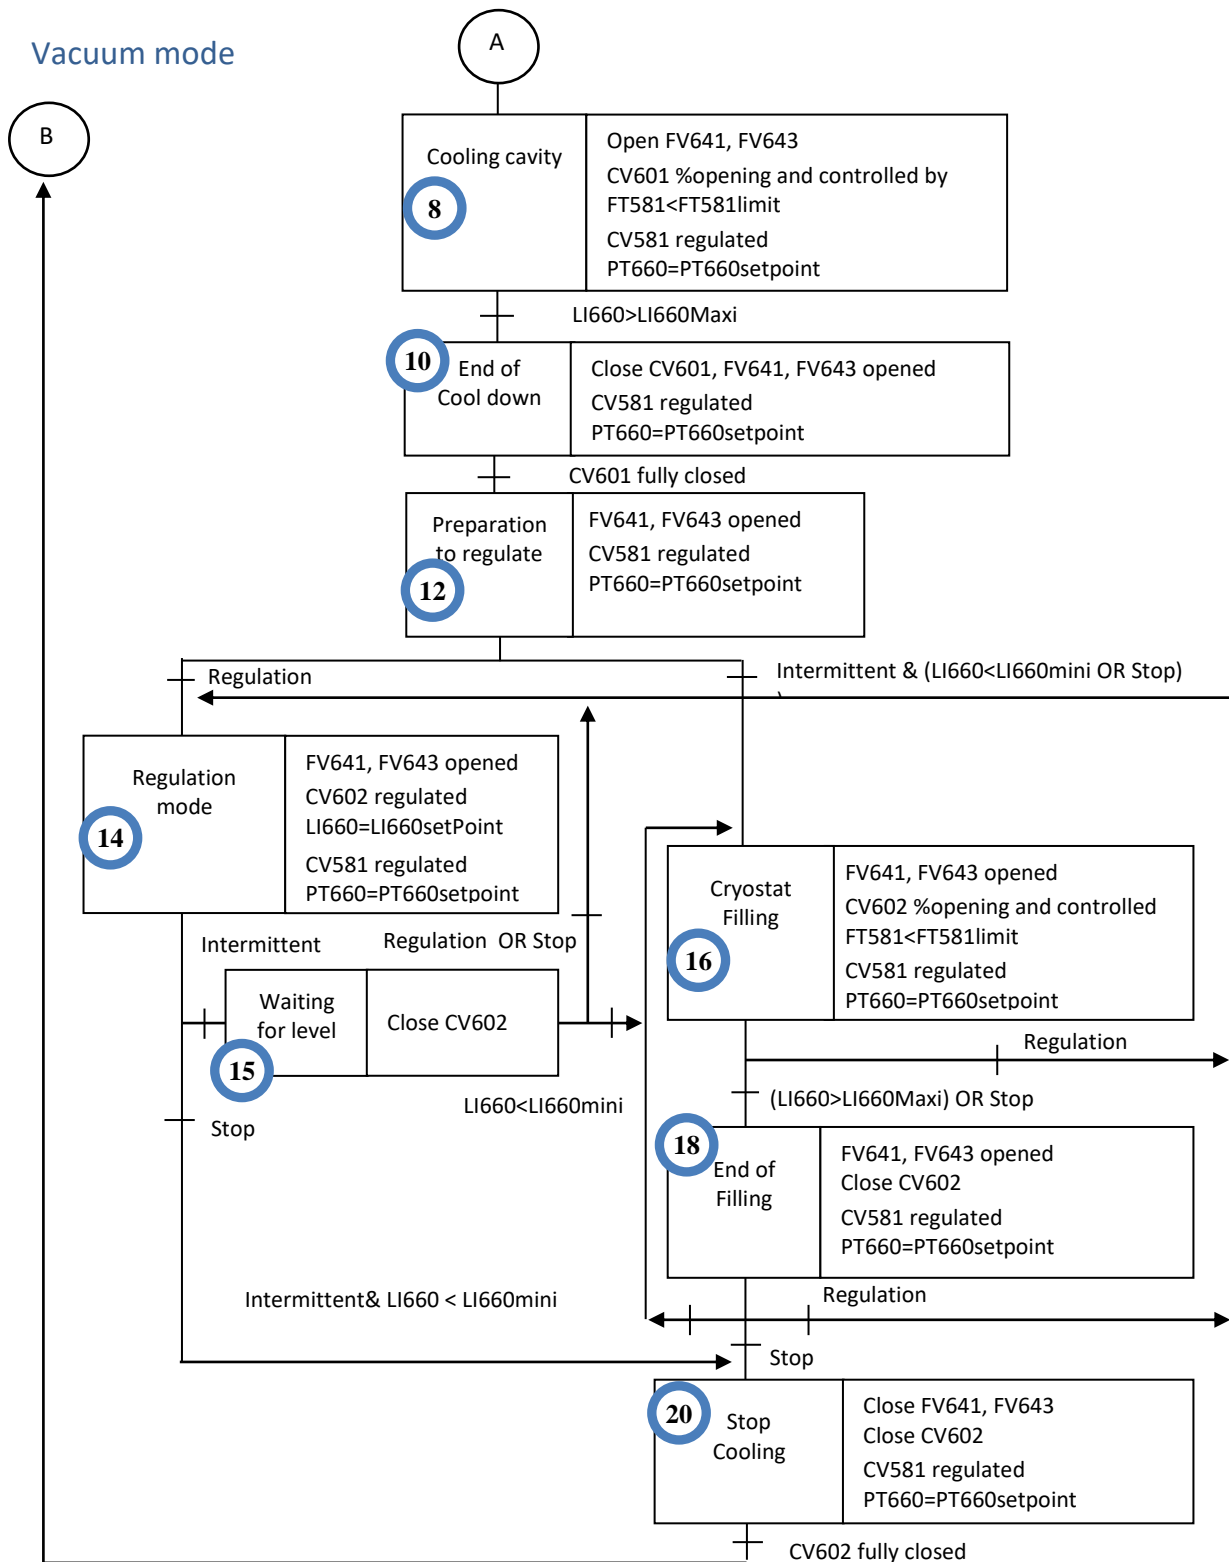

Liquid mode

