
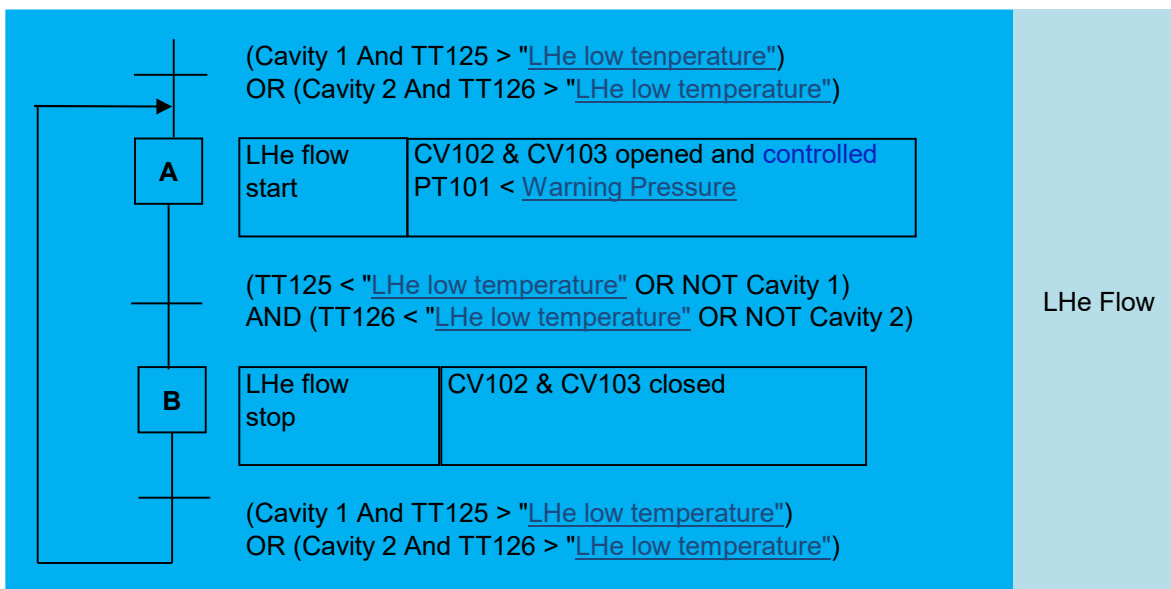


## SQ11 : STANDBY 40 K

FC n°212
DB n°212

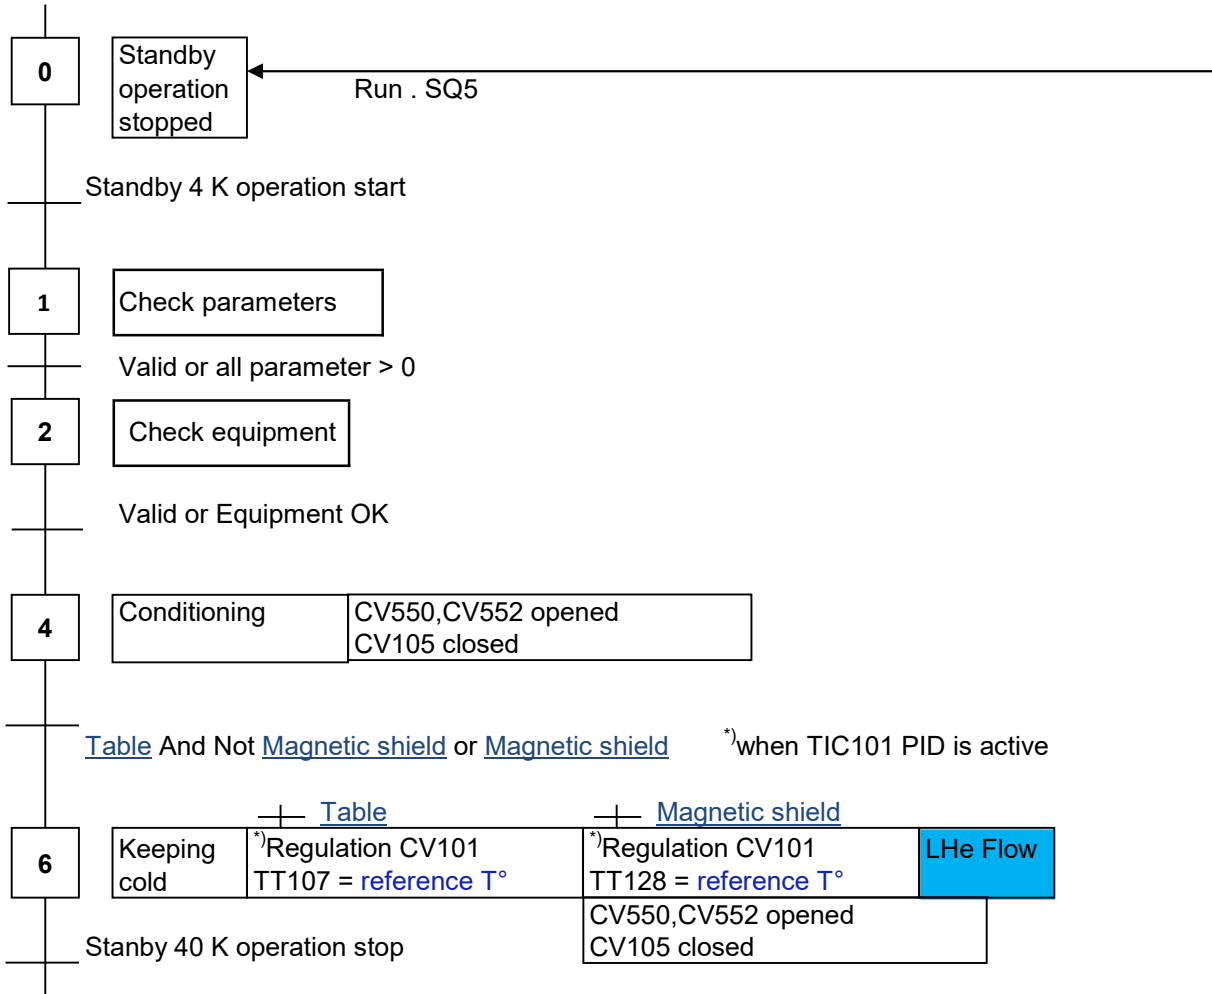

Note:

:CV102 and CV103 will be closed when the pressure PT101 will be higher than "Warning pressure" parameter