Guangzhou Building Materials Institute Limited Company

Test Report

GML-V021

Client:	DONGGUAN TECH FREE AIR CONDITIONING MFY, LTD.	Report No.:	V03-1400040(E)
Project Name:	---	Date Received:	2014-03-10
Sample Name:	Foaming material	Date Tested:	2014-03-10
Type of test:	Sample delivered by client	Date of issue:	2014-03-21
Position of construction:	---	Test Standard:	BS EN 13501-1-2007

Test items		Measure unit	Technical requirement	Test results	Individual judgment
Fs	Surface (mm)	mm	≤150	73	Compliant
	Edge (mm)			80	Compliant
Whether the filter paper is ignited		---	NO	NO	Compliant
Specimen photos before and after the test see the next page					
Conclusion	The inspected items are satisfied the technical requirements of BS EN 13501-1:2007 about class E.				
Remark	Productor: Guangdong wanhua RongWei polyurethane co., LTD; Sample Type: RH2038101 / 45mm; Brand: WanHua.				

Remark: Test report shall not be reproduced except in full, repreduced report is invalid without the seal of original"special stamp of test report" of the centre.

Laboratory address: No.43, Jinzhou North Road, Changzhou, Huangpu, Guangzhou

1WT031400907

Project Code: Y666 Sample Number: 1V031400036

Certified by: 赵侠 Checked by: 姜欣 Tested by: 易爱华

Guangzhou Building Materials Institute

Test Report (Continue)

Report No.: V03-1400040(E)

Specimen photos before and after the test

Before the test
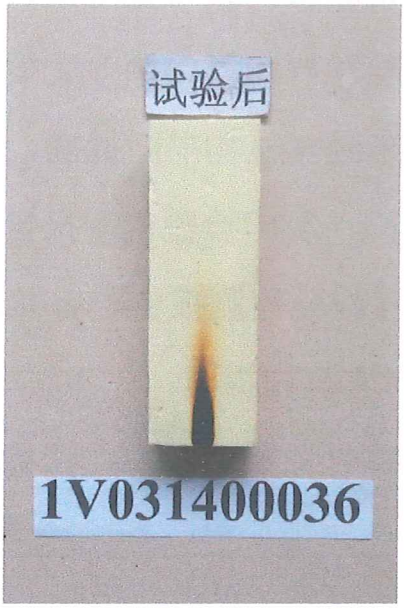
After the test