Guangzhou Building Materials Institute Limited Company

中国认可 国际互认 CNAS TESTING L0300-0157

Test Report

GML-V021

Client:	DONGGUAN TECH FREE AIR CONDITIONING MFY, LTD.	Report No.:	V03-1400018(E)
Project Name:	---	Date Received:	2014-01-27
Sample Name:	Steel wire sealant rubber strip	Date Tested:	2014-02-10
Type of test:	Sample delivered by client	Date of issue:	2014-04-02
Position of construction:	---	Test Standard:	BS EN 13501-1:2007

Test items		Measure unit	Technical requirement	Test results	Individual judgment
Fs	Surface (mm)	mm	≤150	36	Compliant
	Edge (mm)			52	Compliant
Whether the filter paper is ignited		---	NO	NO	Compliant
Specimen photos before and after the tests see the next page					
Conclusion	The inspected items are satisfied the technical requirements of BS EN 13501-1:2007 about class E.				
Remark	Productor: Dongguan united trading co., LTD; Sample Type: EPDM-W-1m ; Brand: SOUTHCO				

Remark: Test report shall not be reproduced except in full, repreduced report is invalid without the seal of original"special stamp of test report" of the centre.

Laboratory address: No.43, Jinzhou North Road, Changzhou, Huangpu, Guangzhou

1WT031400578

Project Code: Y666 Sample Number: 1V031400022

Certified by: 赵侠 Checked by: 易爱华 Tested by:

Guangzhou Building Materials Institute

Test Report (Continue)

Report No.: V03-1400018(E)

Specimen photos before and after the test

Before test

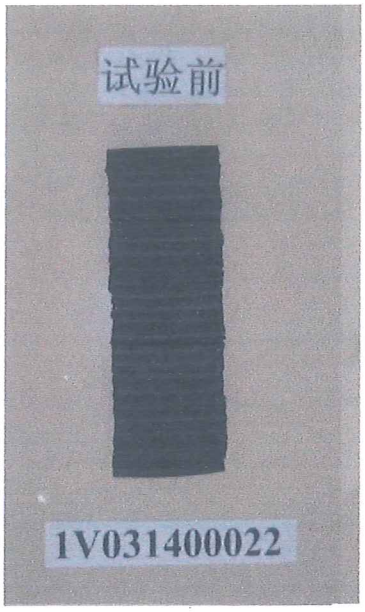
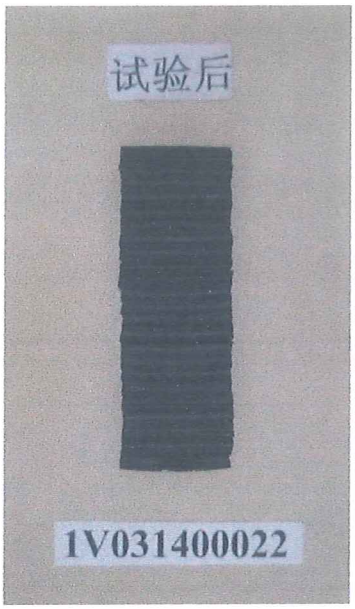
After test