


規制番号 名称	01-0095 県病院入口	(UD-TTR)	運用	2022年2月25日	製造番号	1M3783
管制番号 名称	10095 県病院入口	1012号「版4」	開始日時	2時15分	製造年月	2021年12月
					メーカー	コイト電工

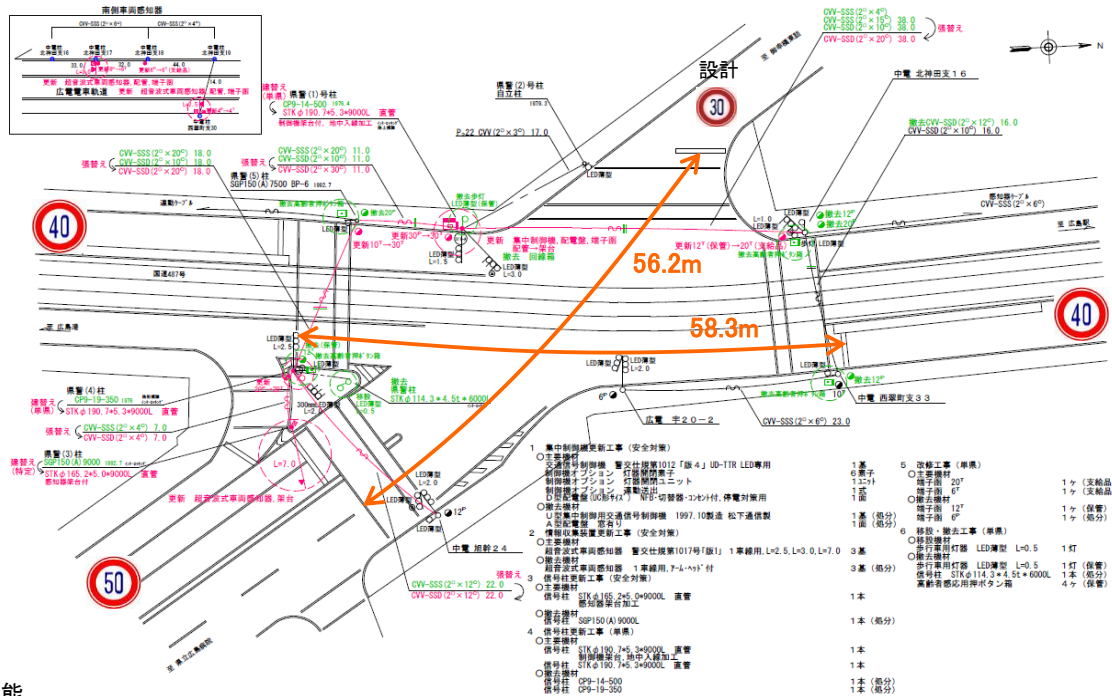


付加機能
連動出力
ステータス機能
S3:閃光

ステップ番号	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
ステップ名称	1PG	1PW	1 G	1 Y	1 R	2PG	2PW	2 G	2 Y	2 A	2 A	2 Y	2 R							
流動図																				
1P	[1P]																			
1P'	[3P]																			
1	[1V]																			
2P	[2P]																			
2	[2V]																			
2'	[3V]																			
2'右矢	[1A]																			
PU	109					109					109									
PL (93秒)	18	6	10	3	5	17	6	10	3	5	5	2	3							
保安秒時 (150秒)	50	6	10	3	5	28	6	10	3	5	19	2	3							
最長時間(秒)	110	110	110	10	10	110	110	110	10	110	110	10	10							
最短時間(秒)	6	1	1	1	1	6	1	1	1	1	1	1	1							
AB連動出力	A	B	B	B	B	B	A	A	A	A	A	A	A							

規制番号 名称	10095 県病院前電停	運 用	H. 9年11月27日	製造番号	7H0725
管制番号 名称	10095 県病院前電停 (U集中)		開始日時	11時02分 ~	製造年月
				メーカー	松下電器産業(株)

Int132

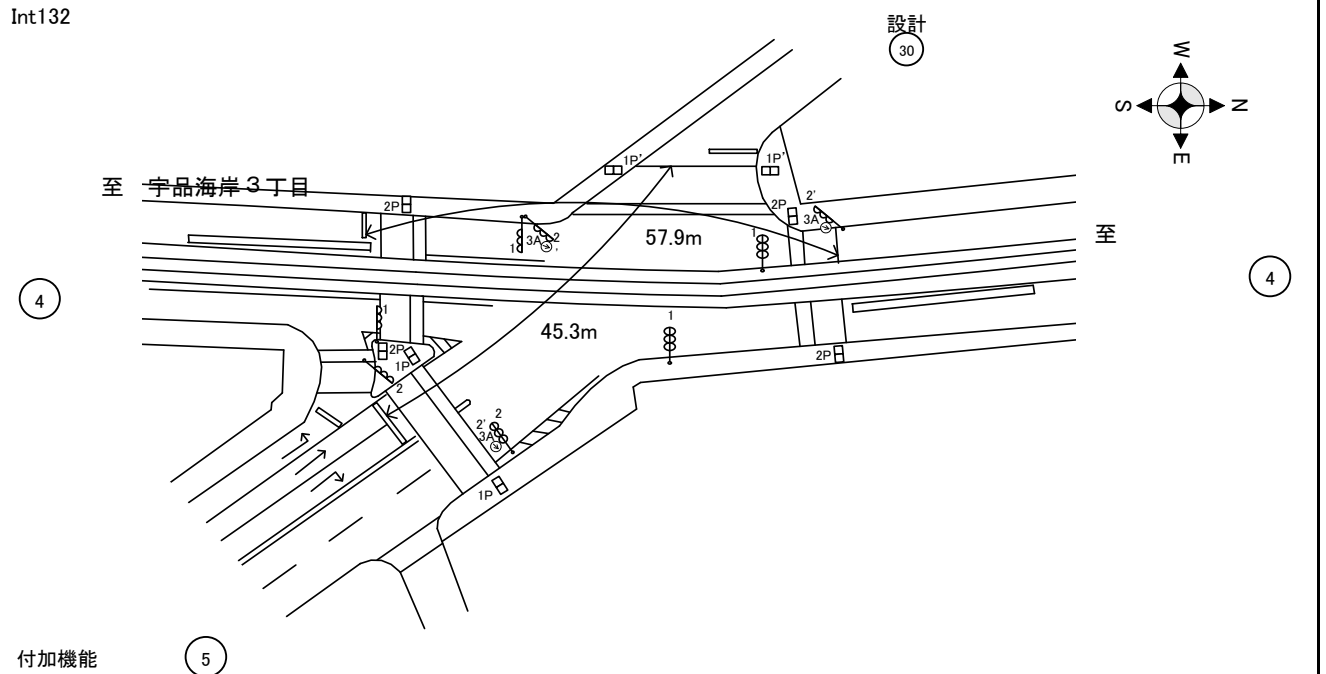

付加機能
連動出力
ステータス機能
S3:閃光

※4現示開始Step11→12に変更

ステップ番号	1*	2	3	4	5	6*	7	8	9	10	11*	12	13	14*	15	16	17	18	19	20
ステップ名称	1PG	1PG	1PW	1 G	1 Y	1 R	2PG	2PW	2 G	2 Y	2 A	2 A	2 Y	2 R						
流動図																				
1P [1P]																				
1P' [3P]																				
1 [1V]																				
2P [2P]																				
2 [2V]																				
2' [3V]																				
2'右矢 [3A]																				
PU	109	109					109					109								
PL (91秒)	10	6	6	10	3	5	17	6	10	3	5	5	2	3						
初期PL (92秒)	10	8	6	10	3	4	17	6	10	3	5	5	2	3						
定周期 (#####)	20	15	12	10	3	4	33	10	10	3	5	15	2	3						
保安秒時(#####)	20	21	6	10	3	4	37	6	10	3	5	15	2	3						
最長時間(秒)	110	110	110	110	10	10	110	110	110	10	110	110	10	10						
最短時間(秒)	6	0.95	0.95	0.95	0.95	0.95	6	0.95	0.95	0.95	0.95	0.95	0.95	0.95						
AB運動出力	A	A	B	B	B	B	B	A	A	A	A	A	A	A						