



規制番号・名称	5-0009 高須インター(北)	運 用	平成17年2月28日	製造番号	4J1398
管制番号・名称	50009 高須インター(北) (U形)	開始日時	15時58分 ~	製造年月	2005年1月
				メーカー	松下電器産業(株)

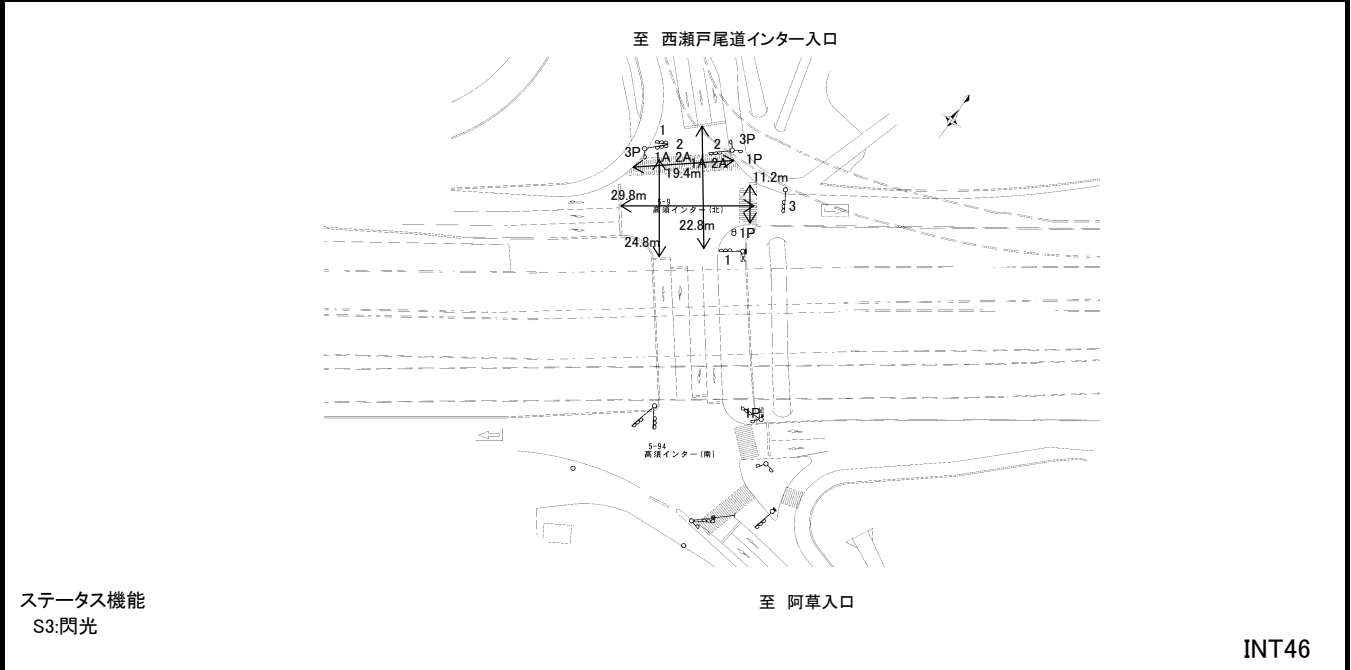

ステップ番号	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
ステップ名称	1PG	1PW	1G	1Y	1R	2PG	2PW	2G	2Y	2R	3G	3Y	3R							
流動図																				
1P [1P]																				
1 [1V]																				
2 [2V]																				
1A [1A]																				
2A [2A]																				
3P [3P]																				
3 [3V]																				
PU	109					109					109									
PL(60秒)	12	5	2	3	2	20	7	2	3	3	5	2	3							
保安秒数(+60秒)	54	5	2	3	2	54	7	2	3	3	10	2	3							
最長時間(秒)	110	10	110	10	10	110	10	110	10	10	110	10	10							
最短時間(秒)	6	0.95	0.95	0.95	0.95	6	0.95	0.95	0.95	0.95	0.95	0.95	0.95							
AB連動出力	A	B	B	B	B	B	A	A	A	A	A	A	A							

規制番号・名称	5-0009 高須インター(北)	運用	平成17年2月14日	製造番号	4J1398
管制番号・名称	50009 高須インター(北) (U形)	開始日時	13時34分 ~	製造年月	2005年1月
				メーカー	松下電器産業(株)

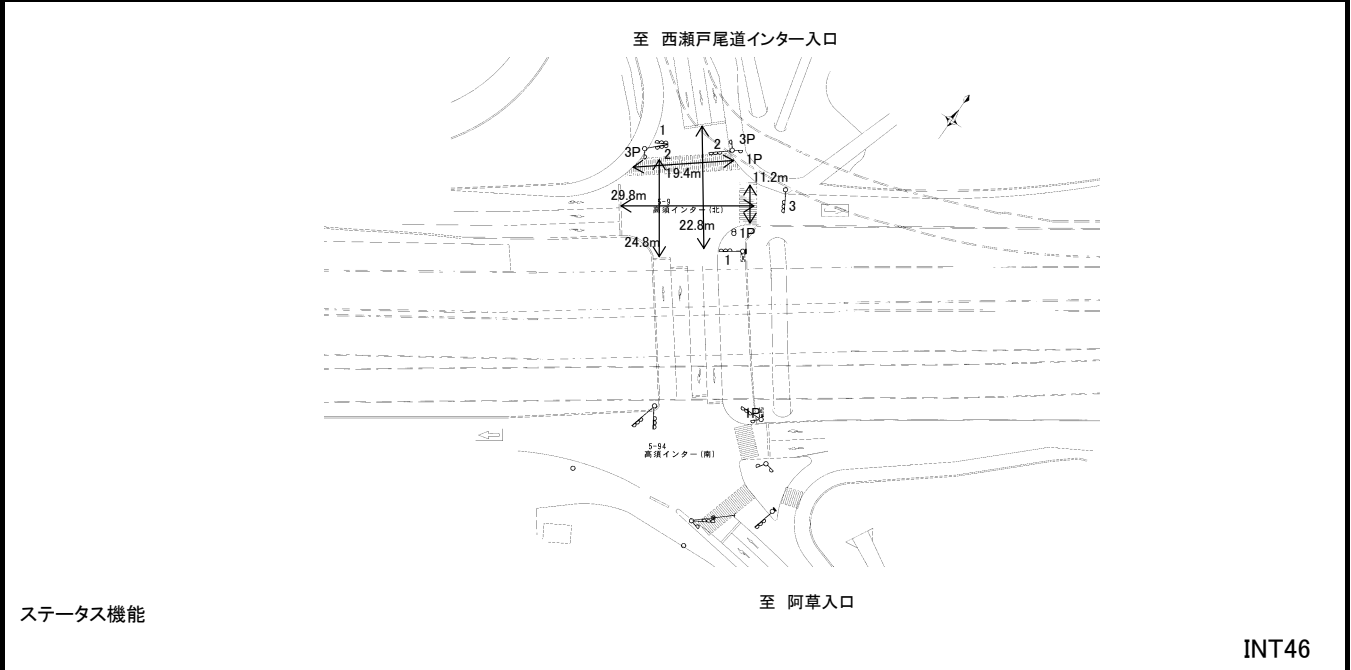

ステップ番号	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
ステップ名称	1PG	1PW	1G	1Y	1R	2PG	2PW	2G	2Y	2R	3G	3Y	3R							
流動図																				
1P [1P]																				
1 [1V]																				
2 [2V]																				
3P [1P]																				
3 [2V]																				
PU	109					109					109									
PL(71秒)	12	5	2	3	2	20	7	2	3	2	7	3	3							
保安秒数(+30秒)	45	5	2	3	2	46	7	2	3	2	7	3	3							
最長時間(秒)	110	110	110	10	10	110	110	110	10	10	110	10	10							
最短時間(秒)	6	0.95	0.95	0.95	0.95	6	0.95	0.95	0.95	0.95	6	0.95	0.95							
AB連動出力	A	B	B	B	B	B	A	A	A	A	A	A	A							