


規制番号 名称	07-0086 入江大橋北詰	(UD-TTR)	運 用	2023年2月8日	製造番号	220723
管制番号 名称	70086 入江大橋北詰	1012号「版5」		開始日時	0時16分 ~	製造年月
					メーカー	住友電工

ステップ番号	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
ステップ名称	1PG	1PW	1G	1Y	1 A	1Y	1R	2PG	2PW	2G	2Y	2R	2A	2Y	2R					
流動図																				
	1 P [1P]																			
	1 [1V]																			
	1' [3V]																			
	1 右矢 [1A]																			
	1 左矢 [3A]																			
	2 P [2P]																			
2 [2V]																				
2 右矢 [2A]																				
ギャップ 感応	補正禁止	○					○							○						
	感応／補正							補正						感応	単位青：4秒，短縮：14秒，延長：5秒					
P U	109				109			109					109							
P L (77秒)	16	8	5	3	5	2	3	10	6	2	3	3	5	2	4					
保安秒時 (160秒)	28	8	5	3	11	2	3	61	6	2	3	3	19	2	4					
最長時間 (秒)	110	110	110	10	110	10	10	110	110	110	10	10	110	10	10					
最短時間 (秒)	6	0.95	0.95	0.95	0.95	0.95	0.95	6	0.95	0.95	0.95	0.95	0.95	0.95	0.95					
A B連動出力																				

規制番号 名称	7-0086 入江大橋北詰	運用	H16.3.15	製造番号	1A0525
管制番号 名称	070086 入江大橋北詰 (I型)	開始日時	18:00~	製造年月	平成13年 6月

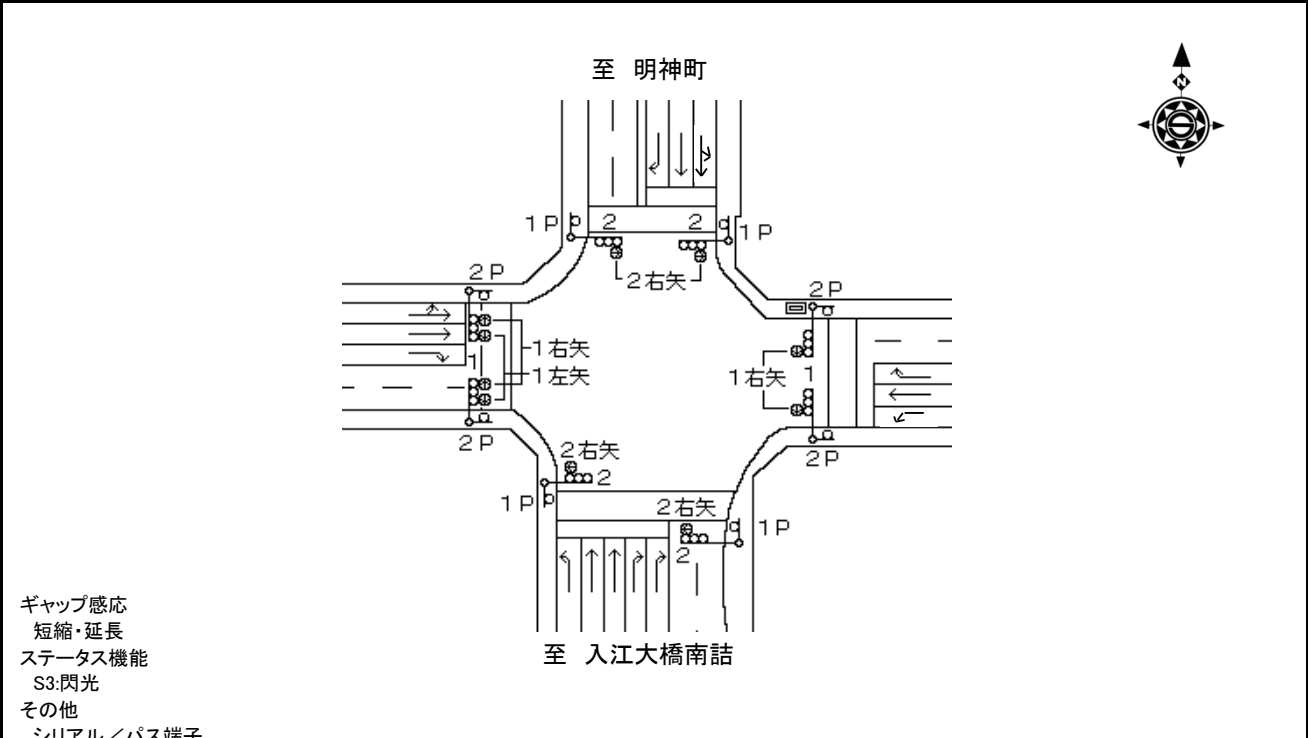

ステップ番号	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20		
ステップ名称	1PG	1PW	1G	1Y	2 A	2 Y	2 R	3PG	3PW	3 G	3 Y	3 R	4 A	4 Y	4 R							
流動図																						
	1P [1P]																					
	1 [1V]																					
	1' [3V]																					
	1右矢 [1A]																					
1左矢 [2A]																						
2P [2P]																						
2 [2V]																						
2右矢 [3A]																						
最終指定				○			○					○			○	スプリット数: 4						
可変指定	○				○			○					○									
保安秒時(140秒)	27	9	6	3	8	2	4	51	5	5	3	3	8	2	4							
最長時間(秒)	110	110	110	10	110	10	10	110	110	110	10	10	110	10	10							
最短時間(秒)	6	0.95	0.95	0.95	0.95	0.95	0.95	6	0.95	0.95	0.95	0.95	0.95	0.95	0.95							
AB運動出力	A	B	B	B	B	B	B	B	A	A	A	A	A	A	A							