


PIPING & INSTRUMENTATION DIAGRAM — HEAT-EXCHANGER TRAIN

ISA-5.1 notation · Drawing: P-002 Rev B · Synthetic fixture

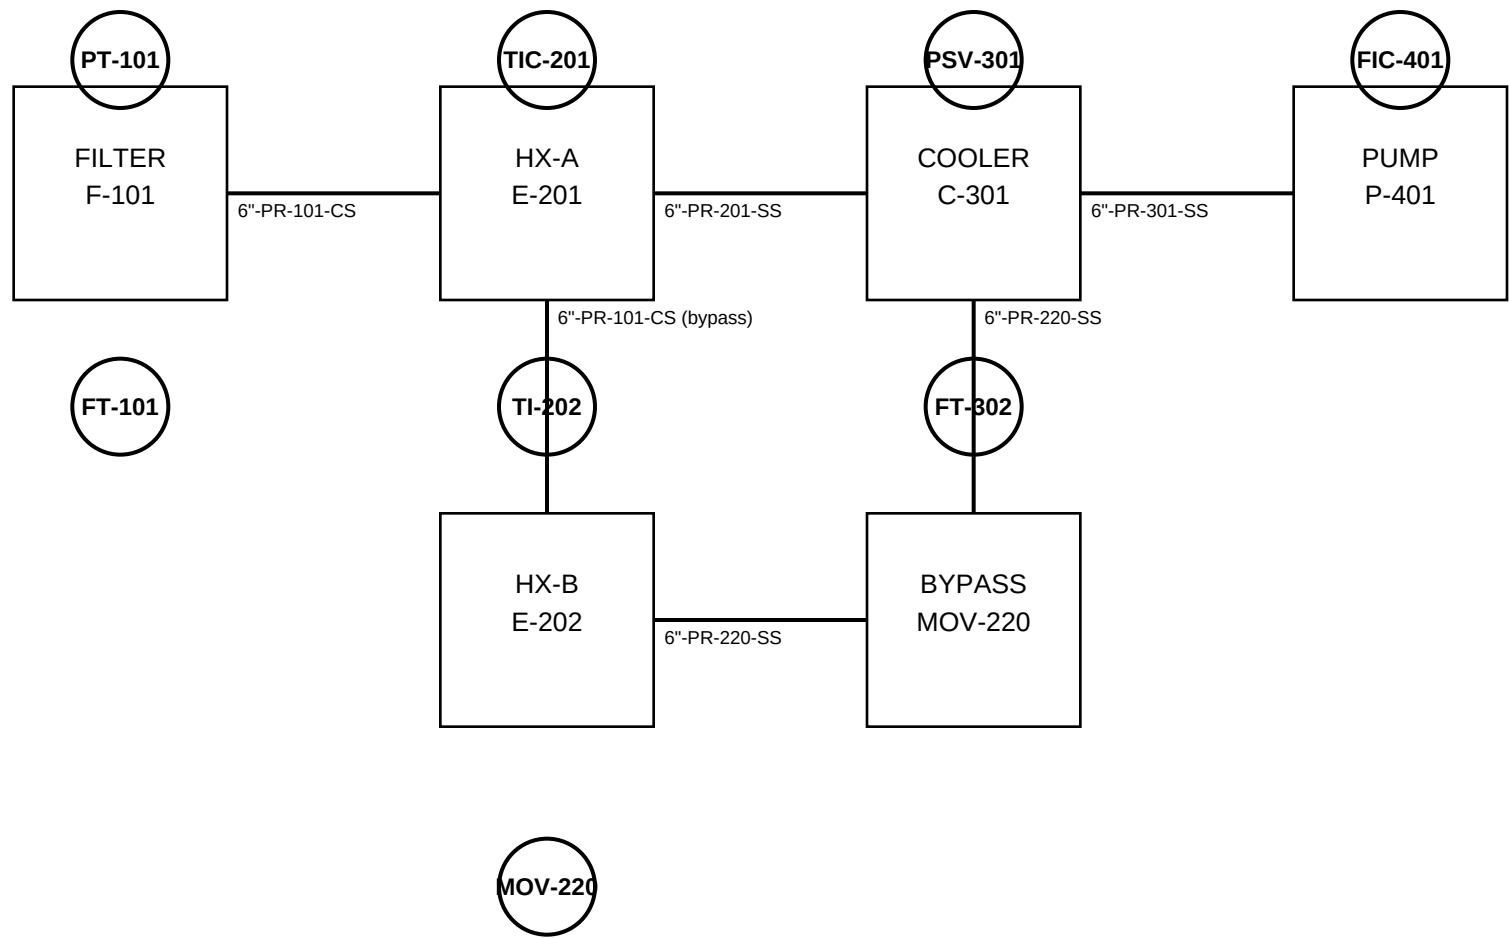

SAFETY INTERLOCKS:

- I-1: PSV-301 (high pressure) → trip P-401 + open MOV-220
- I-2: FT-302 (low flow) → close FIC-401 + alarm
- I-3: TIC-201 (high temp) → modulate COOLER C-301 flow

LEGEND: PT = Pressure Tx · FT = Flow Tx · TIC = Temp Indicating Controller
PSV = Pressure Safety Valve · MOV = Motorized Operated Valve · FIC = Flow Indicating Controller
Line tag format: <size>"-<service>-<line#>-<material> · CS = carbon steel · SS = stainless