




1 nLight - CAISSE TYPE 0
Design 2

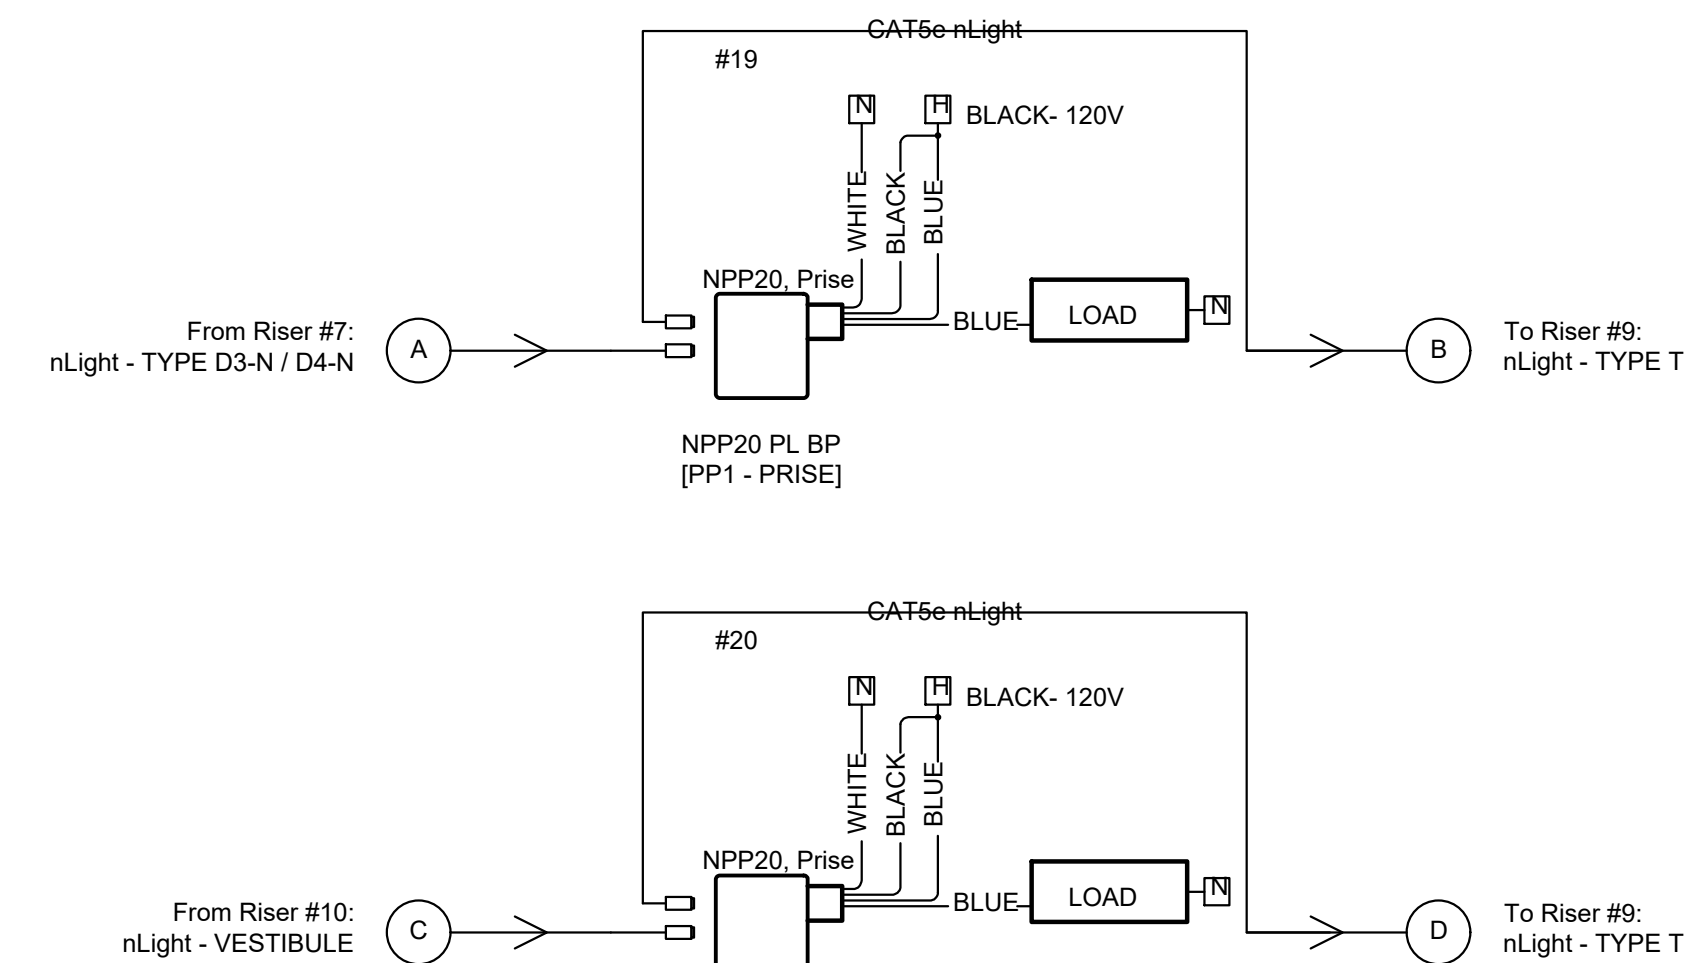


2 nLight - CAISSE TYPE D3-N / D4-N
Design 2

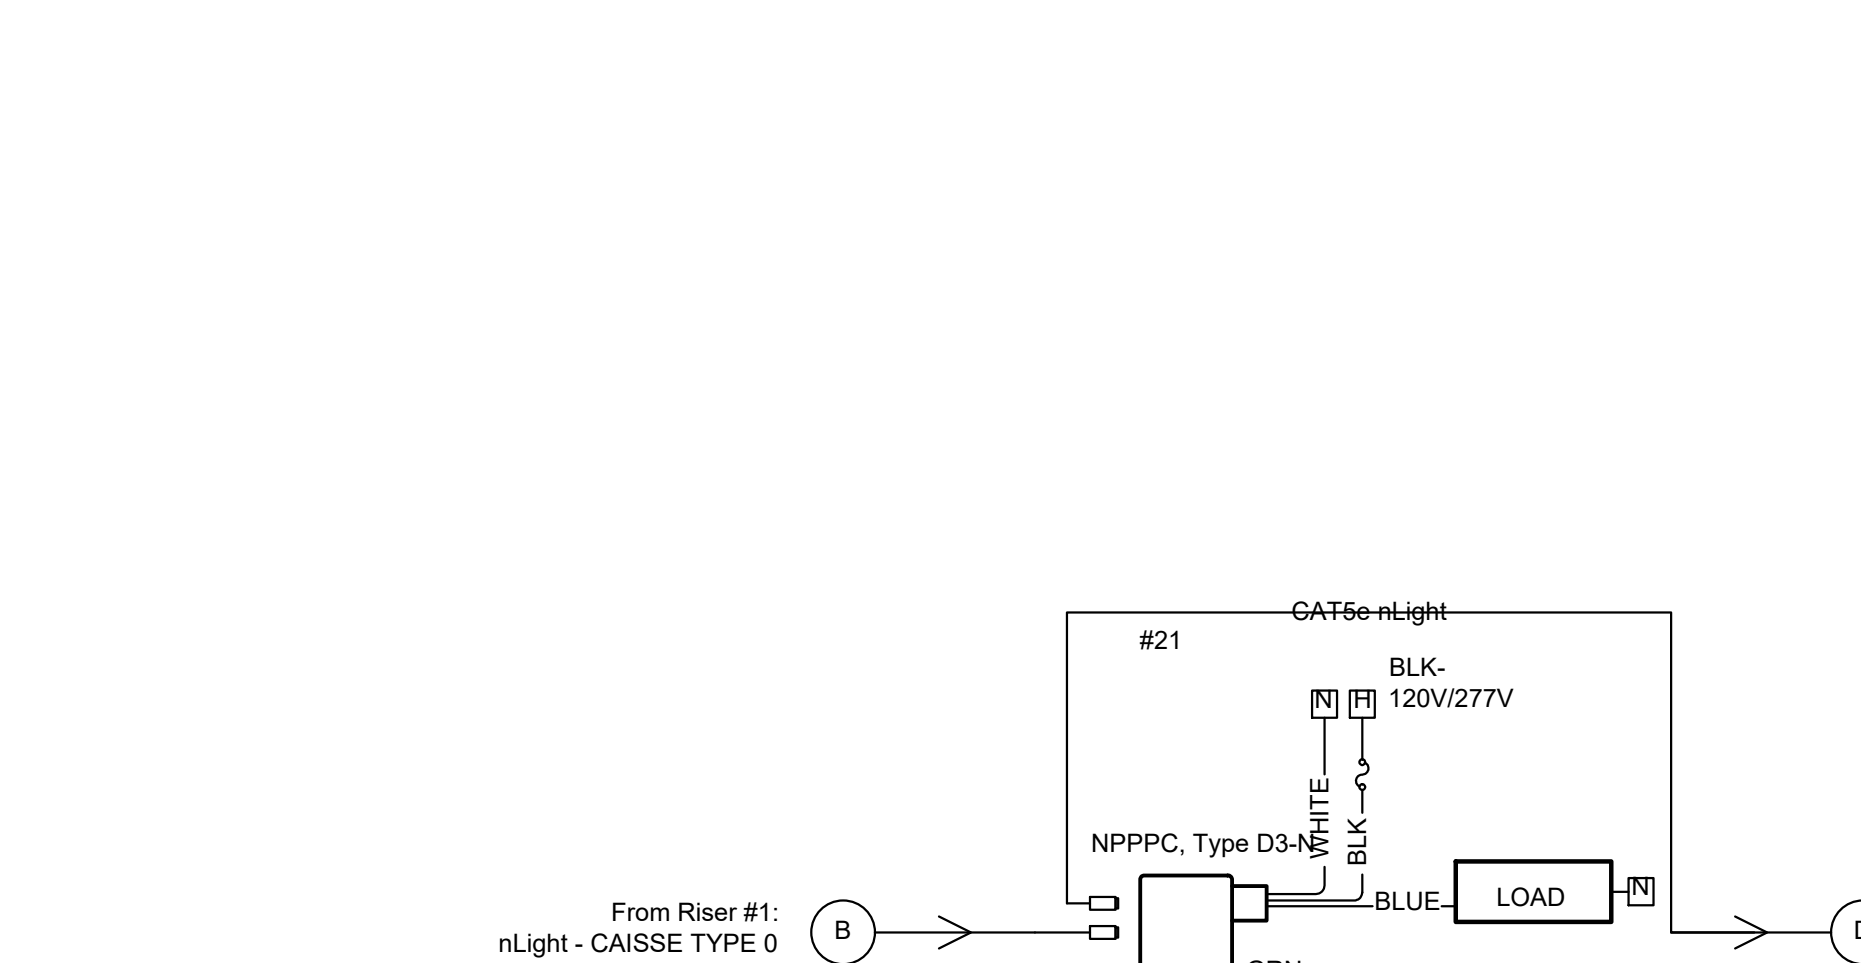


3 nLight - ENTREPOT
Design 2

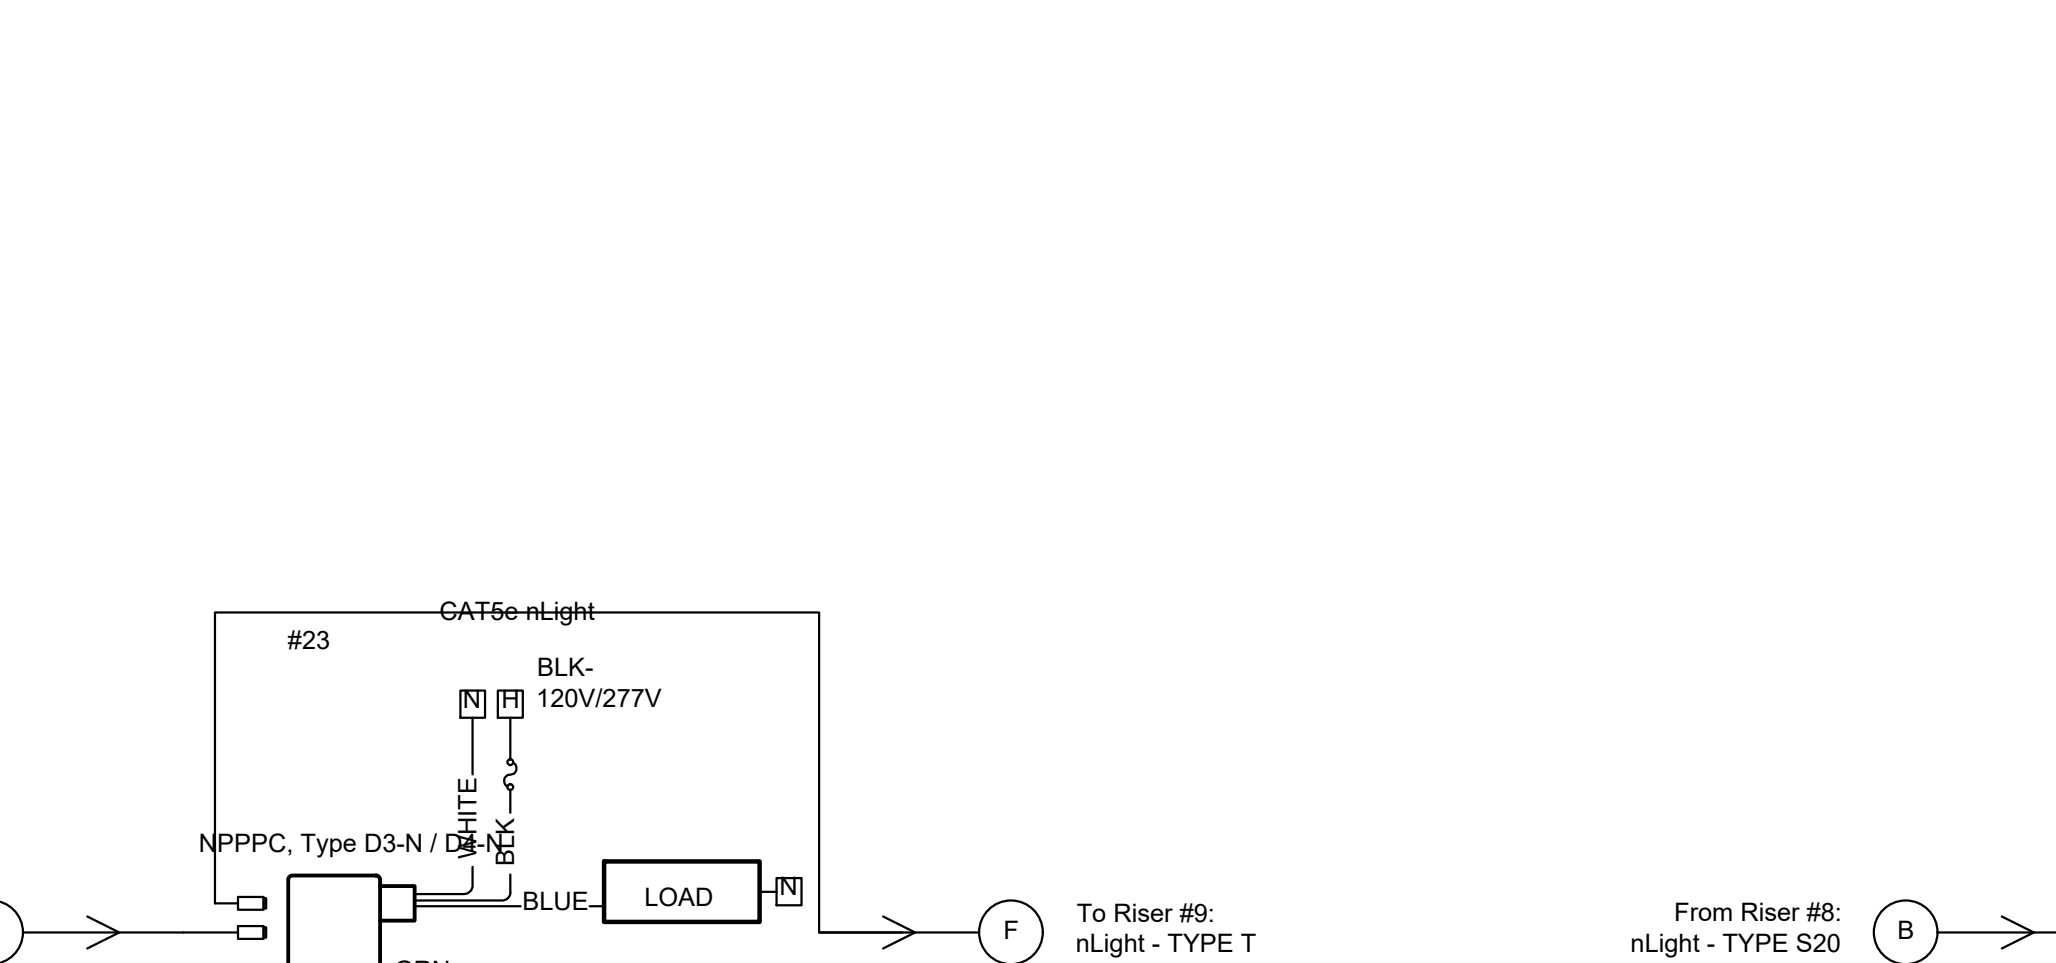


4 nLight - PRISE
Design 2

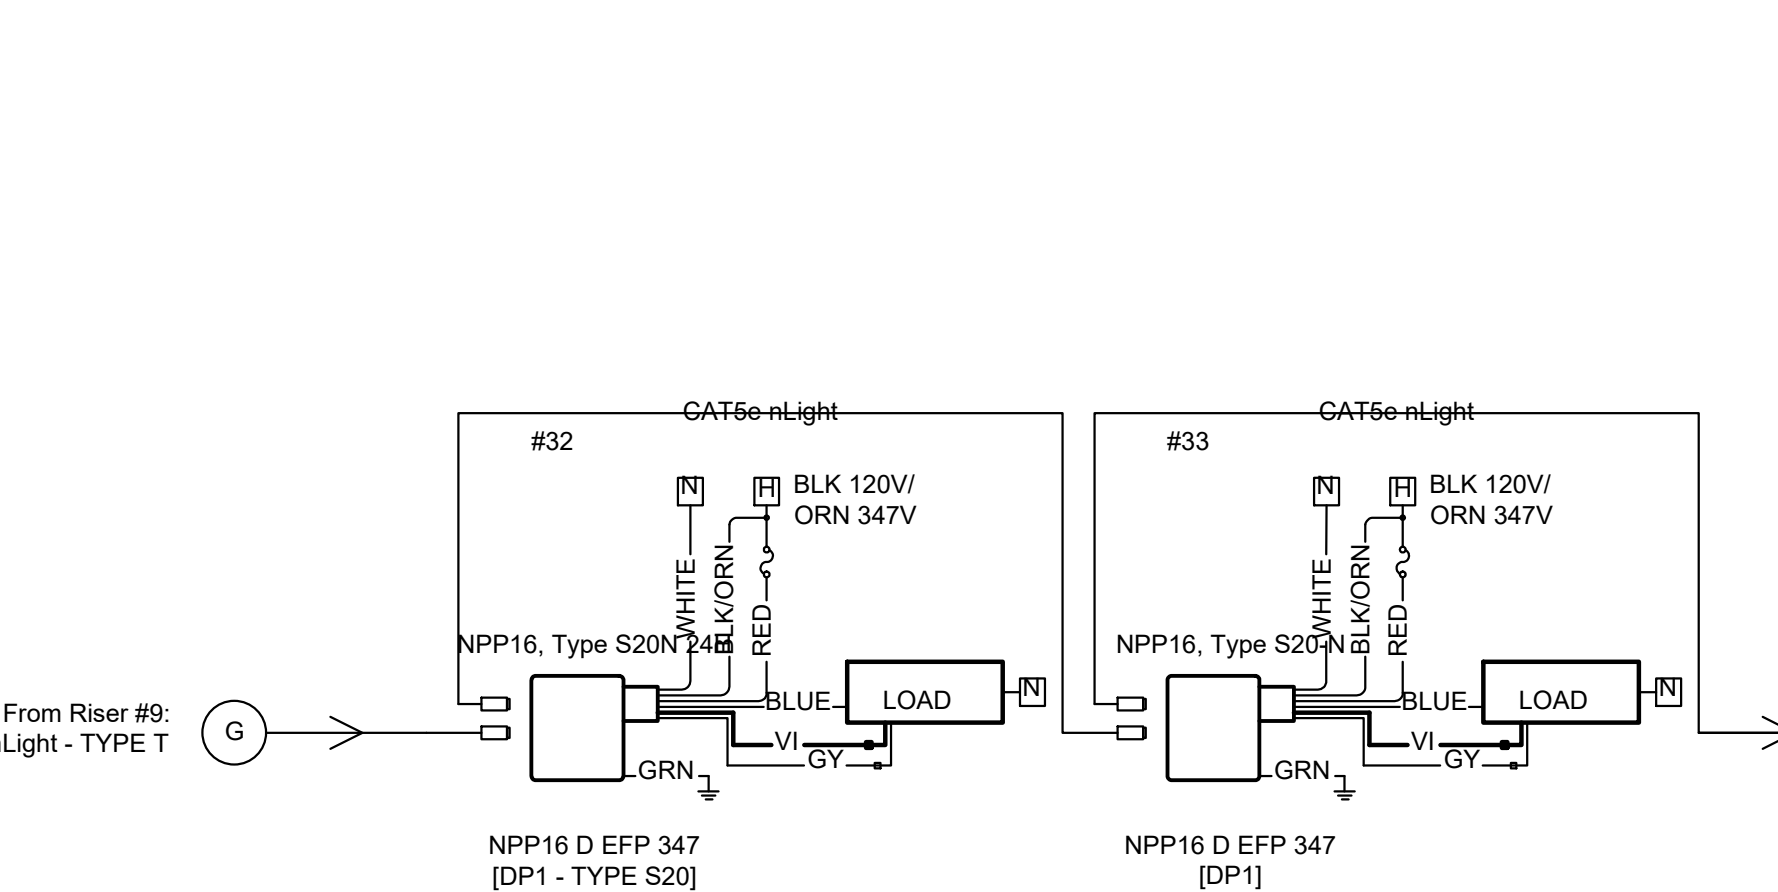


5 nLight - RAIL
Design 2

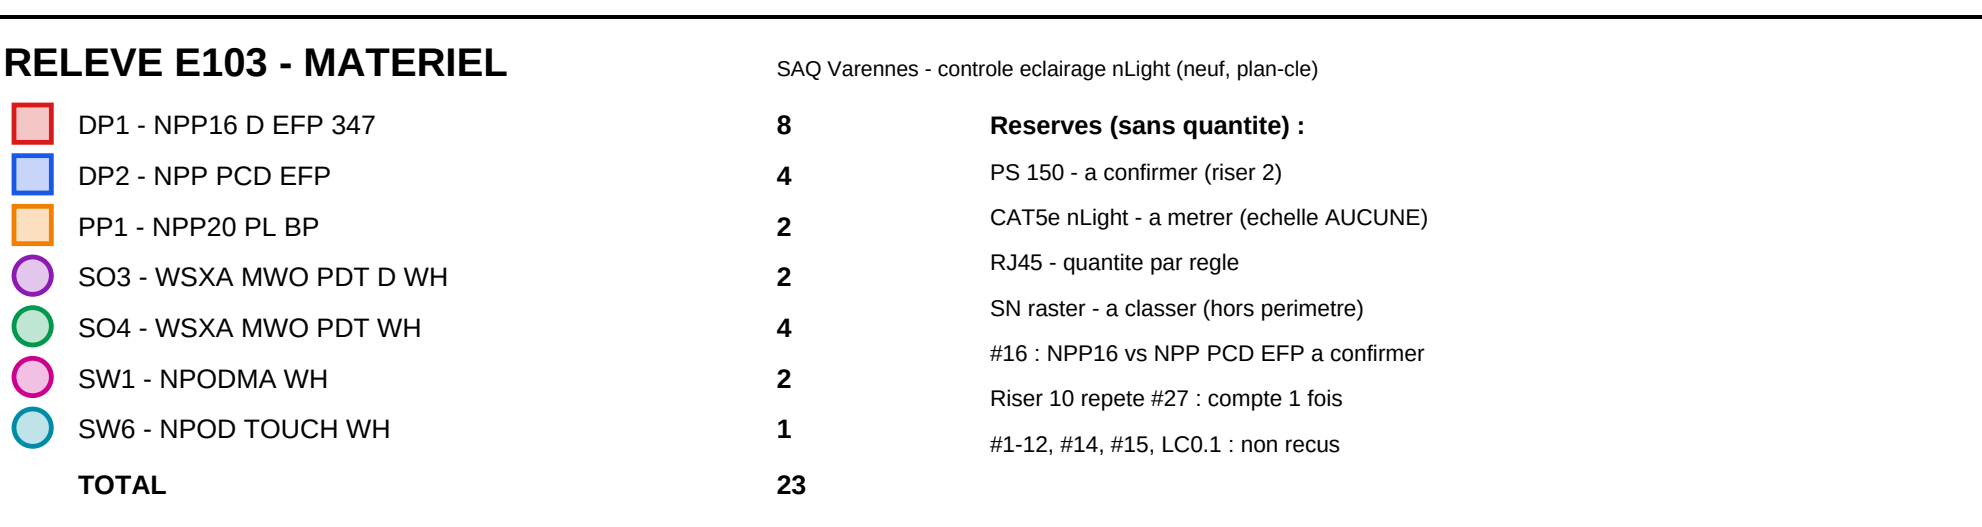


6 nLight - RAIL D3-N / D4-N
Design 2

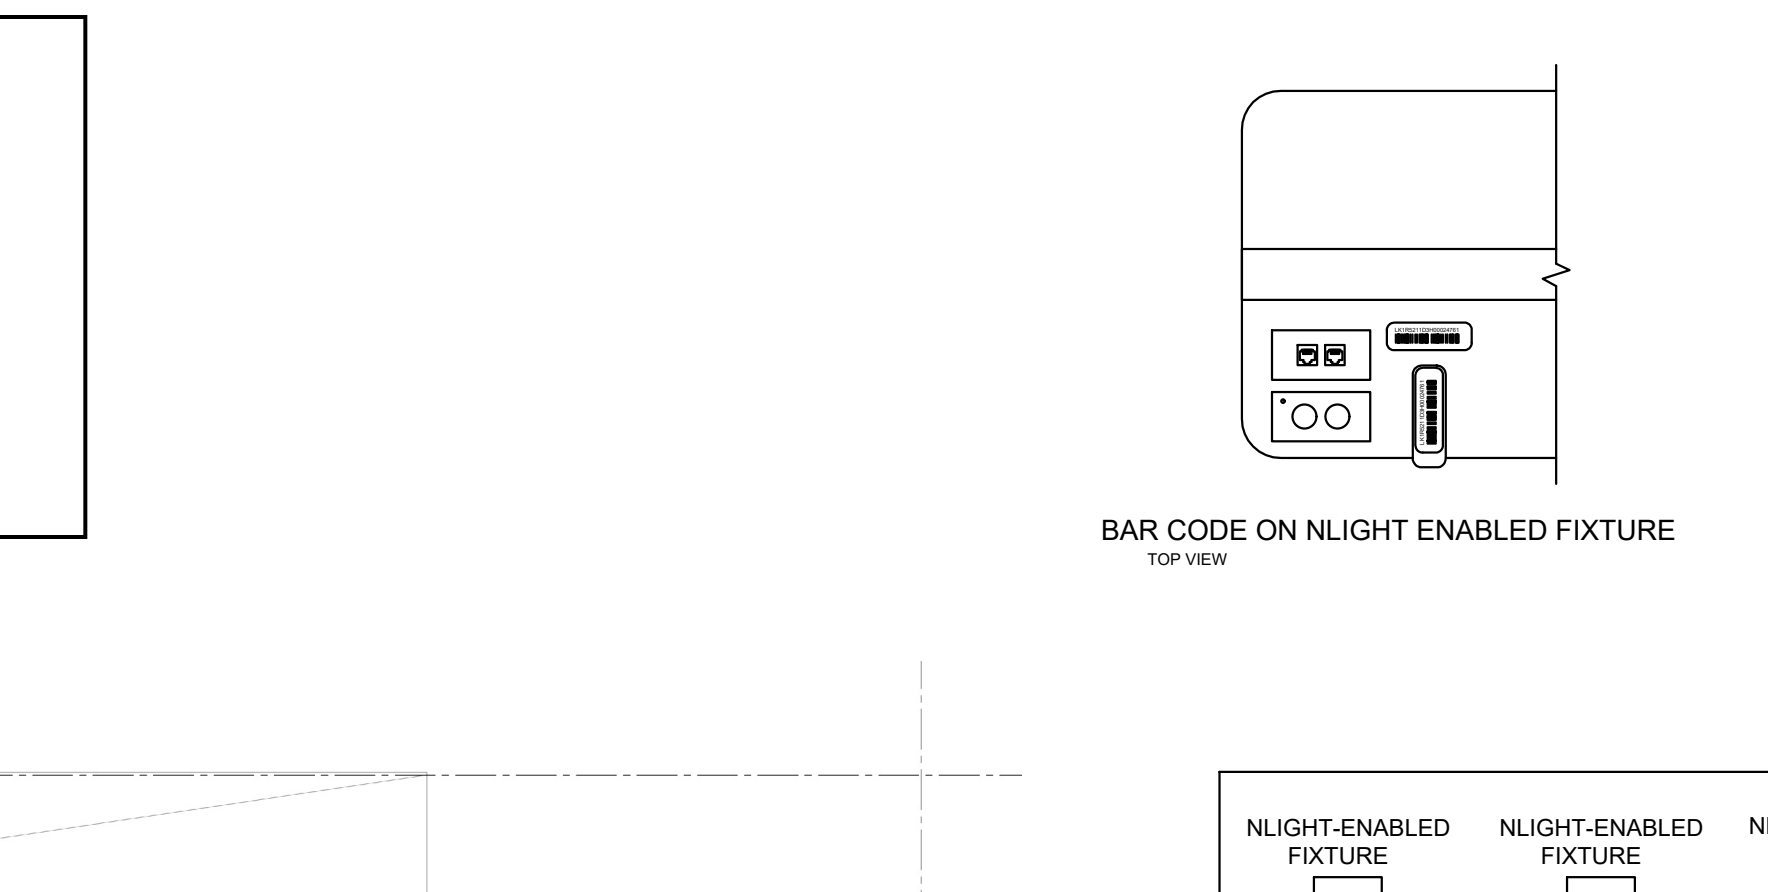


7 nLight - TYPE D3-N / D4-N
Design 2

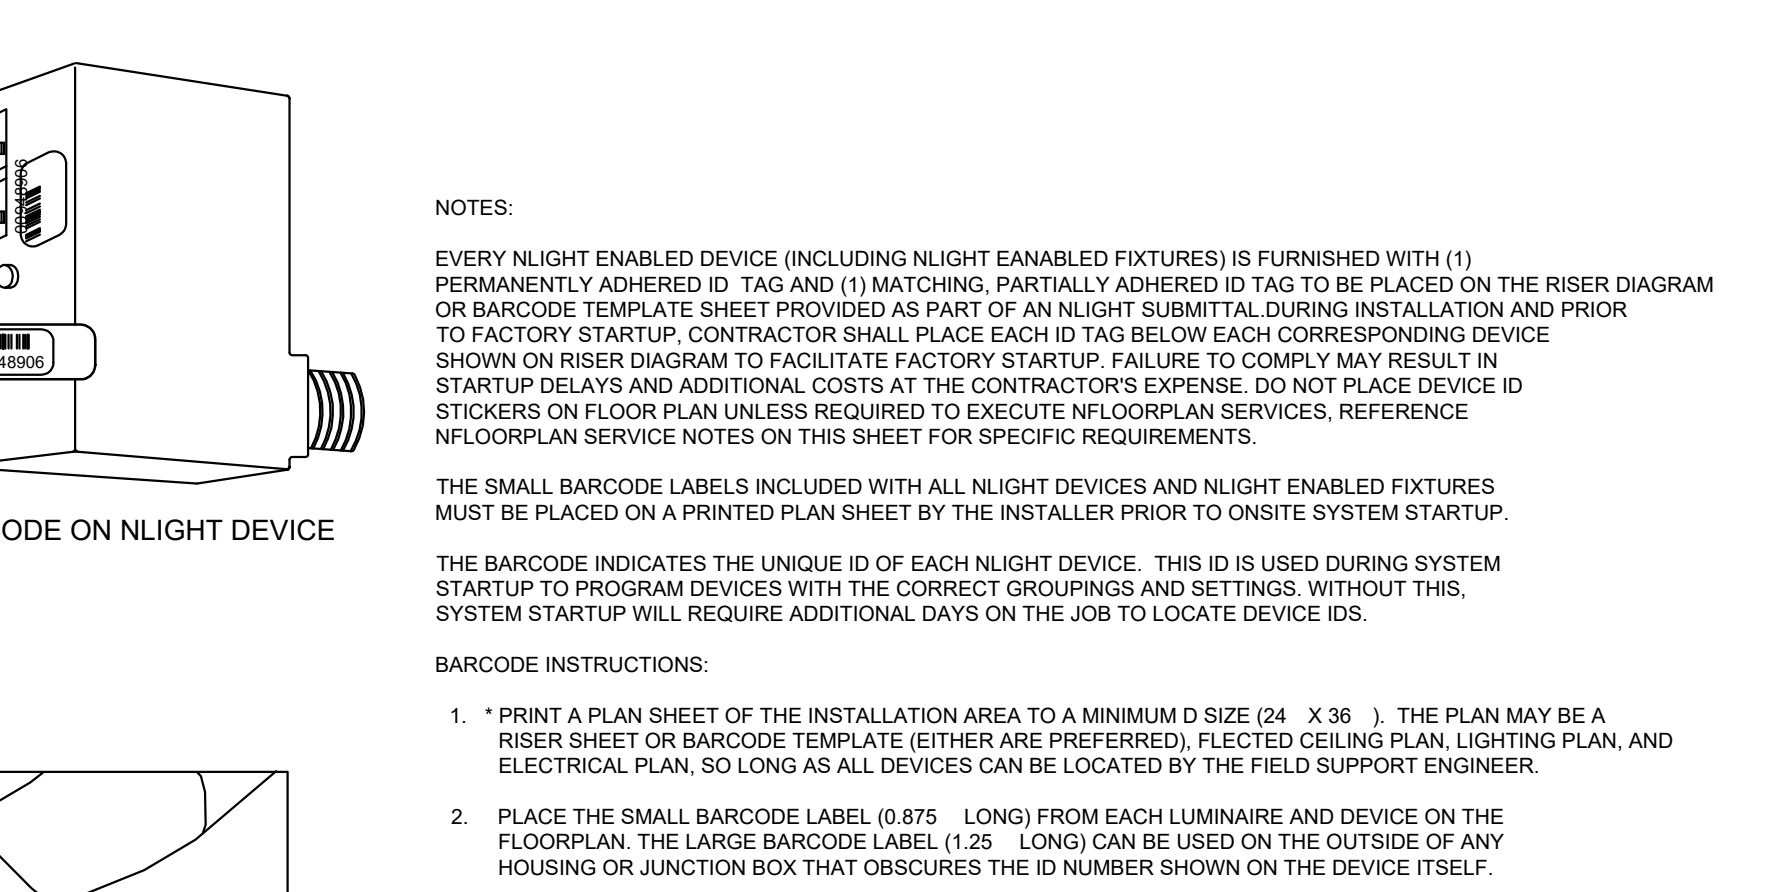



8 nLight - TYPE S20
Design 2

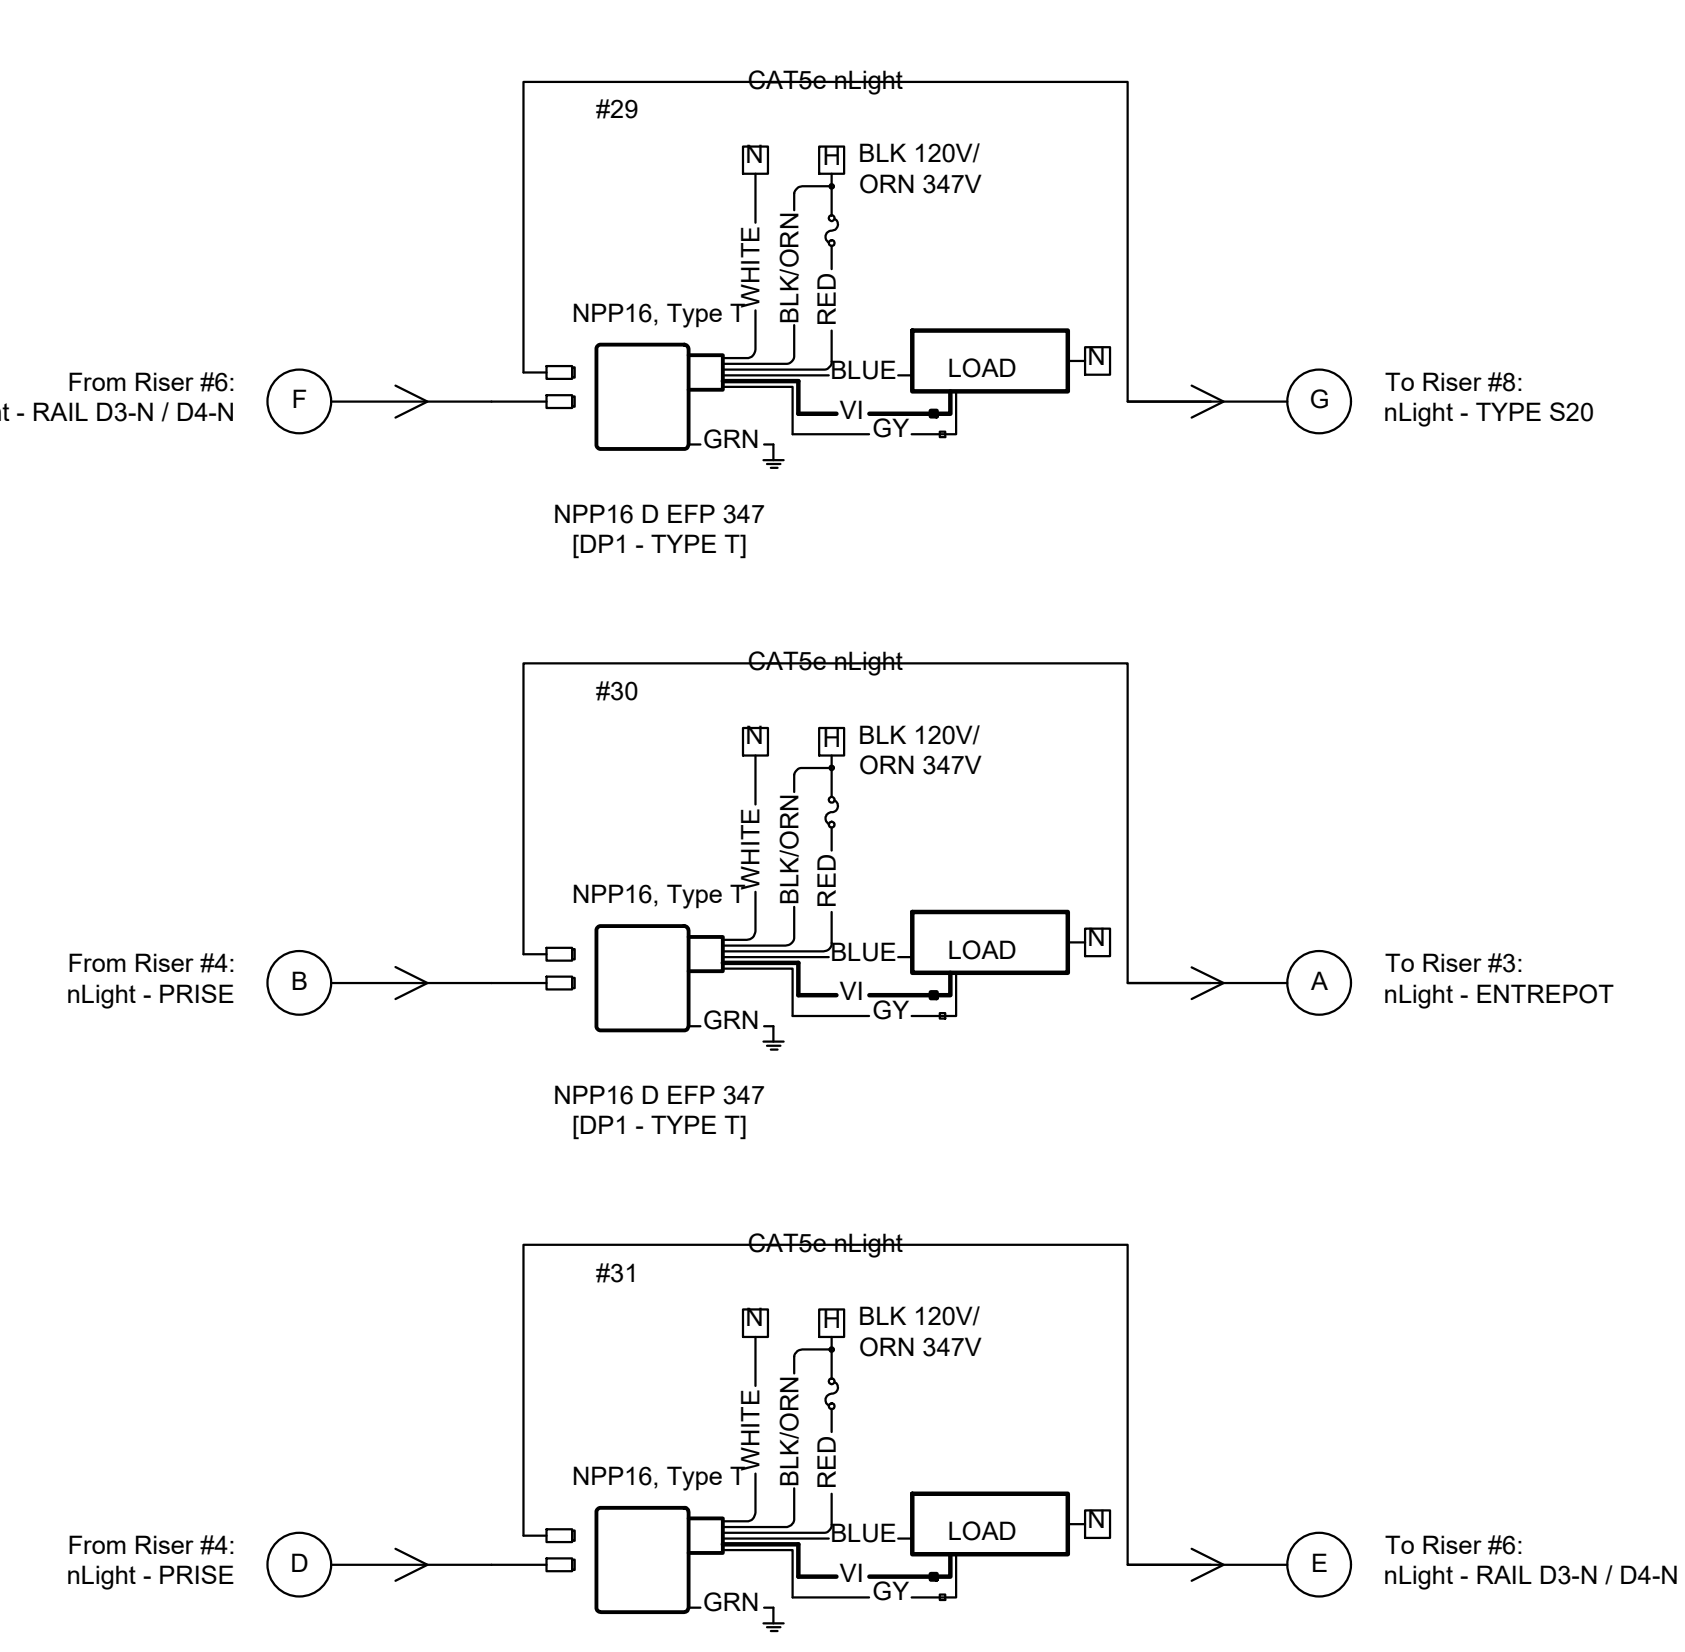

9 nLight - TYPE T
Design 2

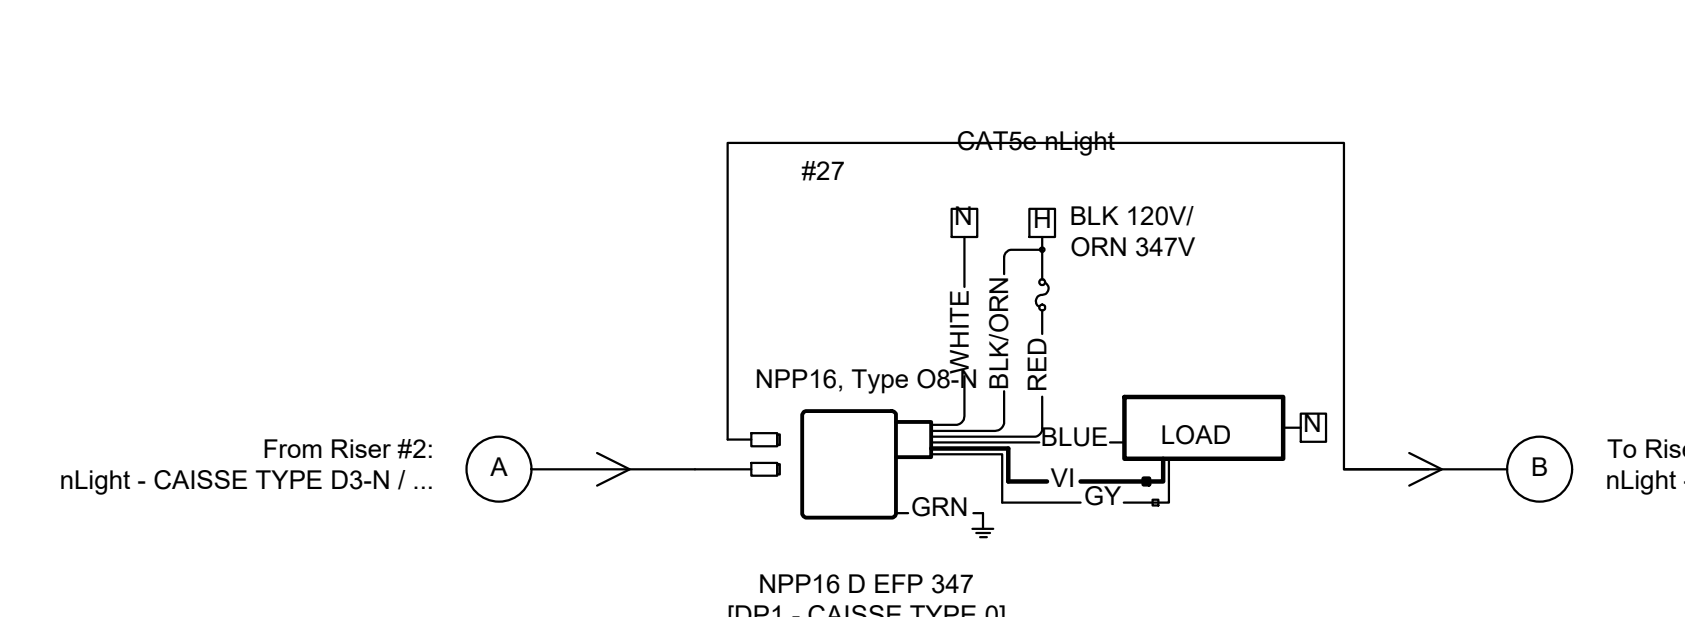

10 nLight - VESTIBULE
Design 2

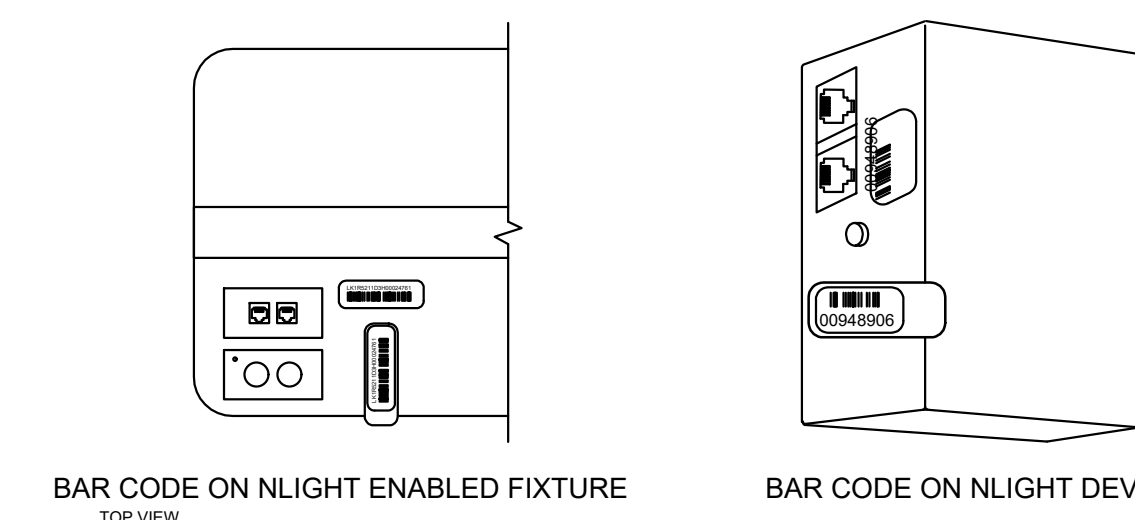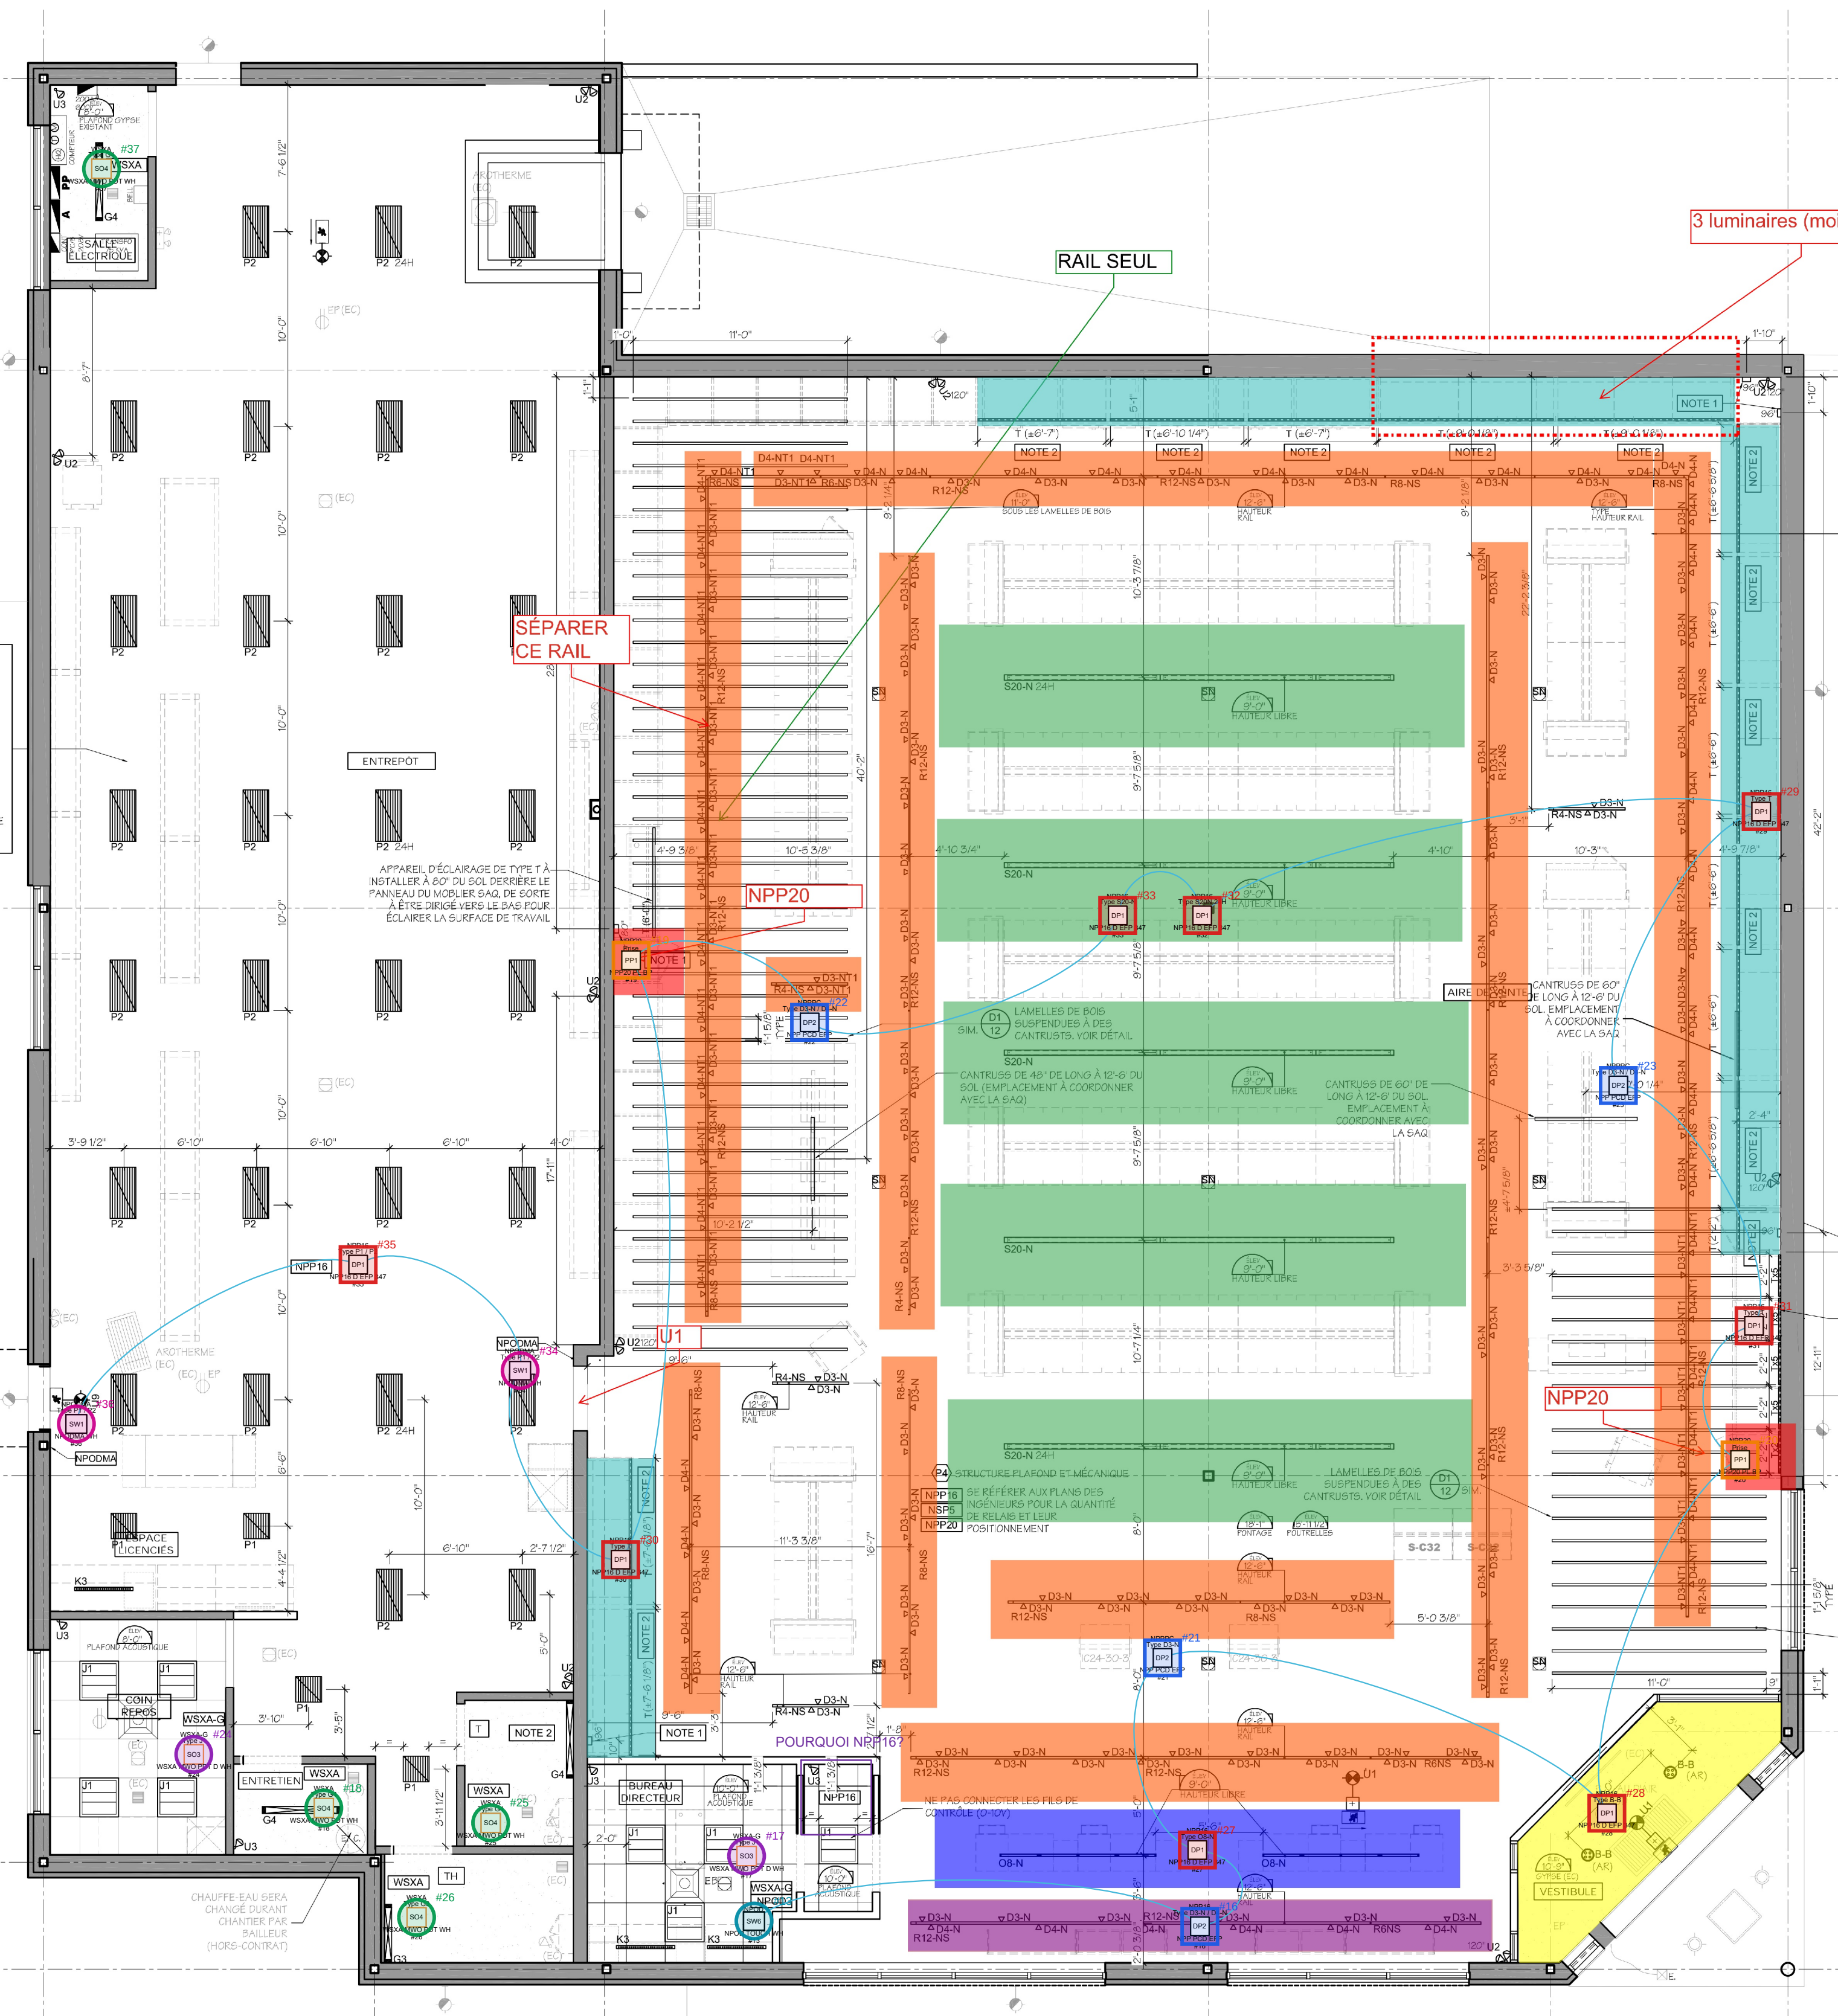

BAR CODE ON NLIGHT ENABLED FIXTURE

BAR CODE ON NLIGHT DEVICE

NOTES

EVERY NLIGHT ENABLED DEVICE (INCLUDING NLIGHT ENABLED FIXTURES) IS FURNISHED WITH (1) PERMANENTLY ADHERED ID TAG AND (1) MATCHING PARTIALLY ADHERED ID TAG TO BE PLACED ON THE RISER DIAGRAM OR BARCODE TEMPLATE SHEET PROVIDED AS PART OF AN NLIGHT SUBMITTAL DURING INSTALLATION AND PRIOR TO FACTORY STARTUP. CONTRACTOR SHALL PLACE EACH ID TAG BELOW EACH CORRESPONDING DEVICE SHOWN ON RISER DIAGRAM TO FACILITATE FACTORY STARTUP. FAILURE TO COMPLY MAY RESULT IN STARTUP DELAYS AND ADDITIONAL COSTS AT THE CONTRACTOR'S EXPENSE. DO NOT PLACE DEVICE ID TAGS ON FLOOR PLAN UNLESS REQUIRED TO EXECUTE NLIGHT PLAN SERVICES. REFERENCE NLIGHT PLAN SERVICE NOTES ON THIS SHEET FOR SPECIFIC REQUIREMENTS.

THE SMALL BARCODE LABELS INCLUDED WITH ALL NLIGHT DEVICES AND NLIGHT ENABLED FIXTURES MUST BE PLACED ON A PRINTED PLAN SHEET BY THE INSTALLER PRIOR TO ONSITE SYSTEM STARTUP. THE BARCODE INDICATES THE UNIQUE ID OF EACH NLIGHT DEVICE. THIS ID IS USED DURING SYSTEM STARTUP TO PROGRAM DEVICES WITH THE CORRECT GROUPINGS AND SETTINGS. WITHOUT THIS, SYSTEM STARTUP WILL REQUIRE ADDITIONAL DAYS ON THE JOB TO LOCATE DEVICE IDS.

BARCODE INSTRUCTIONS:

- * PRINT A PLAN SHEET OF THE INSTALLATION AREA TO A MINIMUM D SIZE (24" X 36"). THE PLAN MAY BE A RISER SHEET OR BARCODE TEMPLATE (EITHER ARE PREFERRED). FLECTED CEILING PLAN, LIGHTING PLAN, AND ELECTRICAL PLAN. SO LONG AS ALL DEVICES CAN BE LOCATED BY THE FIELD SUPPORT ENGINEER.
- PLACE THE SMALL BARCODE LABEL (0.875" LONG) FROM EACH LUMINAIRE AND DEVICE ON THE FLOORPLAN. THE LARGE BARCODE LABEL (1.25" LONG) CAN BE USED ON THE OUTSIDE OF ANY HOUSING OR JUNCTION BOX THAT OBSCURES THE ID NUMBER SHOWN ON THE DEVICE ITSELF.
- SAVE THE PLAN AT THE JOB SITE, AND HAND OVER TO ACUTY FIELD SUPPORT ENGINEER OR OTHER PERSONNEL RESPONSIBLE FOR ONSITE SYSTEM STARTUP. IT IS ALSO ACCEPTABLE TO PROVIDE THE BARCODE PLAN AS SCANNED PDF FILES. EMAILED TO CONTROLS.STARTUP@ACUTYBRANDS.COM WITH PROJECT NAME AND PROJECT ADDRESS IN SUBJECT LINE AND A COPY OF THE ONSITE STARTUP REQUEST FORM.
- DRAW ON PLAN ANY LOCATION CHANGES FOR A FIXTURE OR DEVICES, IF DIFFERENT THAN SHOWN ON PLAN.

NLIGHT BARCODE INSTRUCTIONS


N.T.S.

Function	PAIR	PN OUT	Wire Color
(T1)	1	5	WHITE w BLUE
(R1)	4	4	BLUE
Tx + (T2)	2	1	WHITE w ORANGE
Rx - (R3)	3	3	WHITE w GREEN
(T4)	7	7	WHITE w BROWN
(R4)	8	8	BROWN

TERMINATION & TESTING OF CAT5 CABLES MUST BE DONE BY A QUALIFIED NETWORK INSTALLER

- Cable termination requirements:
- Strip off outer jacket - approximately 1-1/2" (37.6 mm)
 - Terminate approximately 1/2" (12.2 mm) from end of conductors on type 110 punch down block or connector per schedule (568b) - maximum untwist of conductors to terminations is 1/2" (12.2 mm) - trim excess leads.

SEE SYSTEM SPECIFIC NOTES ON SHEET LC0.1 FOR MAXIMUM CABLE LENGTHS.

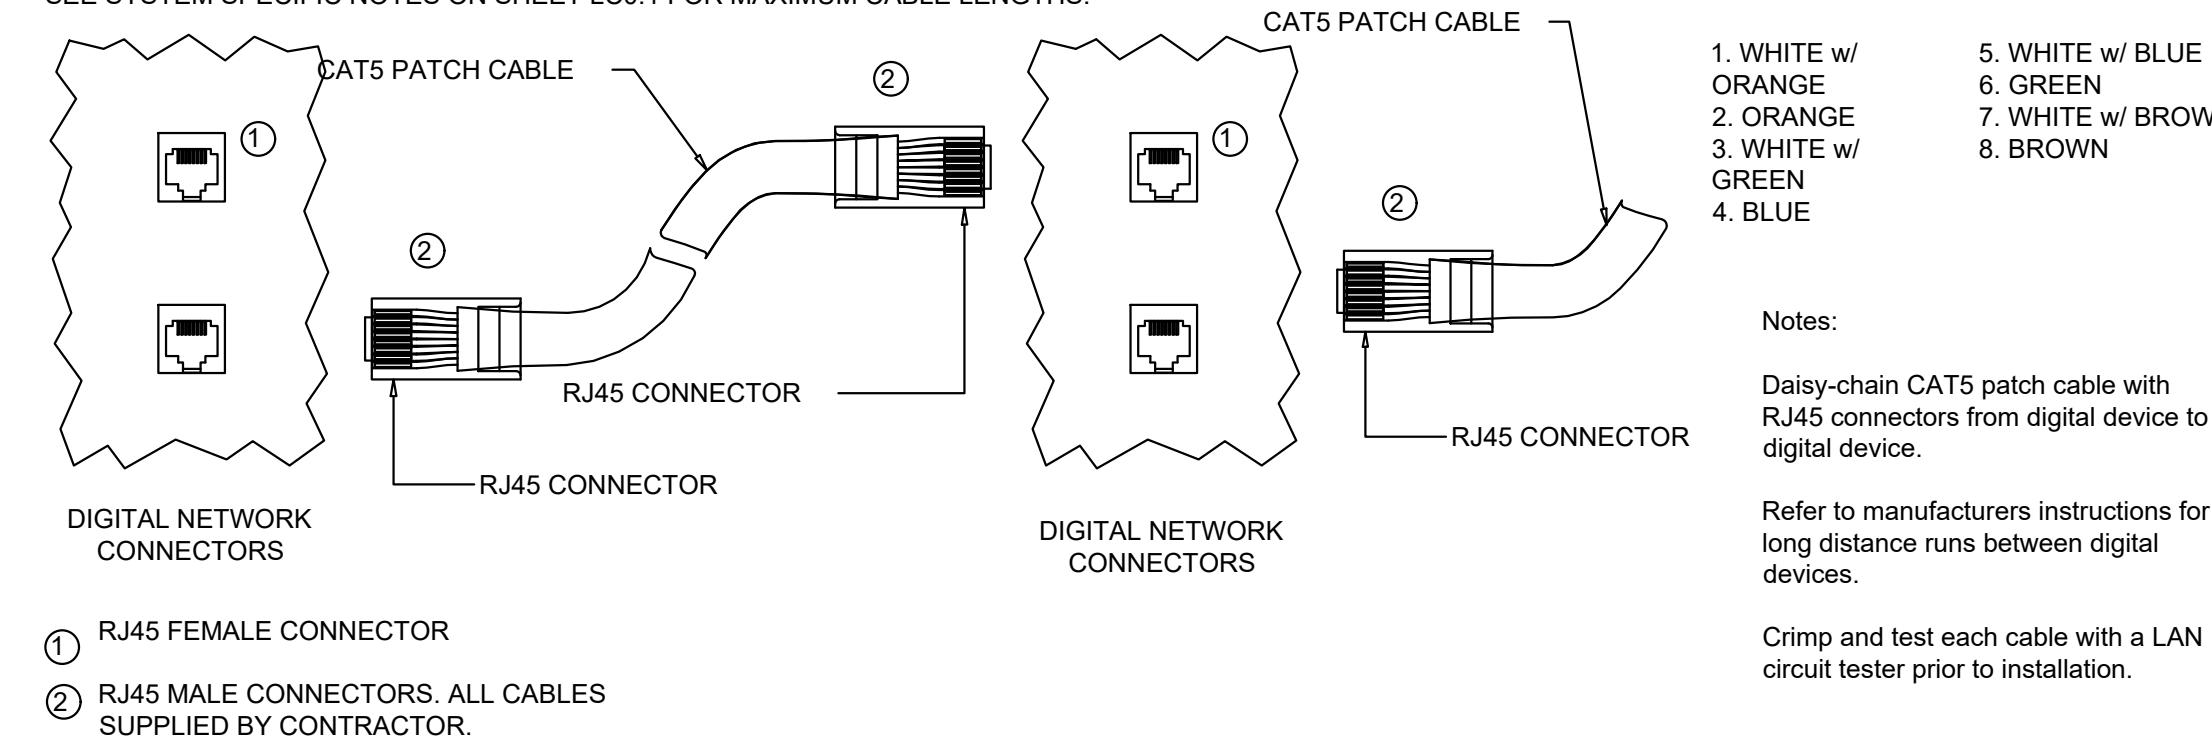


CAT5E/6 CABLE TERMINATION

N.T.S.

NE PAS UTILISER POUR CONSTRUCTION

NO	DATE	REVISION	PAR
0	2026-08-26	POUR SOUMISSIONS	J.B.

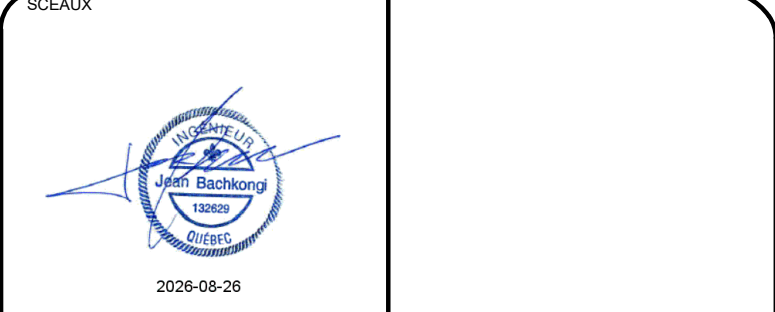

TITRE DU PROJET
SAQ
SAQ VARENNES
VARENNES, QC, J3X 1P7

TITRE DU DESSIN
DÉTAILS
CONTRÔLE D'ÉCLAIRAGE

CONCEPTEUR	ÉLECTRIQUE
CONÇU PAR H. HATTAB, CPI	DATE (AAAA-MM-JJ) 2026-07-13
ÉCRIT PAR F. BELAND, tech.	ÉCHELLE AUCUNE
VÉRIFIÉ PAR J. BACHKONGI, ING.	NO DE PROJET 26-0094-02
APPROUVÉ PAR J. BACHKONGI, Ing.	PLAN NO E103