








City of Flint, Michigan

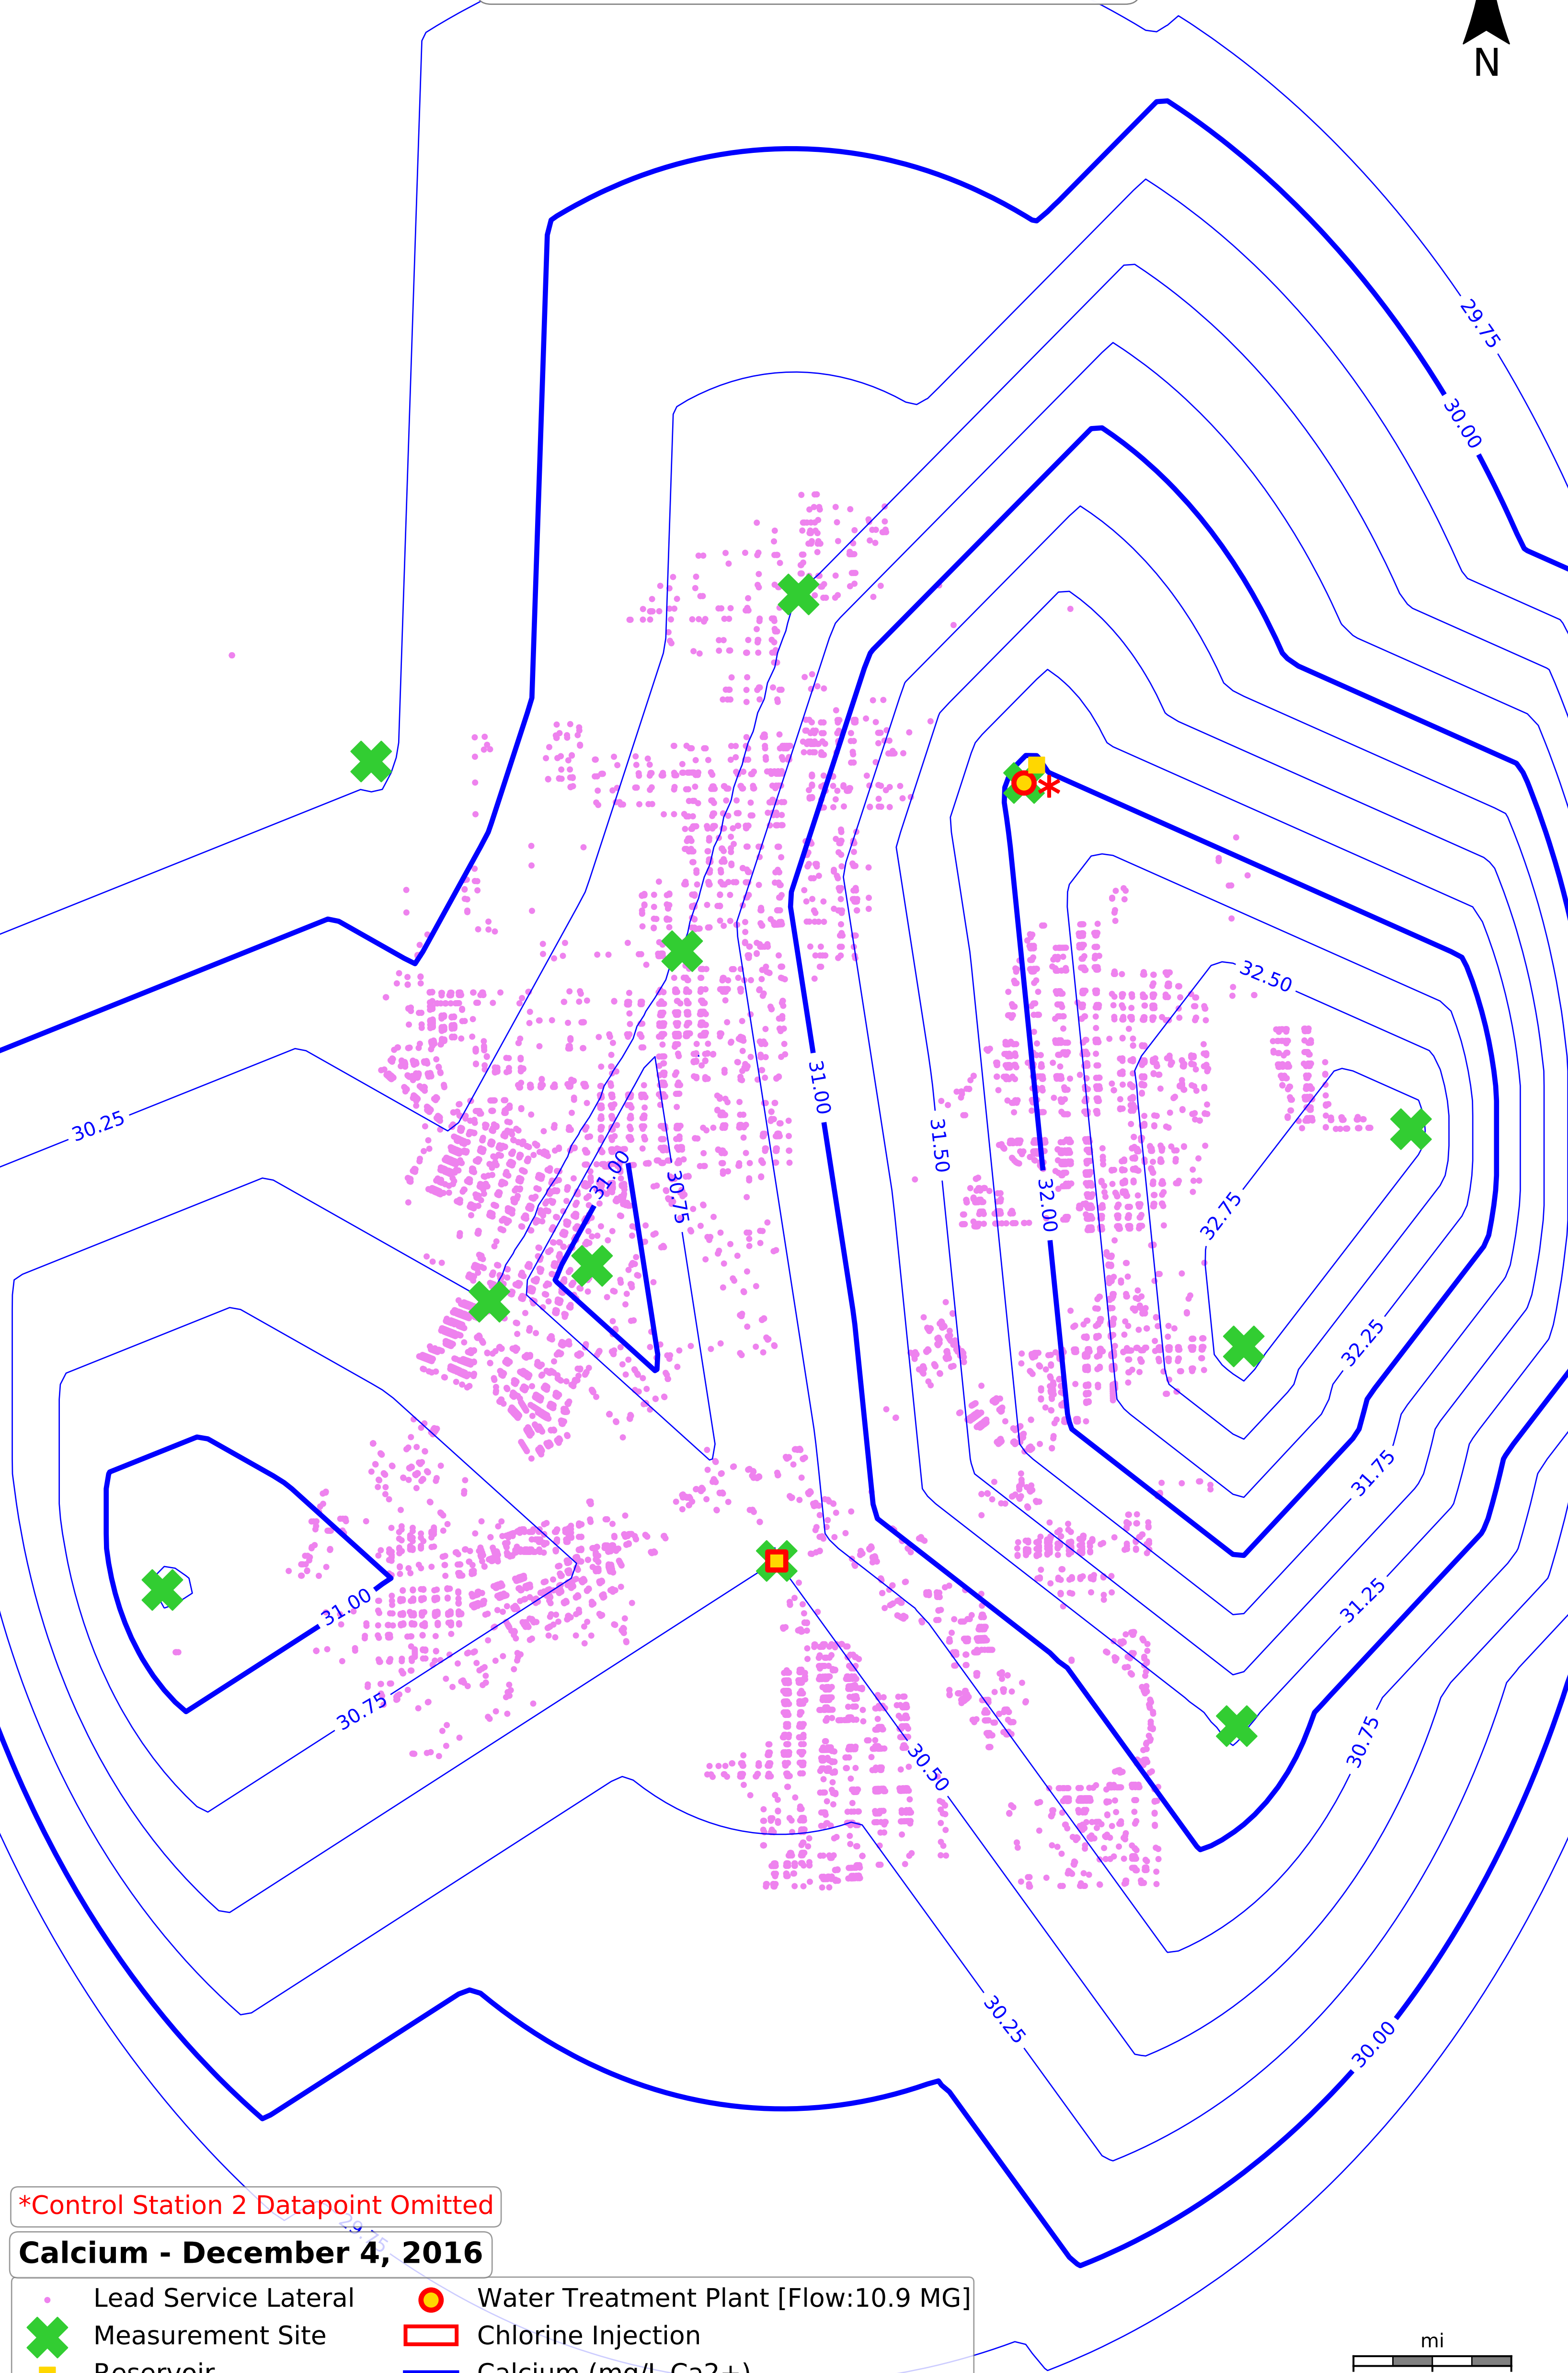

*Control Station 2 Datapoint Omitted

Calcium - December 4, 2016

- | | |
|--|--|
|  Lead Service Lateral |  Water Treatment Plant [Flow:10.9 MG] |
|  Measurement Site |  Chlorine Injection |
|  Reservoir |  Calcium (mg/L Ca ²⁺) |

mi
0.0 0.5 1.0