


# City of Flint, Michigan

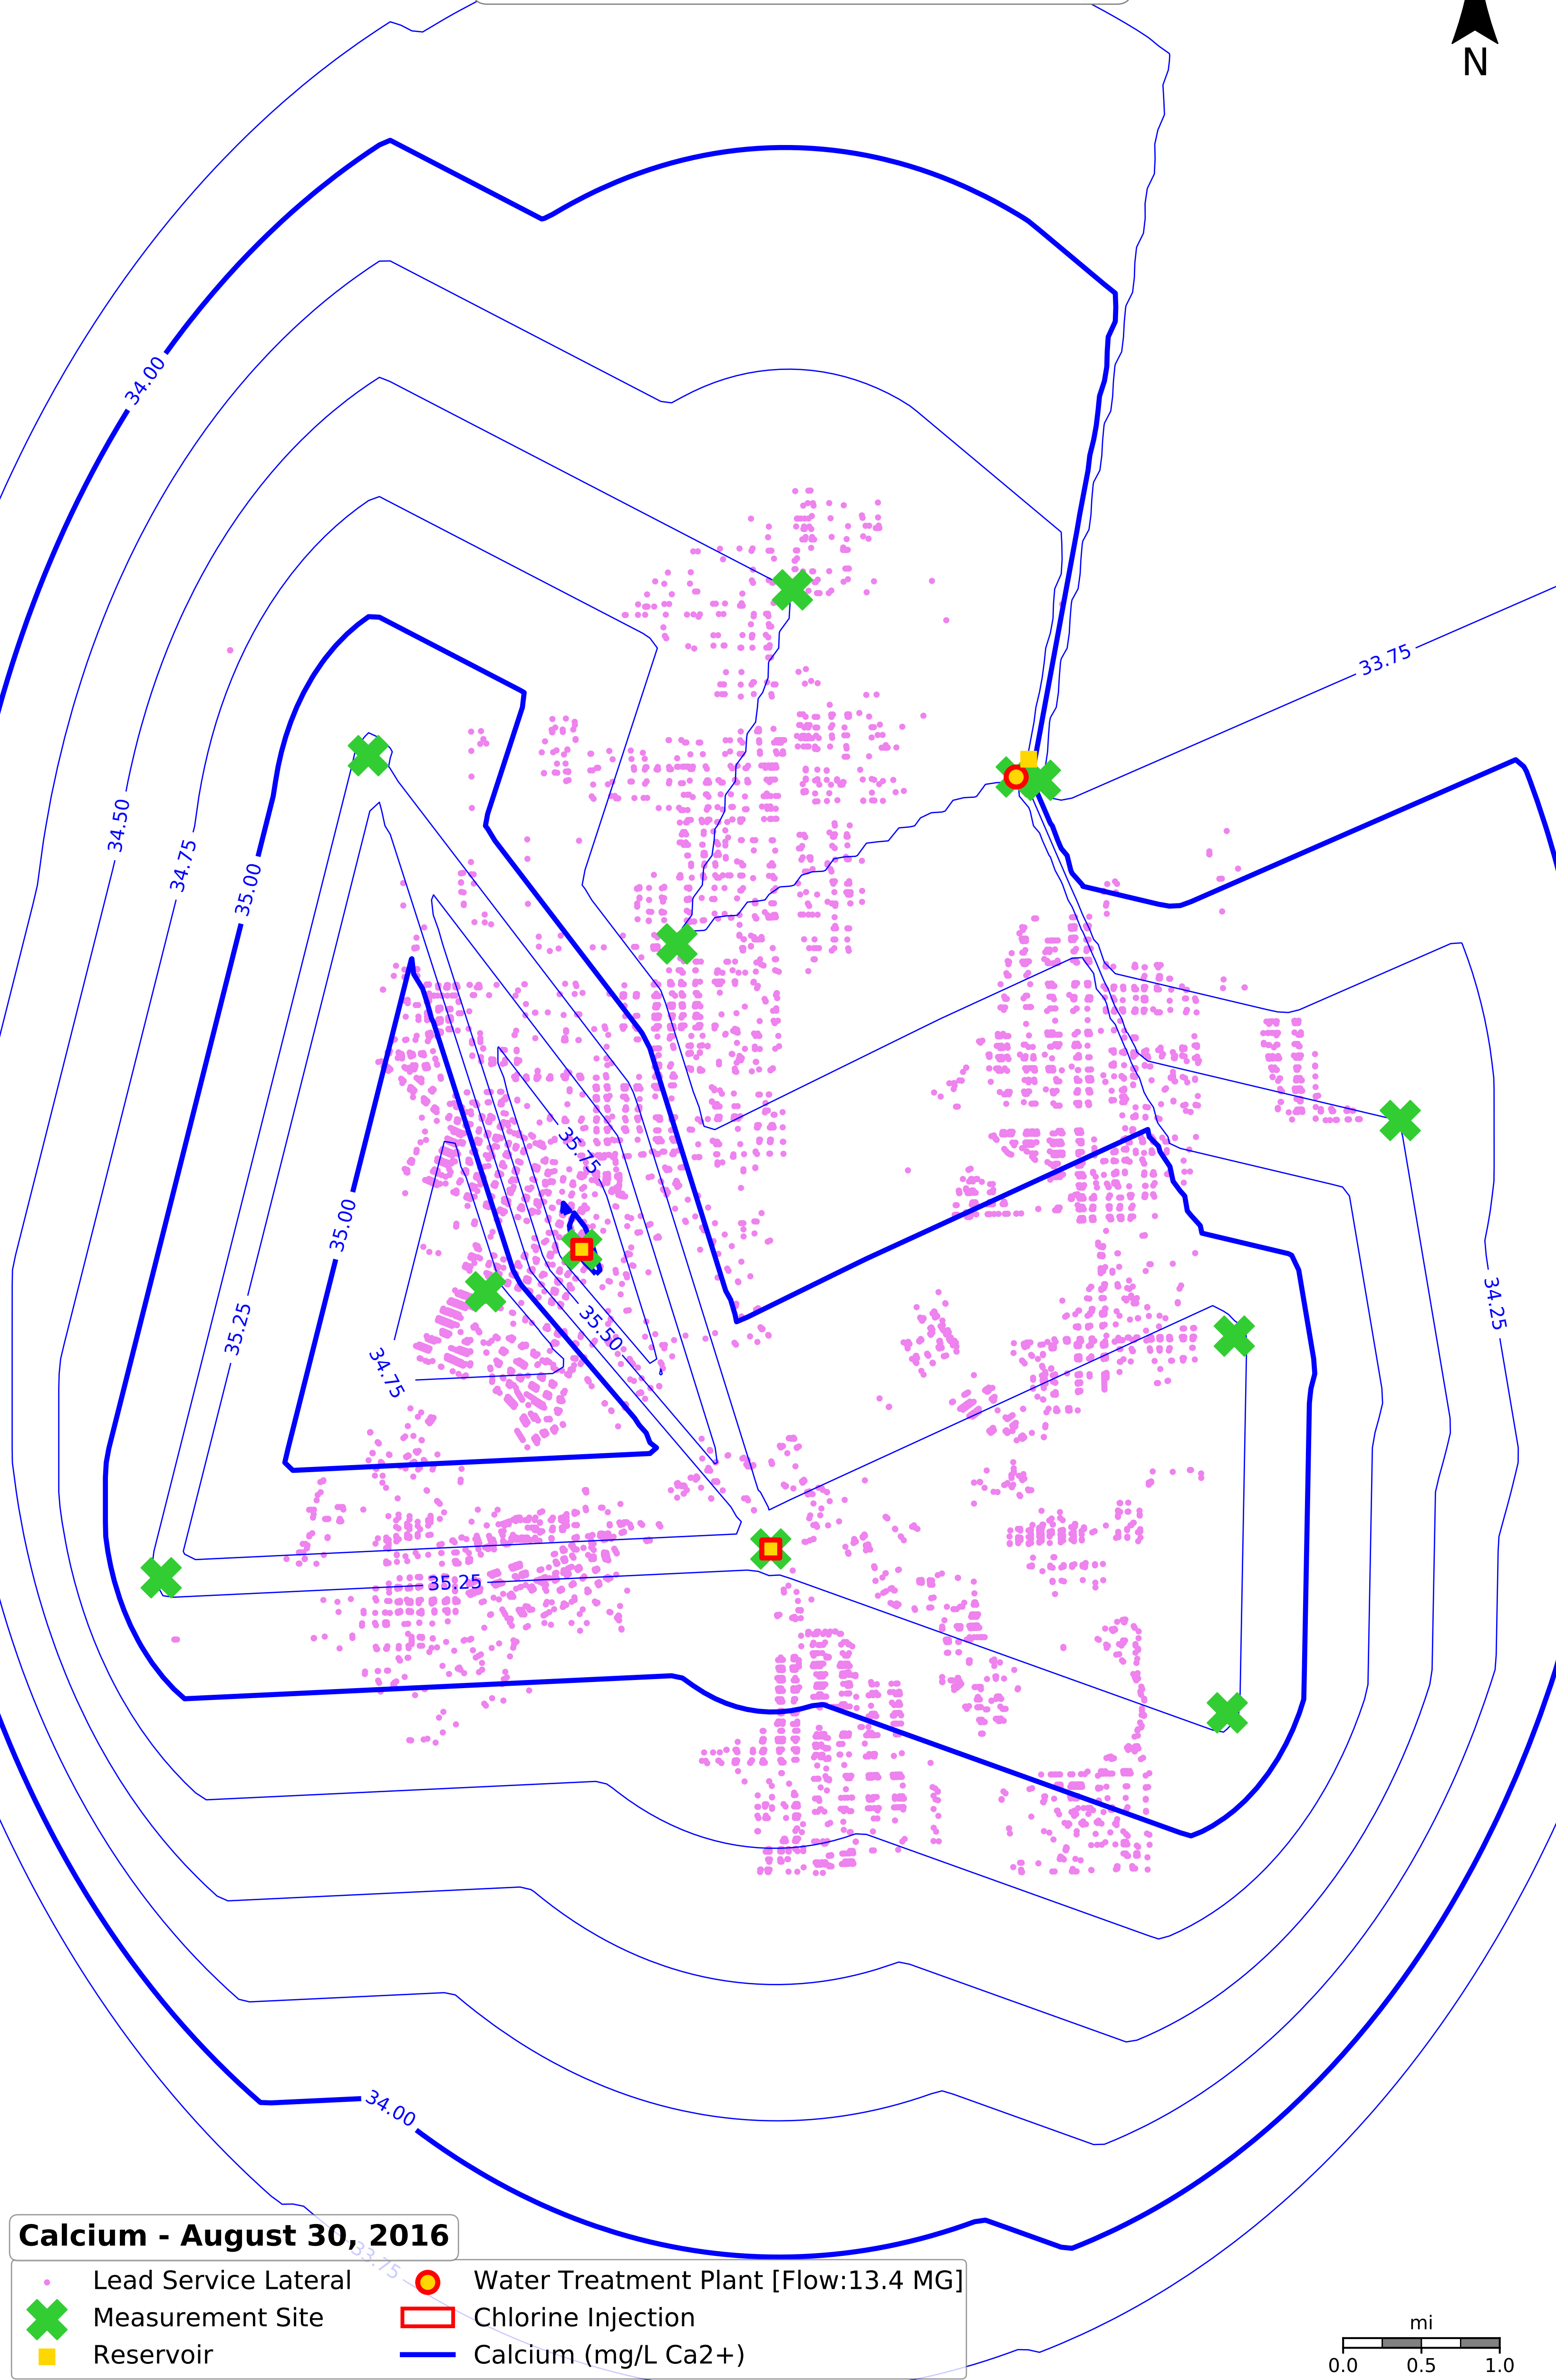

## Calcium - August 30, 2016

- Lead Service Lateral
- Measurement Site
- Reservoir
- Water Treatment Plant [Flow:13.4 MG]
- Chlorine Injection
- Calcium (mg/L Ca<sup>2+</sup>)

mi  
0.0 0.5 1.0