








# City of Flint, Michigan

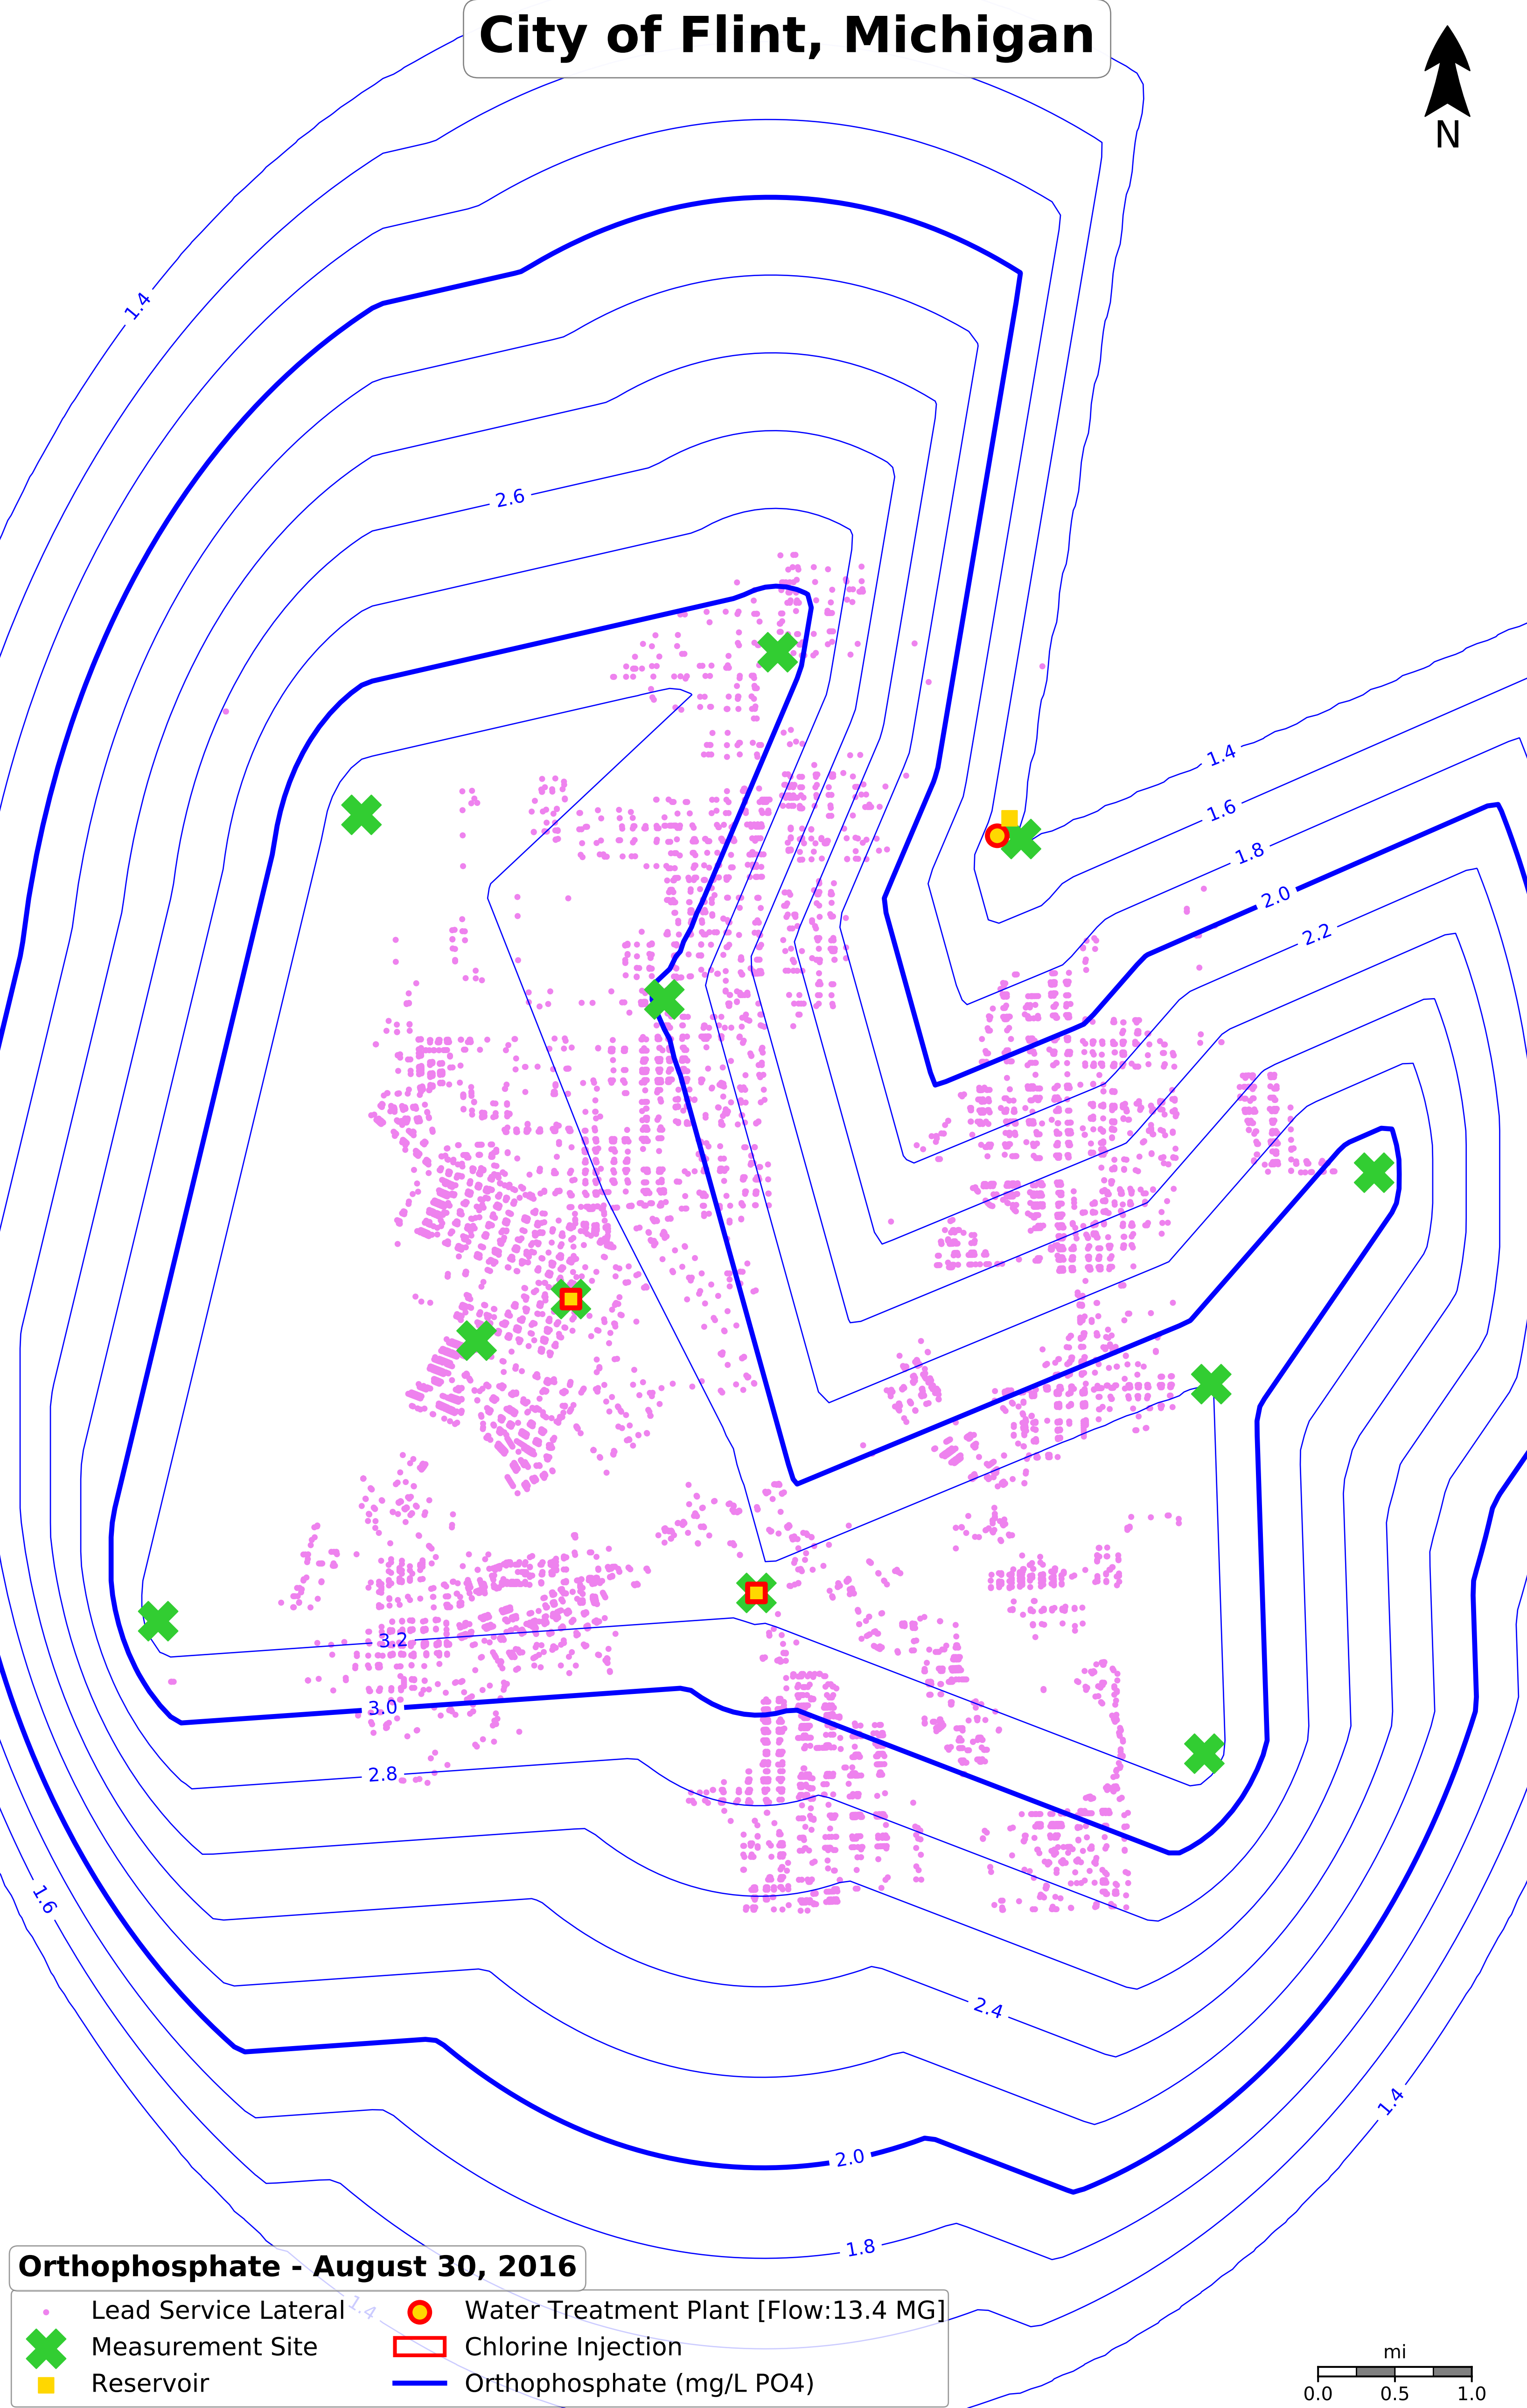

## Orthophosphate - August 30, 2016

- |                                                                                                        |                                                                                                                          |
|--------------------------------------------------------------------------------------------------------|--------------------------------------------------------------------------------------------------------------------------|
|  Lead Service Lateral |  Water Treatment Plant [Flow:13.4 MG] |
|  Measurement Site     |  Chlorine Injection                   |
|  Reservoir            |  Orthophosphate (mg/L PO4)            |

