4.22M	4M	6.15%	4
Total Spend	**Total Budget**	**Variance %**	**Project At Risk**

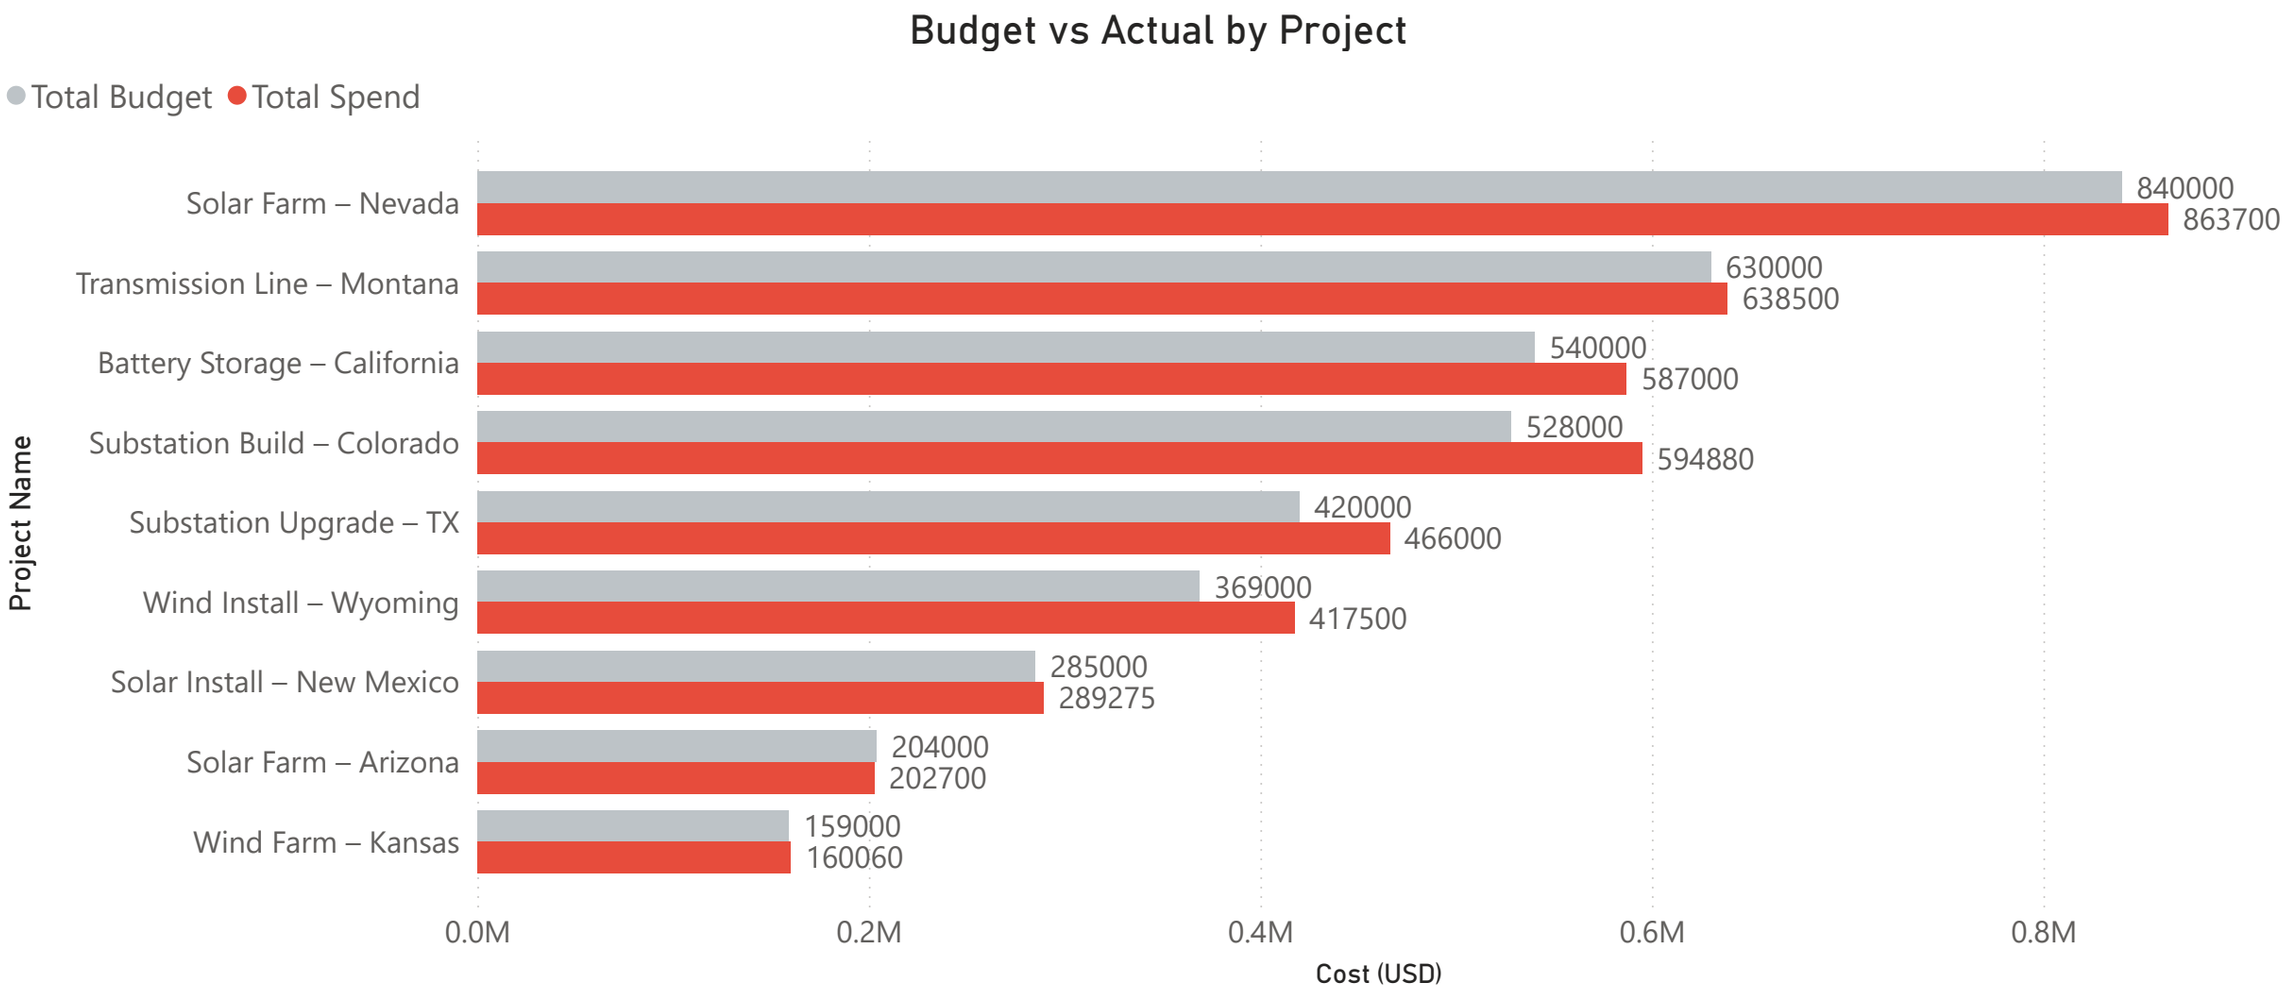

Filter by Project

All

Actual Cost by Category per Project

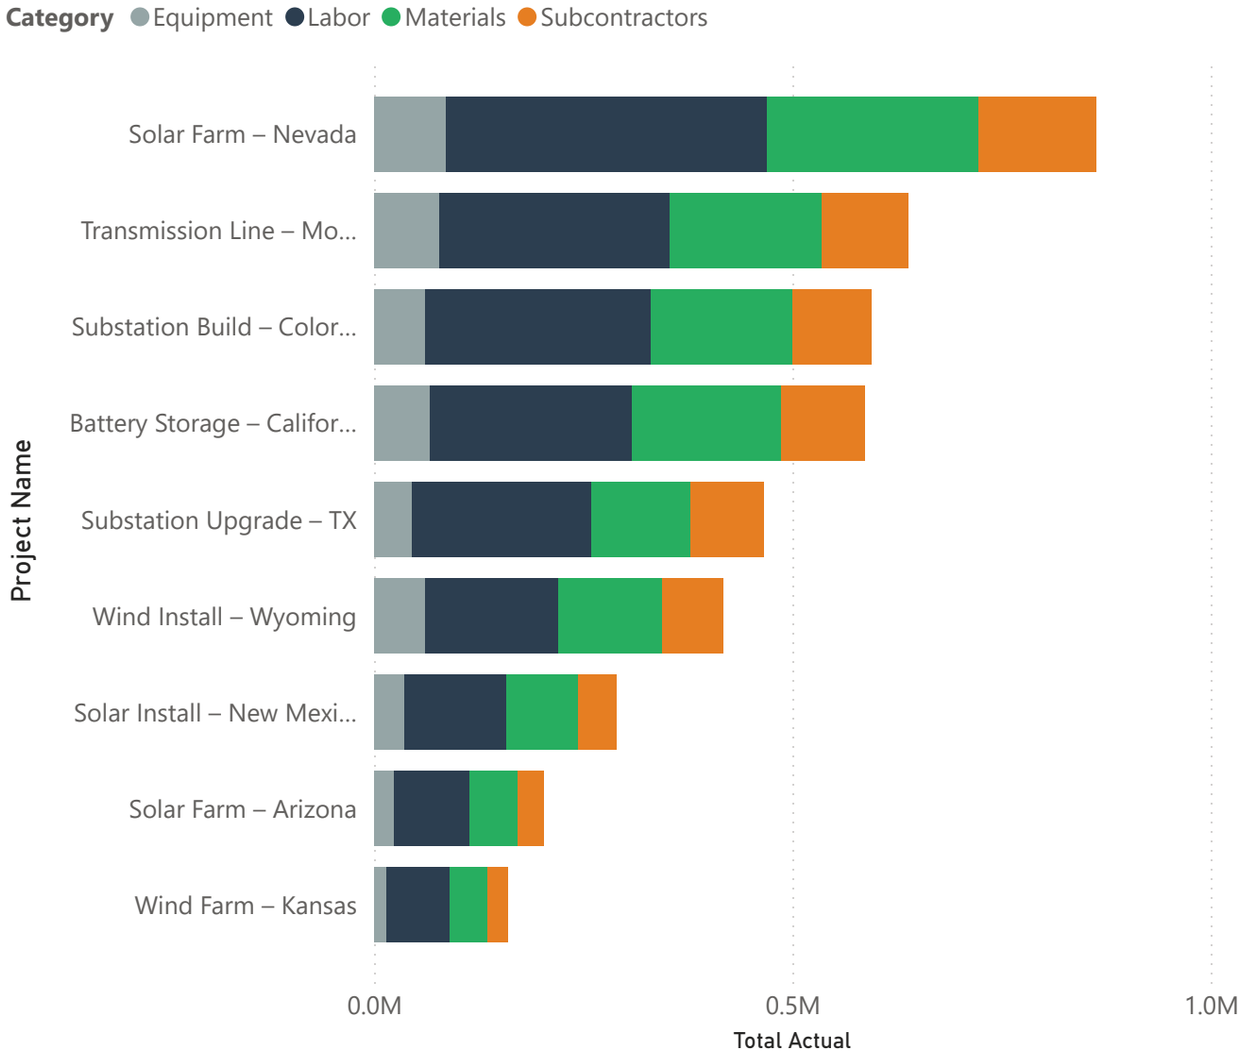

Cumulative Spend vs Budget — All Projects

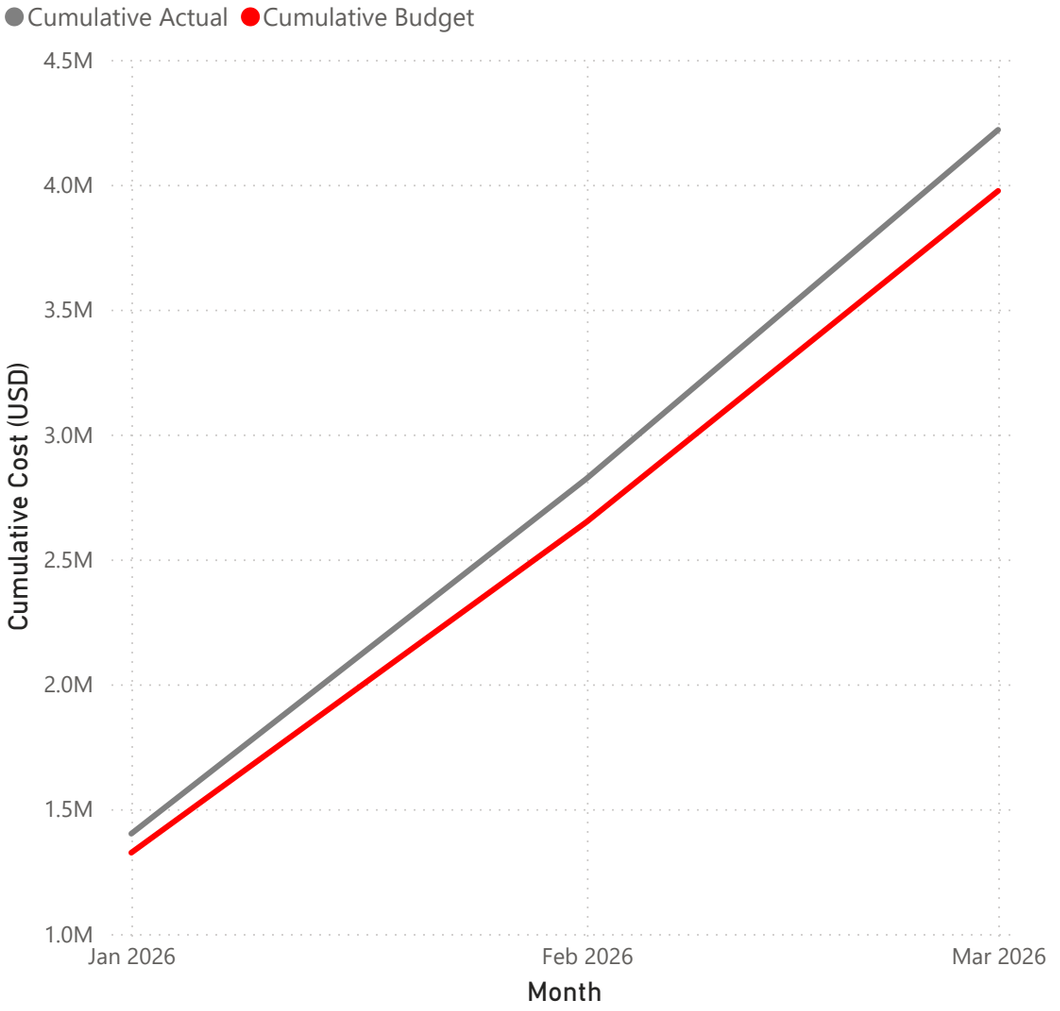

Project Schedule & Status

Project Name	Phase	Start Date	End Date	Status
Battery Storage – California	Engineering	Thursday, January 15, 2026	Wednesday, September 30, 2026	At Risk
Wind Install – Wyoming	Commissioning	Saturday, January 03, 2026	Sunday, May 31, 2026	At Risk
Substation Build – Colorado	Construction	Saturday, January 11, 2025	Tuesday, March 31, 2026	Delayed
Substation Upgrade – TX	Engineering	Saturday, November 15, 2025	Saturday, February 28, 2026	Delayed
Solar Farm – Arizona	Pre-Construction	Friday, January 02, 2026	Monday, August 31, 2026	On Track
Solar Farm – Nevada	Construction	Thursday, January 01, 2026	Tuesday, June 30, 2026	On Track
Solar Install – New Mexico	Commissioning	Sunday, February 15, 2026	Thursday, April 30, 2026	On Track
Transmission Line – Montana	Construction	Sunday, January 12, 2025	Thursday, April 30, 2026	On Track
Wind Farm – Kansas	Pre-Construction	Saturday, January 03, 2026	Monday, November 30, 2026	On Track

Portfolio Health

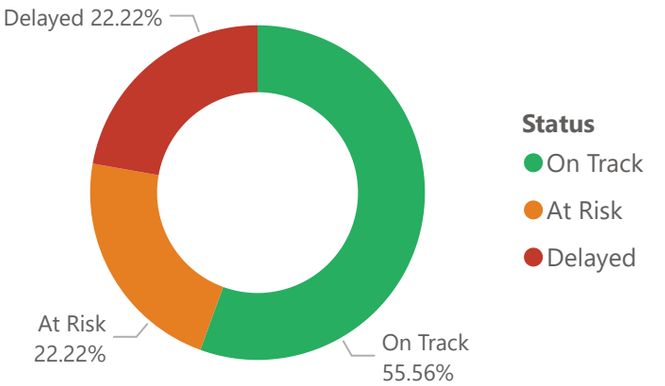

Risk Register

Project ID	Risk Description	Category	Likelihood	Impact	RAG Status	Owner	Status
P001	Labor shortage – Q1 peak season	Workforce	High	High	Red	Site Manager	Open
P002	Engineering scope creep	Scope	High	High	Red	Project Director	Open
P003	Subcontractor performance below SLA	Quality	High	High	Red	QA Manager	Open
P006	Battery component import restrictions	Regulatory	Medium	High	Red	PM	Open
P006	Design change request from client	Scope	High	High	Red	Project Director	Open
P007	Subcontractor contract dispute	Commercial	High	High	Red	Commercial Mgr	Open
P008	Land access agreement pending	Legal	Low	Medium	Green	Legal	Monitoring
P009	Final inspection backlog – state regulator	Regulatory	Low	Low	Green	PM	Open
P001	Panel delivery delay from supplier	Supply Chain	Medium	High	Amber	Procurement Lead	Monitoring
P002	Equipment delivery – 3 week delay	Logistics	Medium	High	Amber	PM	Mitigated
P003	Weather risk – March storms Wyoming	Environmental	Low	Medium	Amber	Safety Lead	Monitoring
P004	Permit approval delays	Regulatory	Medium	Medium	Amber	Legal	Monitoring
P005	Ground condition variance	Technical	Low	High	Amber	Site Engineer	Monitoring
P005	Material cost inflation – steel	Cost	High	Medium	Amber	Cost Manager	Open
P007	Crew mobilization delays	Workforce	Medium	High	Amber	Site Manager	Mitigated

Subcontractor Spend: Budget vs Actual

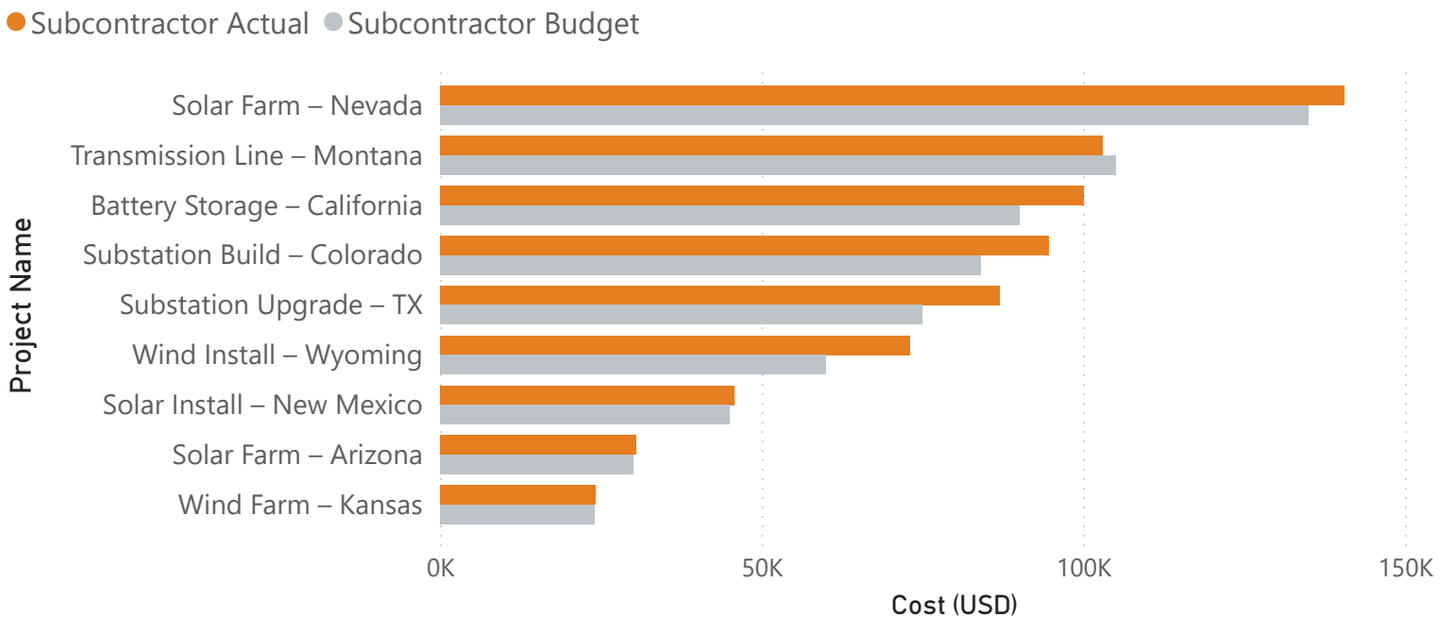

698.48K

Total Subcontractor Spend

Subcontractor Cost Tracker

Project Name	Budget	Actual Spend	Variance	Variance %
Wind Install – Wyoming	60000	73,000.00	13,000.00	21.67%
Substation Upgrade – TX	75000	87,000.00	12,000.00	16.00%
Substation Build – Colorado	84000	94,640.00	10,640.00	12.67%
Battery Storage – California	90000	100,000.00	10,000.00	11.11%
Solar Farm – Nevada	135000	140,500.00	5,500.00	4.07%
Solar Install – New Mexico	45000	45,675.00	675.00	1.50%
Solar Farm – Arizona	30000	30,500.00	500.00	1.67%
Wind Farm – Kansas	24000	24,160.00	160.00	0.67%
Transmission Line – Montana	105000	103,000.00	-2,000.00	-1.90%