

PVsyst - Simulation report

Grid-Connected System

Project: NOVO-CUIABA

Variant: New simulation variant

No 3D scene defined, no shadings

System power: 2400 Wp

Cuiabá - Brazil



PVsyst V8.1.5

VCO, Simulation date:
16/09/26 14:27
with V8.1.5

Project summary

Geographical Site

Cuiabá
Brazil

Situation

Latitude -15.5987 °(S)
Longitude -56.0991 °(W)
Altitude 188 m
Time zone UTC-4

Project settings

Albedo 0.20

Weather data

Cuiabá
NASA POWER satellite data 2001-2020 - Synthetic

System summary

Grid-Connected System

Orientation #1 Horizontal plane

System information

PV Array

Nb. of modules
Pnom total

No 3D scene defined, no shadings

Near Shadings

no Shadings

Inverters

Nb. of units
Total power
Pnom ratio

User's needs

Unlimited load (grid)

4 units
2400 Wp

1 unit
2 kWac
1.20

Results summary

Simulation step Hourly

Produced Energy 3872.6 kWh/year Specific production 1614 kWh/kWp/year Perf. Ratio PR 83.98 %

Table of contents

Project and results summary	2
General parameters, PV Array Characteristics, System losses	3
Main results	4
Loss diagram	5
Predef. graphs	6
Single-line diagram	7



PVsyst V8.1.5

VC0, Simulation date:
16/09/26 14:27
with V8.1.5

General parameters

Grid-Connected System

No 3D scene defined, no shadings

Simulation step

Hourly

Orientation #1

Horizontal plane

Models used

Transposition Perez
Diffuse Perez, Meteonorm
Circumsolar separate

Horizon

Free Horizon

Near Shadings

no Shadings

User's needs

Unlimited load (grid)

PV Array Characteristics

PV module

Manufacturer Generic
Model JKM-600N-72HL4-V
(Original PVsyst database)
Unit Nom. Power 600 Wp
Number of PV modules 4 units
Nominal (STC) 2400 Wp
Modules 1 unit x 4 In series
At operating cond. (50°C)
Pmpp 2226 Wp
U mpp 163 V
I mpp 14 A

Total PV power

Nominal (STC) 2.40 kWp
Total 4 modules
Module area 10.3 m²
Cell area 9.5 m²

Inverter

Manufacturer Generic
Model MIC 2000TL-X
(Original PVsyst database)
Unit Nom. Power 2.00 kWac
Number of inverters 1 unit
Total power 2.0 kWac
Operating voltage 50-500 V
Pnom ratio (DC:AC) 1.20

Total inverter power

Total power 2 kWac
Number of inverters 1 unit
Pnom ratio 1.20

Array losses

Thermal Loss factor

Module temperature according to irradiance
Uc (const) 20.0 W/m²K
Uv (wind) 0.0 W/m²K/m/s

DC wiring losses

Global array res. 196 mΩ
Loss Fraction 1.50 % at STC

Module Quality Loss

Loss Fraction -0.75 %

Module mismatch losses

Loss Fraction 2.00 % at MPP

IAM loss factor

Incidence effect (IAM): Fresnel, AR coating, n(glass)=1.526, n(AR)=1.290

0°	30°	50°	60°	70°	75°	80°	85°	90°
1.000	0.999	0.987	0.963	0.892	0.814	0.679	0.438	0.000



PVsyst V8.1.5

VC0, Simulation date:
16/09/26 14:27
with V8.1.5

Main results

Simulation step

Hourly

System Production

Produced Energy

3872.6 kWh/year


Specific production

1614 kWh/kWp/year


Perf. Ratio PR

83.98 %

Normalized productions (per installed kWp)

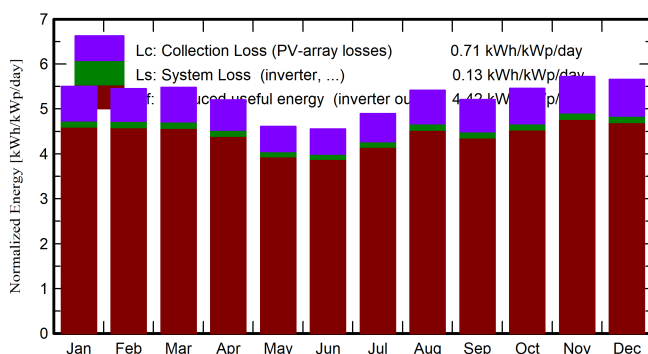

Performance Ratio PR

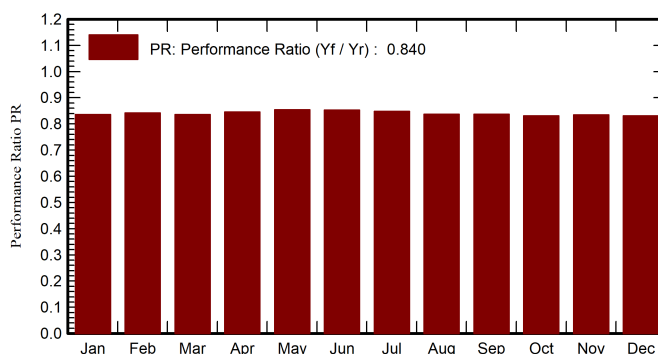

Balances and main results

	GlobHor	DiffHor	T_Amb	GlobInc	GlobEff	EArray	E_Grid	PR
	kWh/m ²	kWh/m ²	°C	kWh/m ²	kWh/m ²	kWh	kWh	ratio
January	170.7	81.25	26.65	170.6	166.3	352.9	342.3	0.836
February	152.9	69.99	26.41	152.7	148.9	318.0	308.7	0.842
March	169.9	73.64	26.45	169.9	165.7	351.1	340.7	0.836
April	156.1	57.40	25.76	156.0	152.0	326.2	316.5	0.845
May	143.1	46.46	24.09	143.0	138.5	301.8	293.0	0.854
June	136.8	36.64	24.03	136.7	132.1	288.1	279.7	0.852
July	151.8	35.71	24.58	151.8	147.1	318.4	308.9	0.848
August	167.9	46.05	27.25	167.9	163.5	347.8	337.5	0.837
September	156.4	61.93	29.54	156.3	152.7	323.7	314.1	0.837
October	169.3	74.26	29.47	169.3	165.5	348.1	337.7	0.831
November	171.7	75.59	28.10	171.7	167.8	354.3	343.7	0.834
December	175.4	82.41	27.10	175.4	171.2	360.5	349.7	0.831
Year	1922.2	741.34	26.62	1921.3	1871.3	3990.8	3872.6	0.840

Legends

GlobHor Global horizontal irradiation

DiffHor Horizontal diffuse irradiation

T_Amb Ambient Temperature

GlobInc Global incident in coll. plane

GlobEff Effective Global, corr. for IAM and shadings

EArray Effective energy at the output of the array

E_Grid Energy injected into grid


PR Performance Ratio



PVsyst V8.1.5

VC0, Simulation date:
16/09/26 14:27
with V8.1.5

Loss diagram

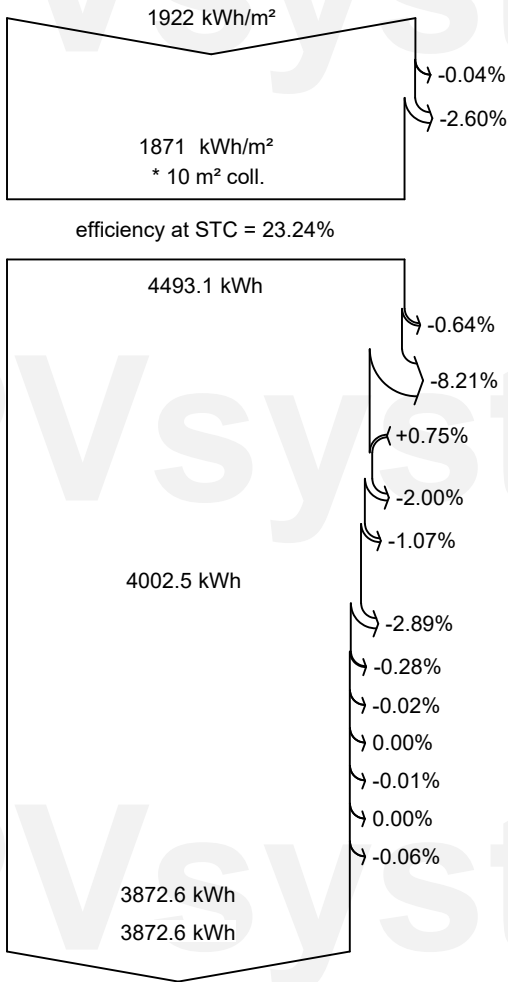

Global horizontal irradiation

Global incident in coll. plane

IAM factor on global

Effective irradiation on collectors

PV conversion

Array nominal energy (at STC effic.)

PV loss due to irradiance level

PV loss due to temperature

Module quality loss

Module array mismatch loss

Ohmic wiring loss

Array virtual energy at MPP

Inverter Loss during operation (efficiency)

Inverter Loss over nominal inv. power

Inverter Loss due to max. input current

Inverter Loss over nominal inv. voltage

Inverter Loss due to power threshold

Inverter Loss due to voltage threshold

Night consumption

Available Energy at Inverter Output


Energy injected into grid




PVsyst V8.1.5

VC0, Simulation date:
16/09/26 14:27
with V8.1.5

Predef. graphs
Daily Input/Output diagram

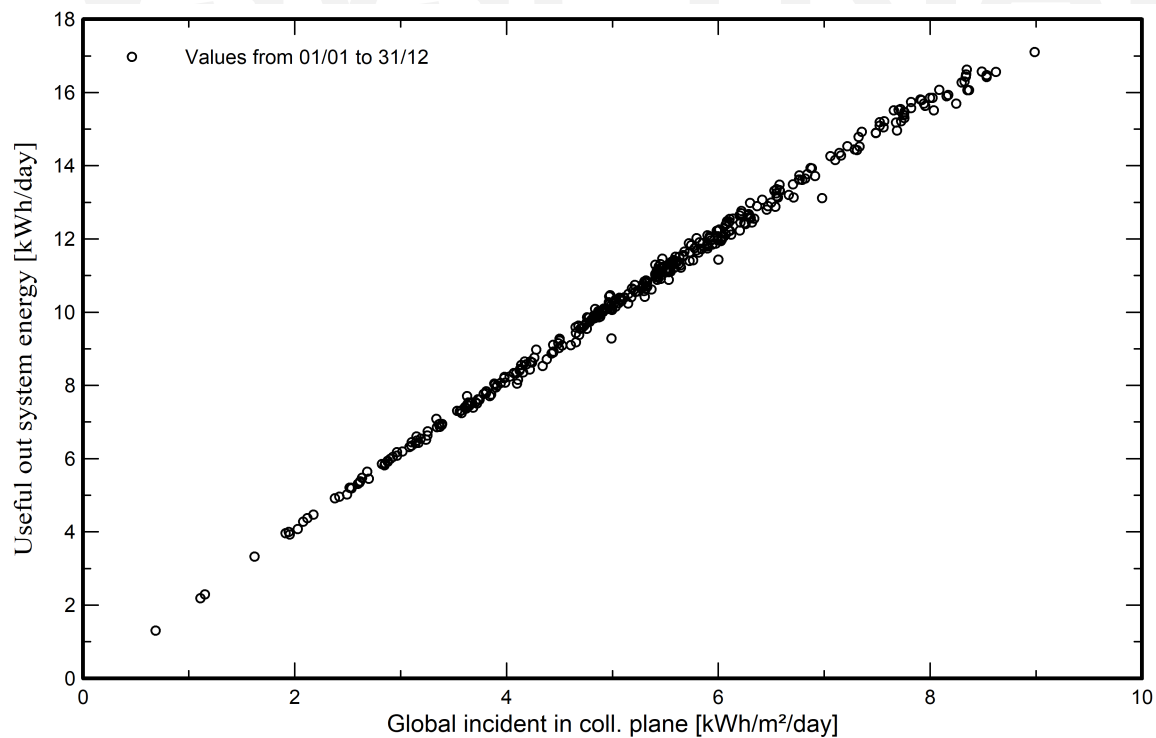

System Output Power Distribution

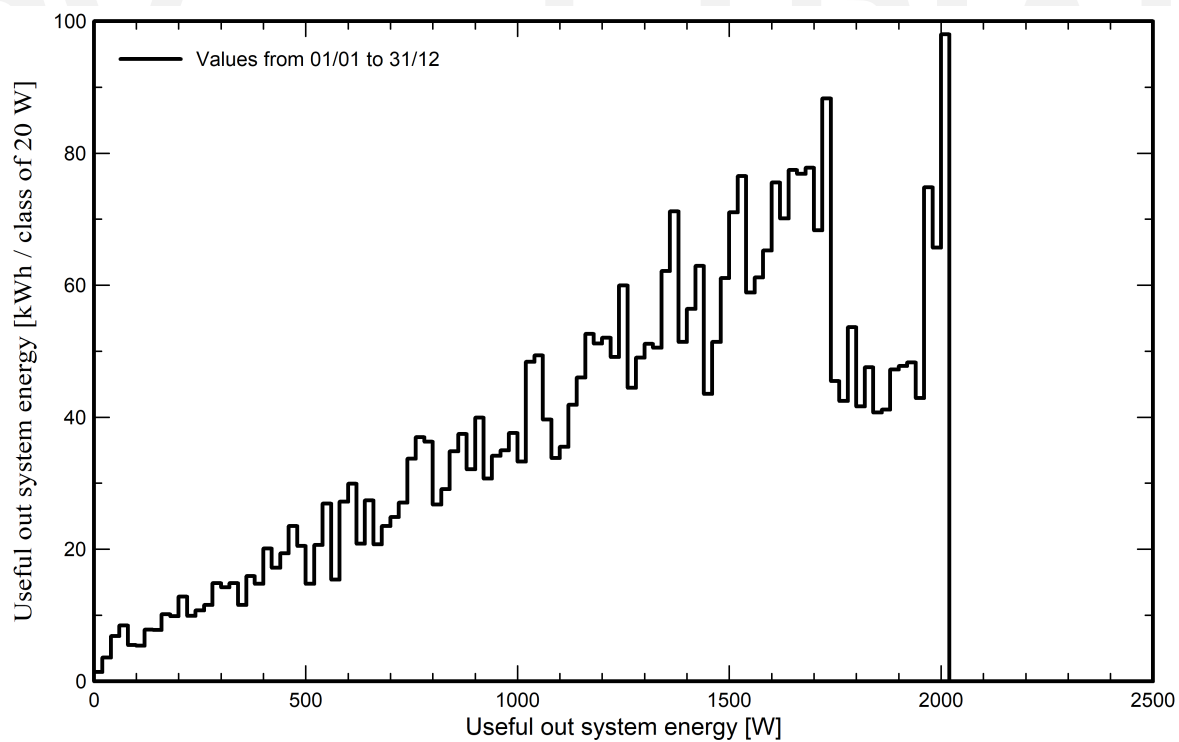




PVsyst V8.1.5

VC0, Simulation date:
16/09/26 14:27
with V8.1.5

Single-line diagram

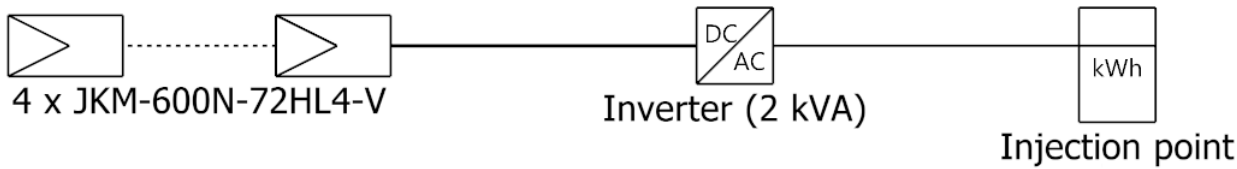

PV module	JKM-600N-72HL4-V
Inverter	MIC 2000TL-X
String	4 x JKM-600N-72HL4-V

NOVO-CUIABA

VC0 : New simulation variant

16/09/26