PVSYST
PHOTOVOLTAIC
SOFTWARE

PVsyst TRIAL

PVsyst - Simulation report

Grid-Connected System

Project: campinas

Variant: New simulation variant

No 3D scene defined, no shadings

System power: 1800 Wp

Campinas - Brazil

Author

PVsyst TRIAL
PVsyst TRIAL
PVsyst TRIAL
PVsyst TRIAL

PVsyst V8.1.7
VC0, Simulation date:
16/10/26 21:59
with V8.1.7

Project summary

Geographical Site
Campinas
Brazil

Situation

Latitude	-22.9056 °(S)
Longitude	-47.0596 °(W)
Altitude	685 m
Time zone	UTC-3

Project settings
Albedo 0.20

Weather data
Campinas
NASA POWER satellite data 2001-2020 - Synthetic

System summary

Grid-Connected System

No 3D scene defined, no shadings

Orientation #1
Horizontal plane

Near Shadings
no Shadings

User's needs
Unlimited load (grid)

System information

PV Array		Inverters	
Nb. of modules	3 units	Nb. of units	1 unit
Pnom total	1800 Wp	Total power	1.5 kWac
		Pnom ratio	1.20

Results summary

Simulation step	Hourly				
Produced Energy	2901.8 kWh/year	Specific production	1612 kWh/kWp/year	Perf. Ratio PR	85.93 %

Table of contents

Project and results summary 2
General parameters, PV Array Characteristics, System losses 3
Main results 4
Loss diagram 5
Predef. graphs 6
Single-line diagram 7

PVsyst TRIAL

PVsyst V8.1.7
VC0, Simulation date:
16/10/26 21:59
with V8.1.7

General parameters

Grid-Connected System — **No 3D scene defined, no shadings**

Simulation step
Hourly

Orientation #1
Horizontal plane

Models used

Transposition	Perez
Diffuse	Perez, Meteonorm
Circumsolar	separate

Horizon
Free Horizon

Near Shadings
no Shadings

User's needs
Unlimited load (grid)

PV Array Characteristics

PV module

Manufacturer	Generic
Model	JKM-600N-72HL4-V
(Original PVsyst database)	
Unit Nom. Power	600 Wp
Number of PV modules	3 units
Nominal (STC)	1800 Wp
Modules	1 unit x 3 In series
At operating cond. (50°C)	
Pmpp	1670 Wp
U mpp	122 V
I mpp	14 A

Inverter

Manufacturer	Generic
Model	MIC 1500TL-X
(Original PVsyst database)	
Unit Nom. Power	1.50 kWac
Number of inverters	1 unit
Total power	1.5 kWac
Operating voltage	50-500 V
Pnom ratio (DC:AC)	1.20

Total PV power

Nominal (STC)	1.80 kWp
Total	3 modules
Module area	7.7 m²
Cell area	7.2 m²

Total inverter power

Total power	1.5 kWac
Number of inverters	1 unit
Pnom ratio	1.20

Array losses

Thermal Loss factor
Module temperature according to irradiance
Uc (const) 20.0 W/m²K
Uv (wind) 0.0 W/m²K/m/s

DC wiring losses
Global array res. 147 mΩ
Loss Fraction 1.50 % at STC

Module Quality Loss
Loss Fraction -0.75 %

Module mismatch losses
Loss Fraction 1.00 % at MPP

IAM loss factor
Incidence effect (IAM): Fresnel, AR coating, n(glass)=1.526, n(AR)=1.290

0°	30°	50°	60°	70°	75°	80°	85°	90°
1.000	0.999	0.987	0.963	0.892	0.814	0.679	0.438	0.000

PVsyst TRIAL

PVsyst V8.1.7
VC0, Simulation date:
16/10/26 21:59
with V8.1.7


Main results

Simulation step
Hourly


System Production

Produced Energy	2901.8 kWh/year	Specific production	1612 kWh/kWp/year
		Perf. Ratio PR	85.93 %

Normalized productions (per installed kWp)

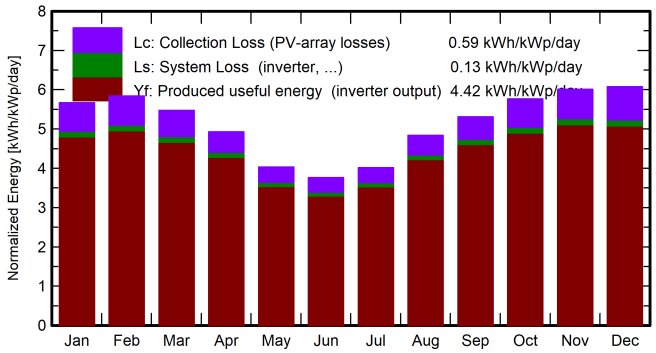

Performance Ratio PR

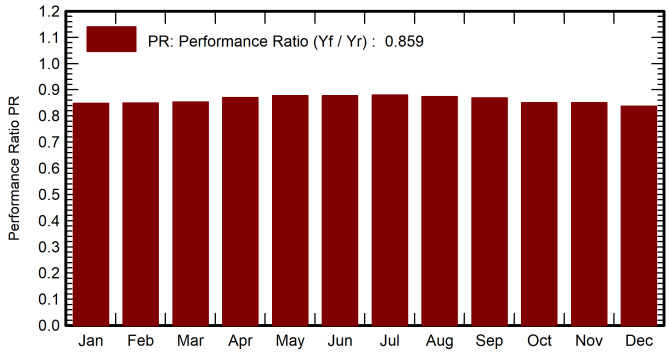

Balances and main results

	GlobHor kWh/m²	DiffHor kWh/m²	T_Amb °C	GlobInc kWh/m²	GlobEff kWh/m²	EArray kWh	E_Grid kWh	PR ratio
January	175.8	83.61	22.84	175.7	171.4	276.4	268.2	0.848
February	163.6	66.87	22.90	163.5	159.5	257.5	250.0	0.849
March	169.7	64.91	22.14	169.6	165.1	268.5	260.6	0.853
April	147.9	47.79	20.65	147.9	143.3	238.5	231.6	0.870
May	125.2	41.70	17.76	125.1	120.6	203.7	197.7	0.878
June	112.9	33.94	17.03	112.8	108.0	183.6	178.2	0.878
July	124.7	34.13	16.80	124.6	119.5	203.2	197.4	0.880
August	150.0	36.87	18.37	150.0	145.2	242.9	235.8	0.874
September	159.3	49.12	20.66	159.2	155.2	256.3	248.9	0.868
October	178.9	69.89	22.20	178.8	174.4	282.0	273.9	0.851
November	180.4	78.40	22.07	180.4	176.0	284.5	276.1	0.850
December	188.3	85.91	22.83	188.3	183.8	292.1	283.5	0.836
Year	1876.7	693.14	20.51	1876.0	1822.1	2989.1	2901.8	0.859


Legends

GlobHor	Global horizontal irradiation	EArray	Effective energy at the output of the array
DiffHor	Horizontal diffuse irradiation	E_Grid	Energy injected into grid
T_Amb	Ambient Temperature	PR	Performance Ratio
GlobInc	Global incident in coll. plane		
GlobEff	Effective Global, corr. for IAM and shadings		

PVsyst TRIAL

PVsyst V8.1.7
VC0, Simulation date:
16/10/26 21:59
with V8.1.7


Loss diagram

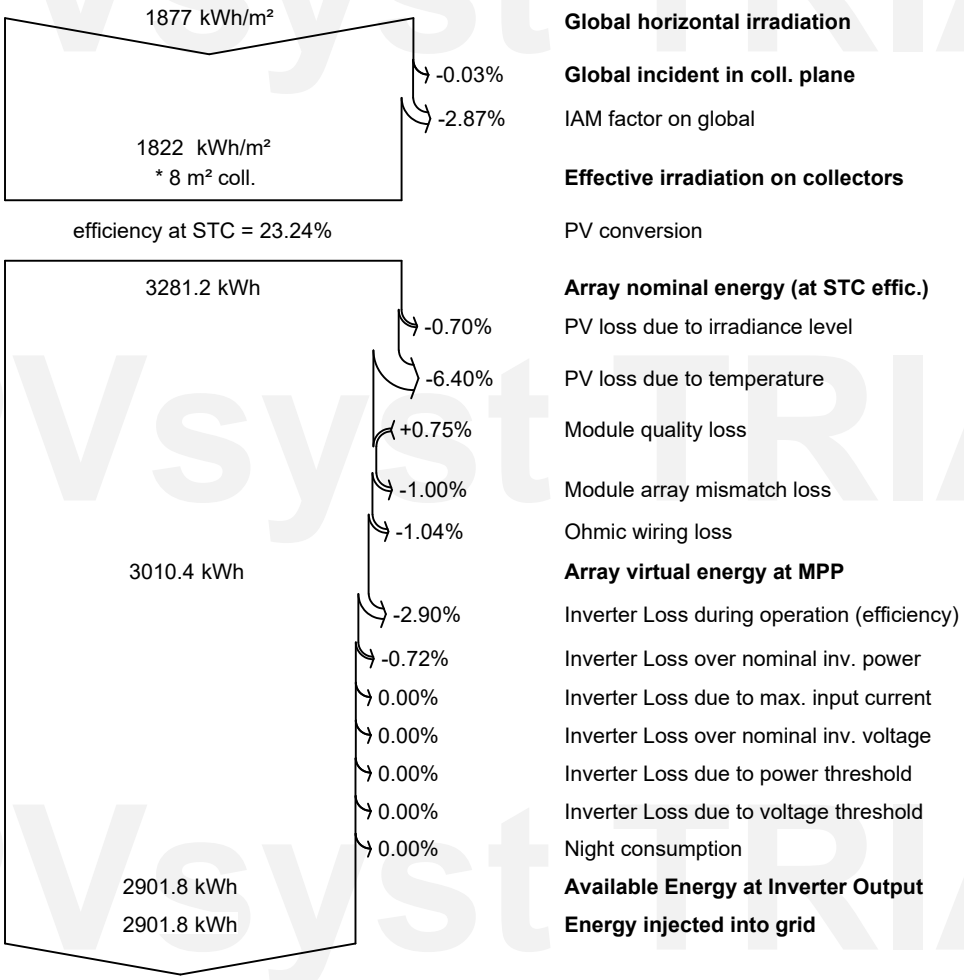


PVsyst TRIAL

Predef. graphs

Daily Input/Output diagram

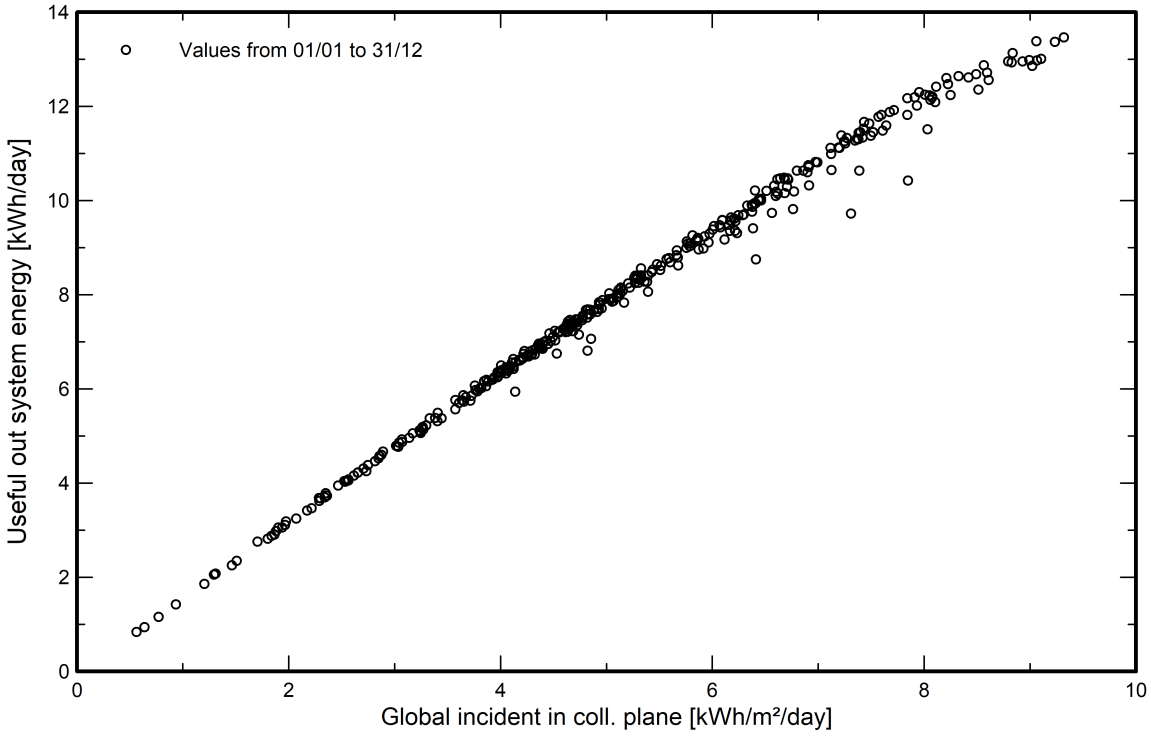


System Output Power Distribution

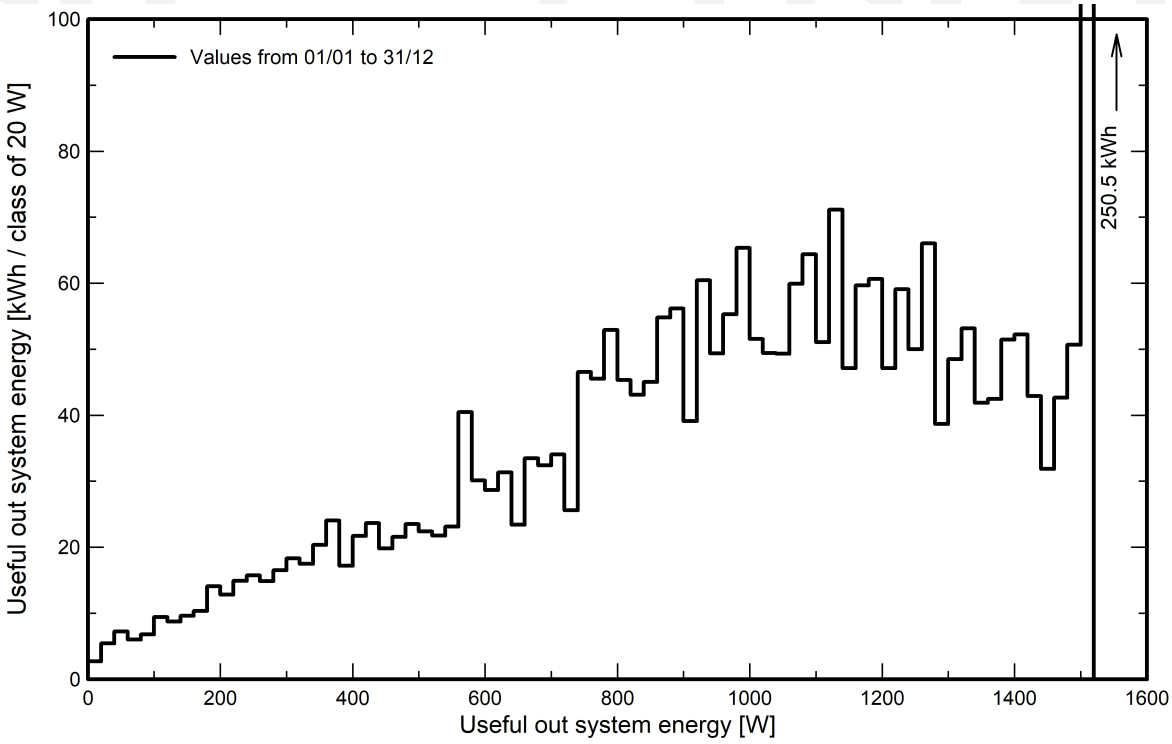

Single-line diagram

PVsyst V8.1.7
VC0, Simulation date:
16/10/26 21:59
with V8.1.7

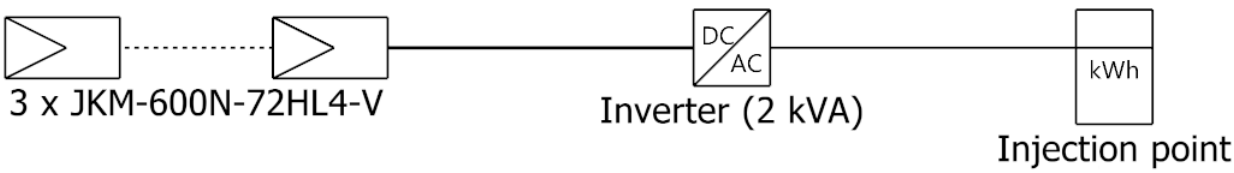

PV module	JKM-600N-72HL4-V
Inverter	MIC 1500TL-X
String	3 x JKM-600N-72HL4-V

	campinas	
	VC0 : New simulation variant	16/10/26