PVSYST
PHOTOVOLTAIC
SOFTWARE

PVsyst TRIAL

PVsyst - Simulation report

Grid-Connected System

Project: campo-grande

Variant: New simulation variant

No 3D scene defined, no shadings

System power: 2400 Wp

Campo-grande - Brazil

Author

PVsyst TRIAL

PVsyst V8.1.7
VC0, Simulation date:
16/10/26 17:05
with V8.1.7

Project summary

Geographical Site
Campo-grande
Brazil

Situation

Latitude	-20.4640 °(S)
Longitude	-54.6163 °(W)
Altitude	592 m
Time zone	UTC-4

Project settings
Albedo 0.20

Weather data
Campo-grande
NASA POWER satellite data 2001-2020 - Synthetic

System summary

Grid-Connected System
No 3D scene defined, no shadings

Orientation #1
Horizontal plane

Near Shadings
no Shadings

User's needs
Unlimited load (grid)

System information

PV Array		Inverters	
Nb. of modules	4 units	Nb. of units	1 unit
Pnom total	2400 Wp	Total power	2 kWac
		Pnom ratio	1.20

Results summary

Simulation step	Hourly				
Produced Energy	3864.0 kWh/year	Specific production	1610 kWh/kWp/year	Perf. Ratio PR	84.54 %

Table of contents

Project and results summary 2
General parameters, PV Array Characteristics, System losses 3
Main results 4
Loss diagram 5
Predef. graphs 6
Single-line diagram 7

PVsyst TRIAL

PVsyst V8.1.7
VC0, Simulation date:
16/10/26 17:05
with V8.1.7

General parameters

Grid-Connected System — **No 3D scene defined, no shadings**

Simulation step
Hourly

Orientation #1
Horizontal plane

Models used

Transposition	Perez
Diffuse	Perez, Meteonorm
Circumsolar	separate

Horizon
Free Horizon

Near Shadings
no Shadings

User's needs
Unlimited load (grid)

PV Array Characteristics

PV module

Manufacturer	Generic
Model	JKM-600N-72HL4-V
(Original PVsyst database)	
Unit Nom. Power	600 Wp
Number of PV modules	4 units
Nominal (STC)	2400 Wp
Modules	1 unit x 4 In series
At operating cond. (50°C)	
Pmpp	2226 Wp
U mpp	163 V
I mpp	14 A

Inverter

Manufacturer	Generic
Model	MIC 2000TL-X
(Original PVsyst database)	
Unit Nom. Power	2.00 kWac
Number of inverters	1 unit
Total power	2.0 kWac
Operating voltage	50-500 V
Pnom ratio (DC:AC)	1.20

Total PV power

Nominal (STC)	2.40 kWp
Total	4 modules
Module area	10.3 m²
Cell area	9.5 m²

Total inverter power

Total power	2 kWac
Number of inverters	1 unit
Pnom ratio	1.20

Array losses

Thermal Loss factor
Module temperature according to irradiance
Uc (const) 20.0 W/m²K
Uv (wind) 0.0 W/m²K/m/s

DC wiring losses
Global array res. 196 mΩ
Loss Fraction 1.50 % at STC

Module Quality Loss
Loss Fraction -0.75 %

Module mismatch losses
Loss Fraction 2.00 % at MPP

IAM loss factor
Incidence effect (IAM): Fresnel, AR coating, n(glass)=1.526, n(AR)=1.290

0°	30°	50°	60°	70°	75°	80°	85°	90°
1.000	0.999	0.987	0.963	0.892	0.814	0.679	0.438	0.000

PVsyst V8.1.7
VC0, Simulation date:
16/10/26 17:05
with V8.1.7


Main results

Simulation step
Hourly


System Production

Produced Energy	3864.0 kWh/year	Specific production	1610 kWh/kWp/year
		Perf. Ratio PR	84.54 %

Normalized productions (per installed kWp)

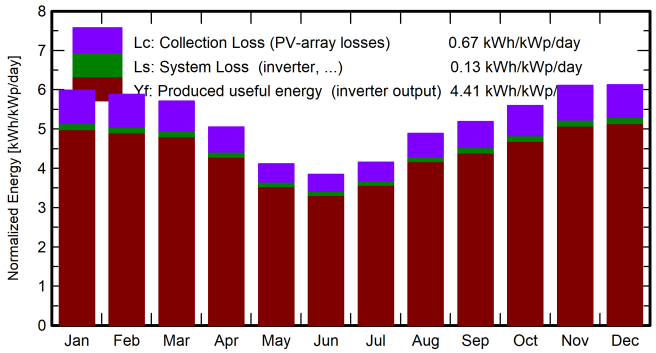

Performance Ratio PR

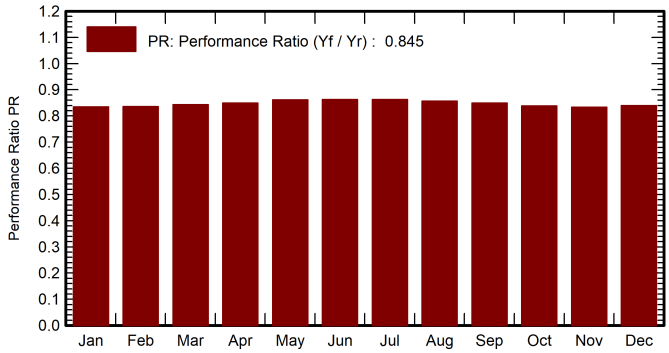

Balances and main results

	GlobHor kWh/m²	DiffHor kWh/m²	T_Amb °C	GlobInc kWh/m²	GlobEff kWh/m²	EArray kWh	E_Grid kWh	PR ratio
January	185.8	81.64	25.06	185.7	181.3	383.2	371.8	0.834
February	164.7	69.90	25.05	164.6	160.4	340.2	330.1	0.836
March	177.3	64.08	24.84	177.1	172.7	369.0	358.2	0.843
April	151.7	47.60	23.45	151.6	147.1	318.4	309.0	0.849
May	127.6	41.70	20.08	127.6	122.9	271.9	263.8	0.861
June	115.3	34.69	19.32	115.3	110.9	246.1	238.7	0.863
July	128.8	36.11	19.42	128.7	123.8	274.4	266.3	0.862
August	151.5	39.17	21.59	151.4	146.7	320.5	311.1	0.856
September	155.7	51.60	24.19	155.6	151.7	326.7	316.9	0.849
October	173.6	69.70	25.45	173.6	169.7	359.9	349.1	0.838
November	183.2	73.16	25.30	183.2	178.7	377.2	366.1	0.833
December	190.0	83.72	25.46	189.9	185.3	394.3	382.8	0.840
Year	1905.1	693.07	23.26	1904.3	1851.0	3981.8	3864.0	0.845


Legends

GlobHor	Global horizontal irradiation
DiffHor	Horizontal diffuse irradiation
T_Amb	Ambient Temperature
GlobInc	Global incident in coll. plane
GlobEff	Effective Global, corr. for IAM and shadings
EArray	Effective energy at the output of the array
E_Grid	Energy injected into grid
PR	Performance Ratio

PVsyst TRIAL

PVsyst V8.1.7
VC0, Simulation date:
16/10/26 17:05
with V8.1.7

Loss diagram

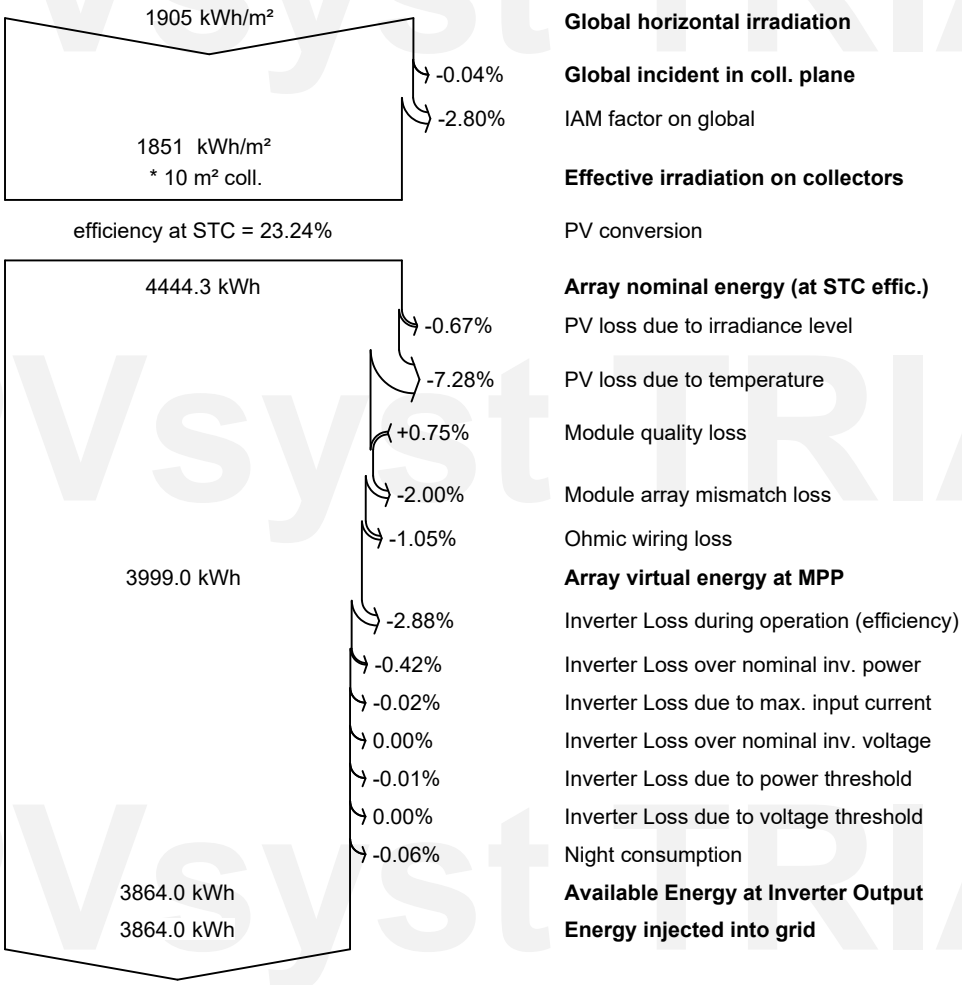


PVsyst TRIAL


PVsyst V8.1.7
VC0, Simulation date:
16/10/26 17:05
with V8.1.7

Predef. graphs

Daily Input/Output diagram

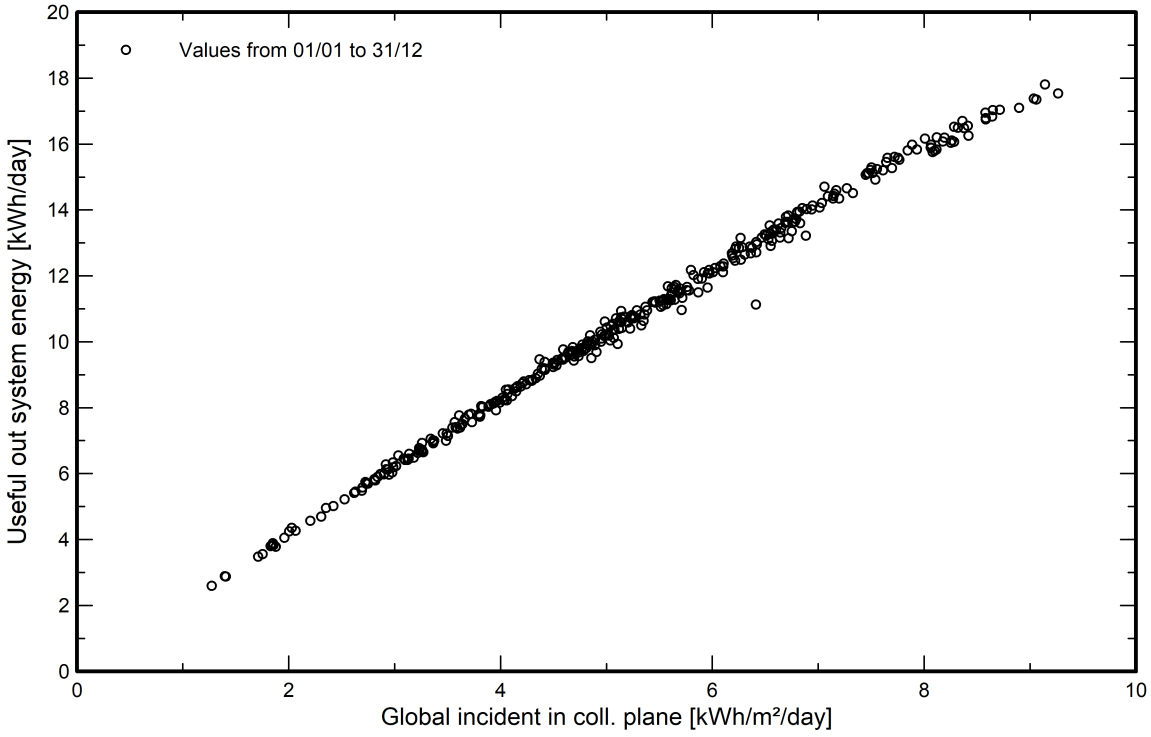


System Output Power Distribution

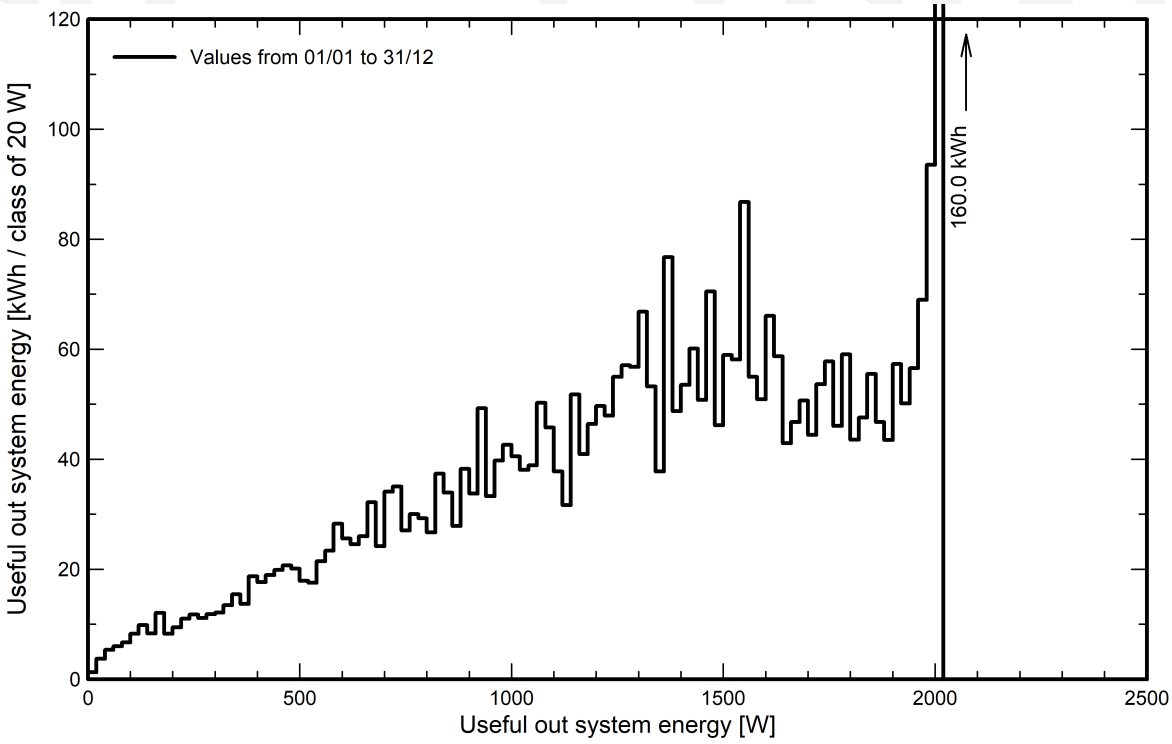

Single-line diagram

PVsyst V8.1.7
VC0, Simulation date:
16/10/26 17:05
with V8.1.7

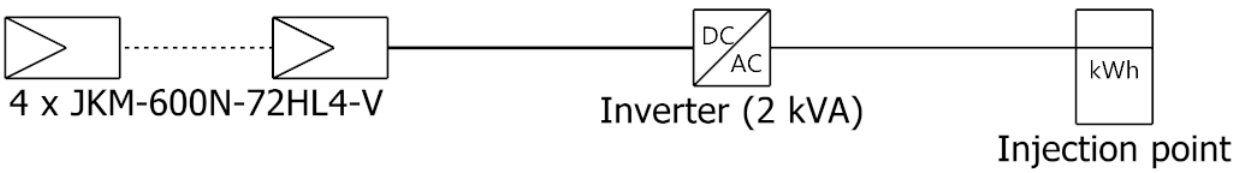

PV module	JKM-600N-72HL4-V
Inverter	MIC 2000TL-X
String	4 x JKM-600N-72HL4-V

	campo-grande	
	VC0 : New simulation variant	16/10/26