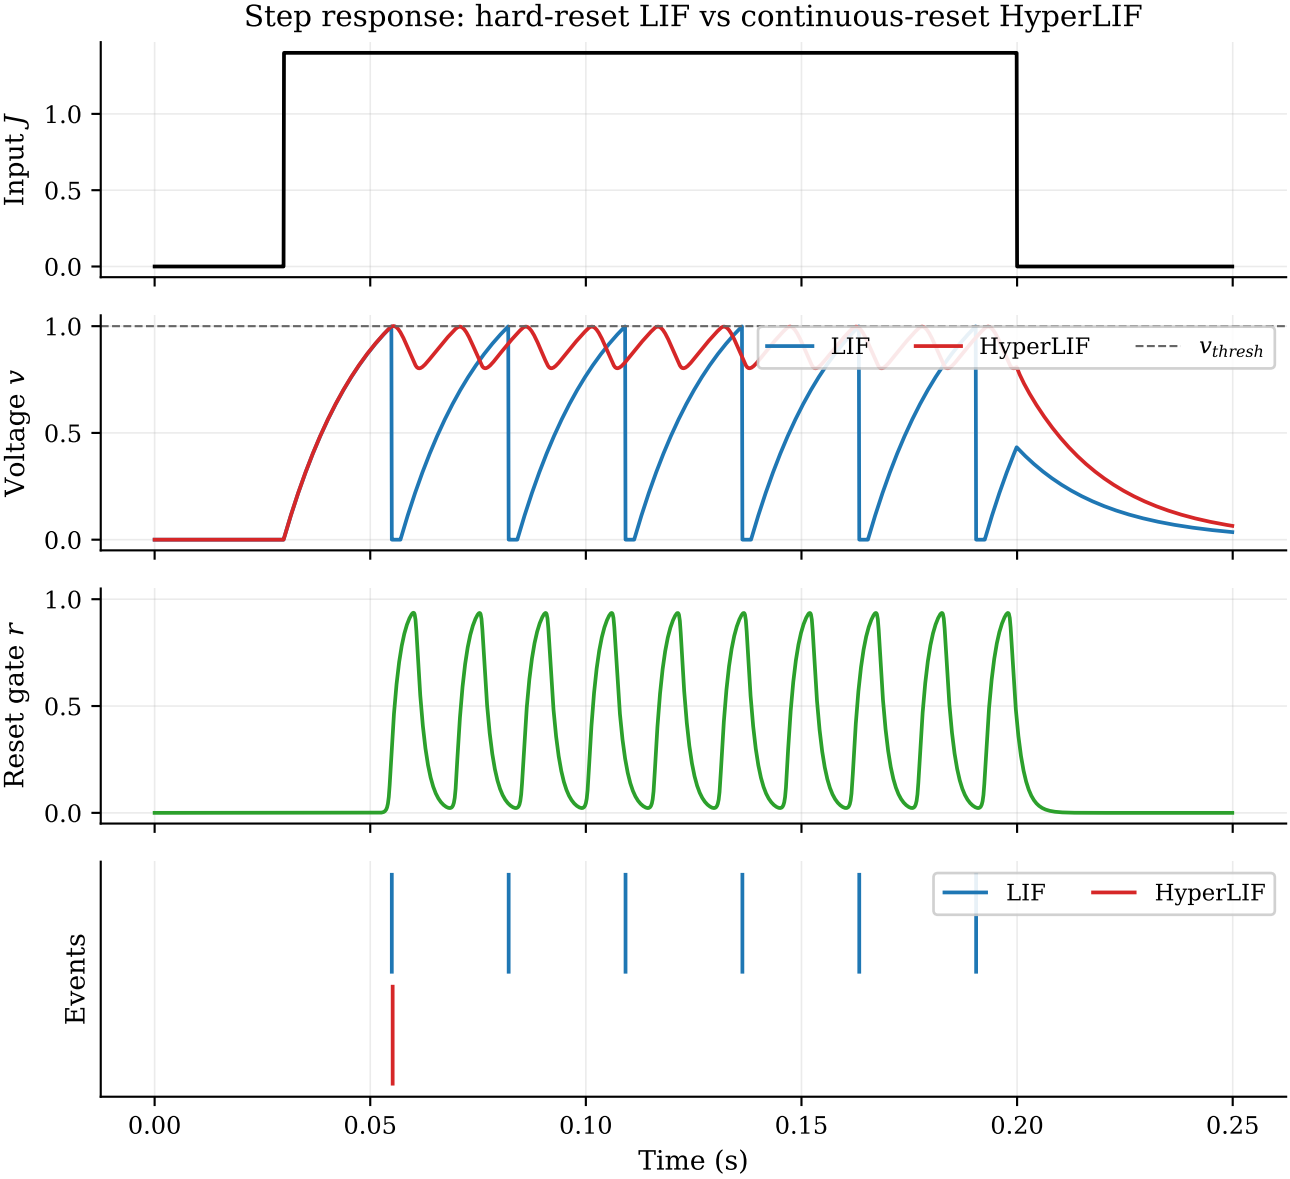
Step response: hard-reset LIF vs continuous-reset HyperLIF
Input J
1.0
0.5
0.0
Voltage v
1.0
0.5
0.0
LIF
HyperLIF
v_{thresh}
Reset gate r
1.0
0.5
0.0
Events
LIF
HyperLIF
0.00
0.05
0.10
0.15
0.20
0.25
Time (s)