
IGBT TEST CELL | CLOSED-LOOP DESAT SCHEMATIC

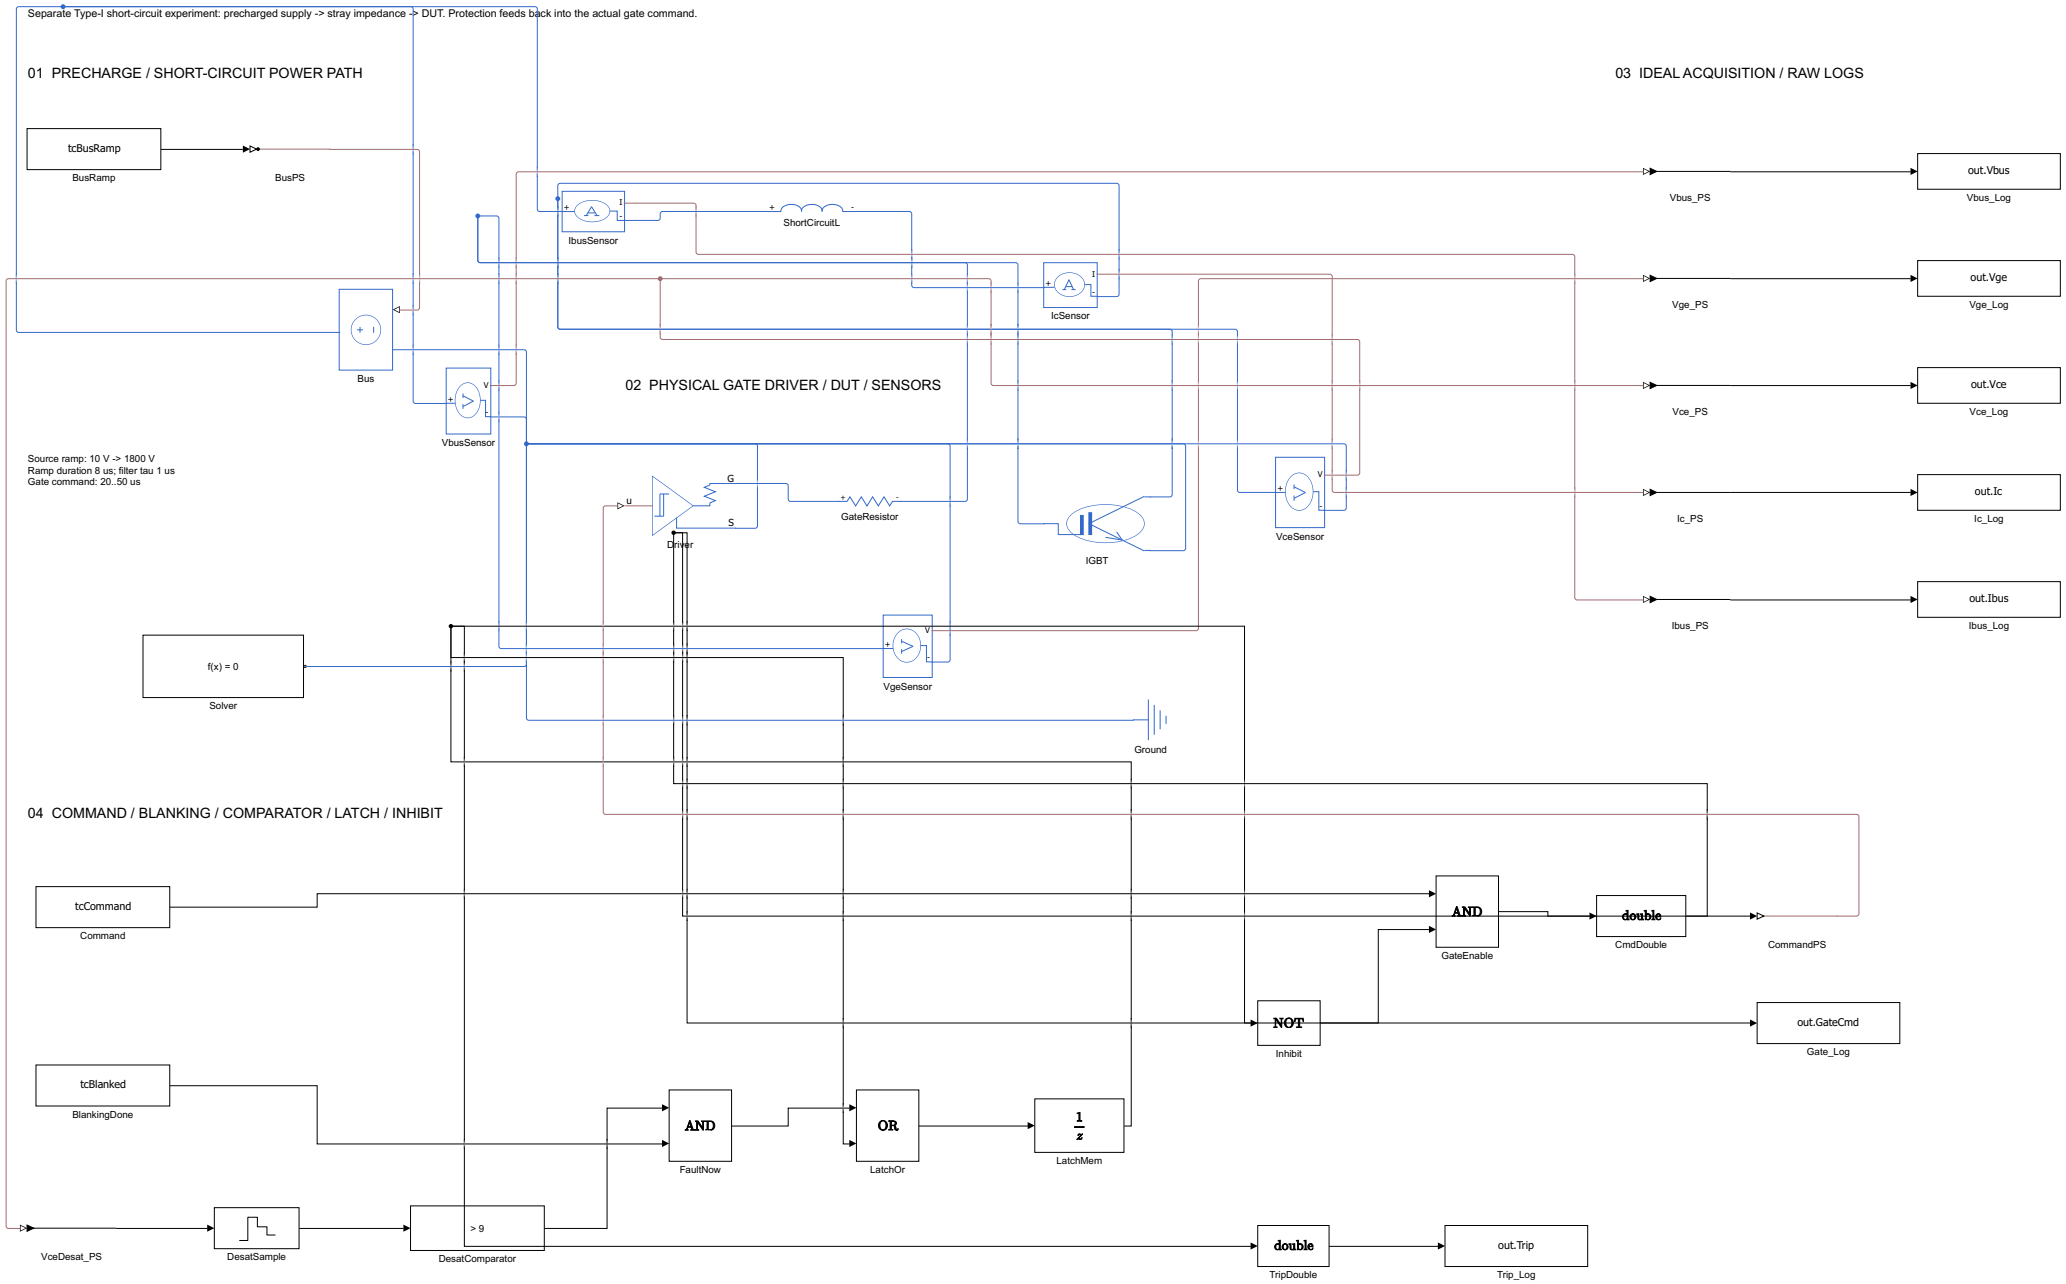

DESAT threshold = 9 V
Blanking = 7.5 us
Detector sample / latch delay = 50 ns
All protection settings ASSUMED

FaultNow = (Vce > threshold) AND BlankingDone\nLatchOr + Unit Delay hold the trip until reset / new simulation.\nGateEnable = Command AND NOT(LatchMem); feeds the physical driver.

Fault onset, detector latch, gate-disable command and current clearance are different times.\nShort-circuit current level and device survival are NOT validated. No avalanche model.\nThe 10 us reference is not replaced by the blanking setting. Hardware decision: INCONCLUSIVE.