



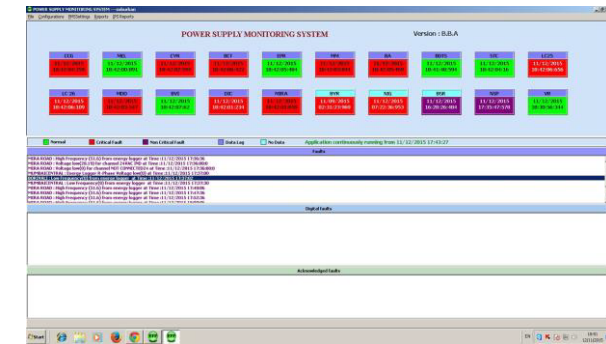

Reports & Analytics

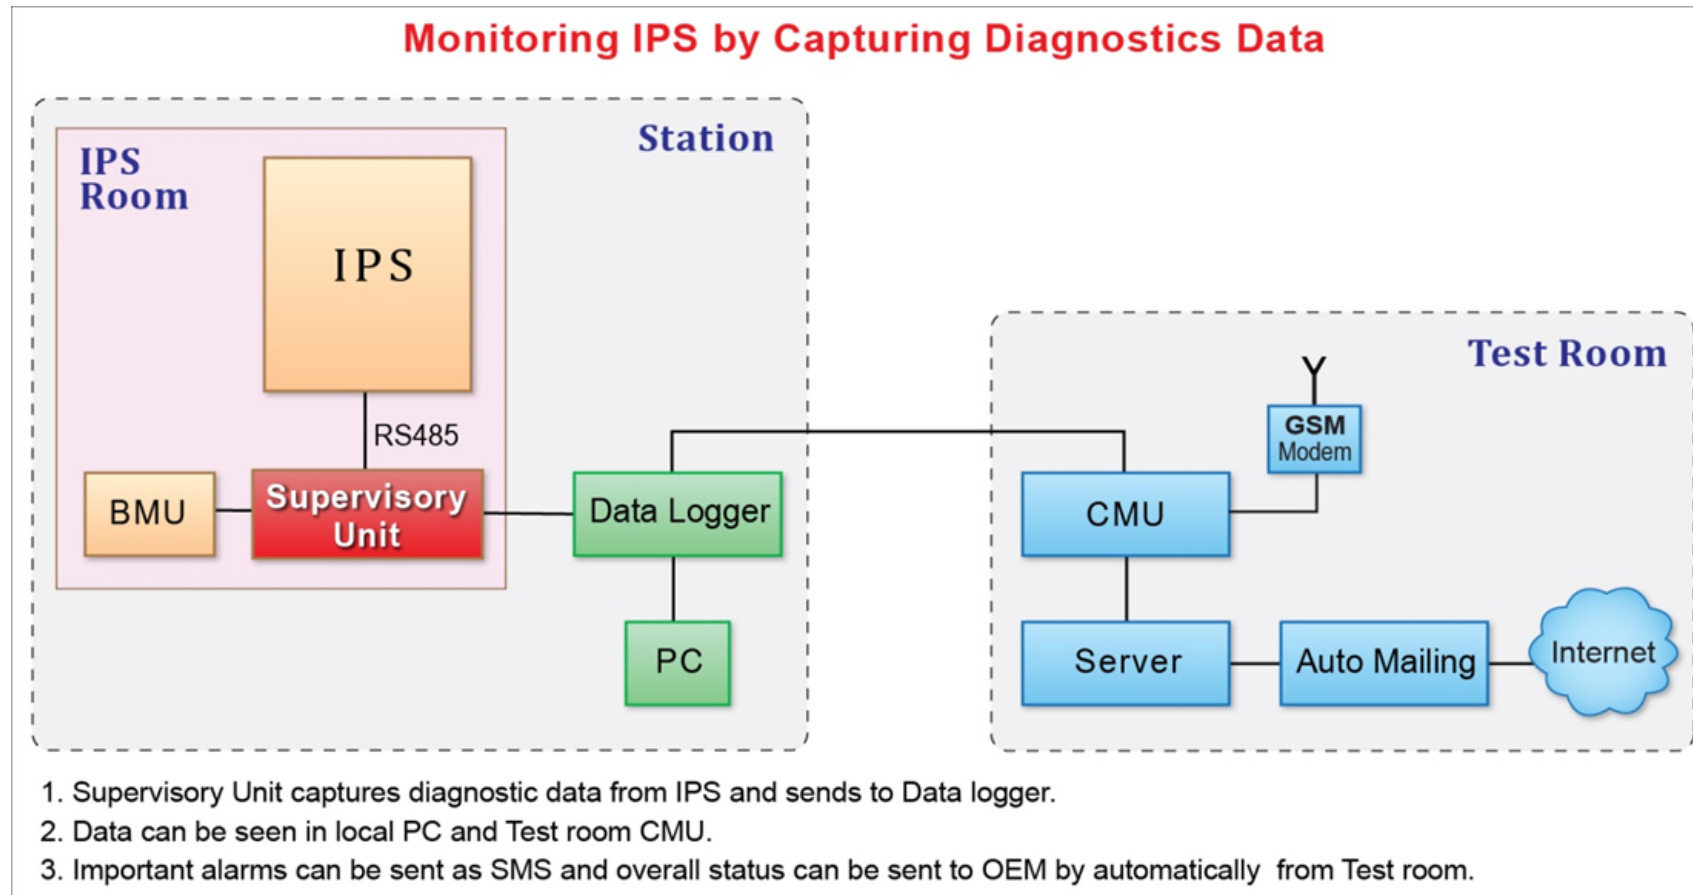

Power Flow / Data Logger / A/D		Power Supply Monitoring															
	SIGL5	DINZ	DINZM	DIBSI	PTMR A0	BHSQ	GKA	BSHA	BHB	ANVR	DNA	DINZM	DIBSI	GKH	MID	MIC	
IPUSAT	X	X	X	X						X	X	X	X	X	X	X	
KACN	X	X	X	X						X	X	X	X	X	X	X	
EMF1	X	X	X	X						X	X	X	X	X	X	X	
DC-DC Conv	X	X	X	X						X	X	X	X	X	X	X	
PVET1	X	X	X	X						X	X	X	X	X	X	X	
PVET2	X	X	X	X						X	X	X	X	X	X	X	
CAR LAY	X	X	X	X						X	X	X	X	X	X	X	
LAUTS+VCOB	X	X	X	X						X	X	X	X	X	X	X	
250k MainSupply	X	X	X	X						X	X	X	X	X	X	X	
LBN UPAT	X	X	X	X						X	X	X	X	X	X	X	
LBN DN AC	X	X	X	X						X	X	X	X	X	X	X	
LBN DC PWRD	X	X	X	X						X	X	X	X	X	X	X	
HVB DC Point	X	X	X	X						X	X	X	X	X	X	X	
14v Ext1	X	X	X	X						X	X	X	X	X	X	X	
14v Ext2	X	X	X	X						X	X	X	X	X	X	X	
14V PANELND	X	X	X	X						X	X	X	X	X	X	X	
14V ET2	X	X	X	X						X	X	X	X	X	X	X	
14V External	X	X	X	X						X	X	X	X	X	X	X	
HVB AC SBU DP	X	X	X	X						X	X	X	X	X	X	X	
HVB AC SBU DPN	X	X	X	X						X	X	X	X	X	X	X	
HVB DC EXT	X	X	X	X						X	X	X	X	X	X	X	
HVB AC WWD TP	X	X	X	X						X	X	X	X	X	X	X	

Legend:

X

 : Input Signal Available

■

 : ENG INPUT SIGNAL-NAL

■

 : AND INPUT VALUED-NORMAL

■

 : AND INPUT VALUED-HIGH OR LOW /

■

 : INPUT NOT AVAILABLE

1

Monitors Power supply of each and every station

2

SMS escalation for Failures