



DRG No. 6070D051
SHT 2 OF 4

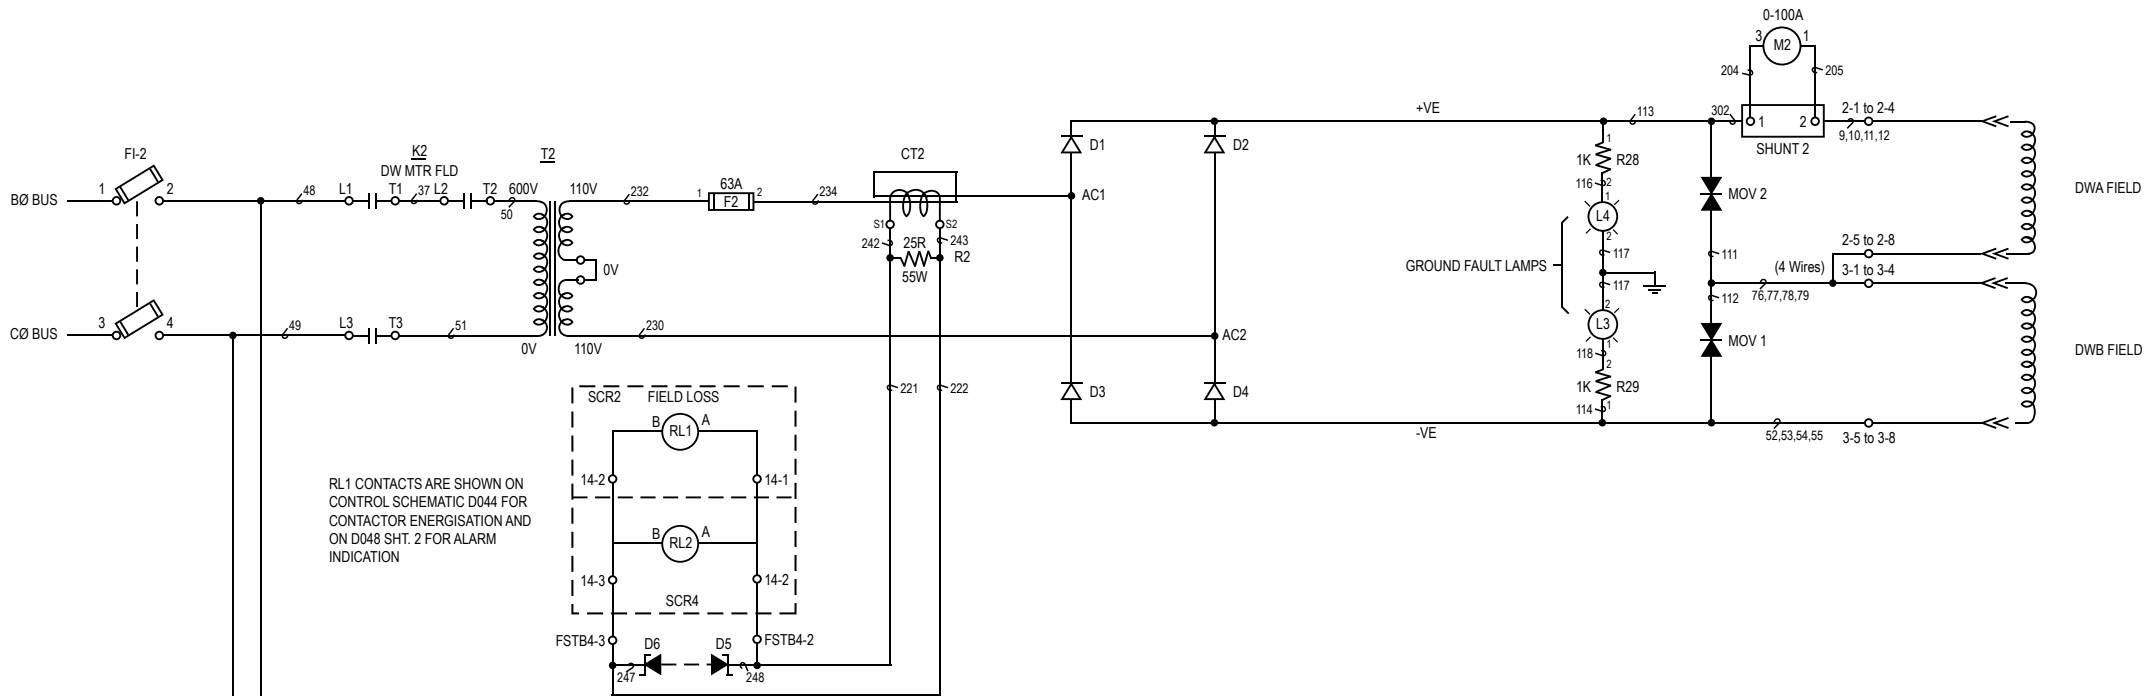


RL1 CONTACTS ARE SHOWN ON
CONTROL SCHEMATIC D044 FOR
CONTACTOR ENERGISATION AND
ON D048 SHT. 2 FOR ALARM
INDICATION

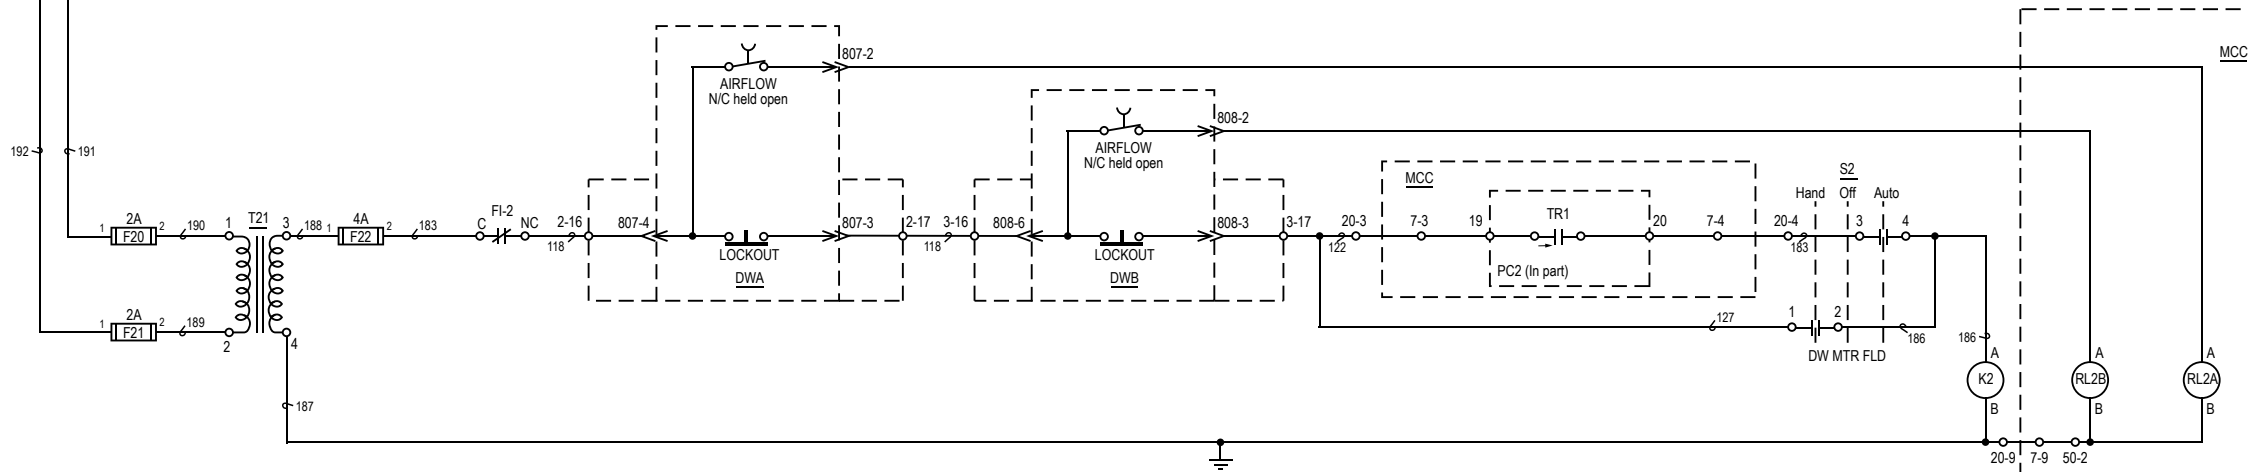

FIELD ENERGISING SEQUENCE

1. DRILLERS CONSOLE - DW SWITCH (S5) TO FORWARD OR REVERSE
2. RELAYS RL1A & RL1B ON AUXILIARY MOTOR BOARD (PC2) ARE ENERGISED, AUTO STARTING DWA & DWB BLOWERS (REF D048 SHT 2)
3. ONCE THE AIRFLOW HAS BEEN ESTABLISHED TR1 ON PC2 IS ENERGISED, 7 SECOND DELAY THUS ENERGISING FIELD

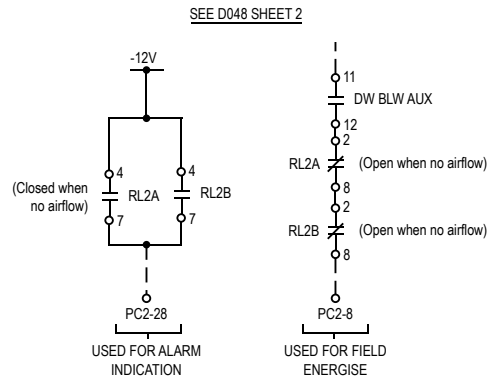

No.	DESCRIPTION	DATE	BY
1	AS COMMISSIONED	24-7-81	MSM
REVISIONS			

DRAWN A.B.	DATE 6-3-81
CHKD	
APP.	
USED ON	

THIS IS A PROPRIETARY DESIGN OF HILL GRAHAM CONTROLS LTD. REPRODUCTION OR USE OF THIS DESIGN BY OTHERS IS PERMISSIBLE ONLY IF EXPRESSLY AUTHORIZED IN WRITING BY HILL GRAHAM CONTROLS LTD.

ASSOCIATED DRAWINGS
WIRE LIST
SCHEMATIC



**HILL GRAHAM
CONTROLS LTD**
HIGH WYCOMBE, BUCKS,
ENGLAND
TEL: (01494) 440121

TITLE DRAWWORKS FIELD SUPPLY			
RIG No.	N110-9	DRG No.	6070D051
CUSTOMER	FORASOL	REV.	1
		SHT 2 OF 4	