

IDENTIFICATION LETTERS

FIRST-LETTER			SUCCEEDING-LETTERS		
	MEASURED OR INITIATING VARIABLE	MODIFIER	READOUT OR PASSIVE FUNCTION	OUTPUT FUNCTION	MODIFIER
A	ANALYSIS		ALARM		
B	BURNER, COMBUSTION, FLAME DETECTOR		BUTTON	USER'S CHOICE	USER'S CHOICE
C	CONDUCTIVE			CONTROL	CLOSE,CLOSED
D	DRAFT, DENSITY	DIFFERENTIAL,INTERFACE			
E	VOLTAGE		SENSOR (PRIMARY ELEMENT)		
F	FLOW RATE	RATIO FRACTION			
G	USER'S CHOICE		GAUGE, GLASS, VIEWING DEVICE		
H	HAND	HAND			HIGH
I	CURRENT (ELECTRICAL)		INDICATE(ANALOG)	INDICATE	
J	POWER	SCAN			
K	TIME, TIME SCHEDULE	TIME RATE OF CHANGE		CONTROL STATION	
KS	BINARY LOGIC FUNCTION				
L	LEVEL		LIGHT,STATUS		LOW
M	USER'S CHOICE		USER'S CHOICE		MIDDLE, INTERMEDIATE
MOV	MOTOR OPERATED VALVE				
N	USER'S CHOICE		USER'S CHOICE	USER'S CHOICE	USER'S CHOICE
O	USER'S CHOICE		ORIFICE RESTRICTION		OPEN
P	PRESSURE, VACUUM		POINT (TEST CONNECTION)		
Q	QUANTITY,HEAT	INTEGRATE, TOTALIZE			
R	RADIATION		RECORD		
S	SPEED, FREQUENCY			SWITCH	
T	TEMPERATURE			TRANSMIT	
U	MULTIVARIABLE		MULTIFUNCTION	MULTIFUNCTION	MULTIFUNCTION
V	VIBRATION, MECHANICAL ANALYSIS			VALVE, DAMPER, LOUVER	
W	WEIGHT, FORCE		WELL		
X	ON-OFF, UNCLASSIFIED	X AXIS	UNCLASSIFIED	UNCLASSIFIED	UNCLASSIFIED
Y	UNCLASSIFIED	Y AXIS		RELAY, COMPUTE, CONVERT,SOLENOID VALVE	
Z	POSITION	Z AXIS,POSITION		DRIVER,ACTUATOR, UNCLASSIFIED FINAL ELEMENT	

SWITCH & ALARM FUNCTIONS

H - HIGH
L - LOW
HH - HIGH-HIGH
LL - LOW-LOW
HL - HIGH-LOW


MODIFIERS

D - DIFFERENTIAL
F - RATIO
I - INDICATION (NON-DCS)
J - SCAN (NON-DCS)
Q - INTEGRATE OR TOTALIZE (NON-DCS) OR QISS SYSTEM
R - RECORDING (NON-DCS)


SPECIAL IDENTIFICATIONS

DG - DRAFT GAUGE
FO - FLOW ORIFICE (RESTRICTION ORIFICE)
HS - SWITCH
PB - PUSH BUTTON
PG - PRESSURE GAUGE (LOCAL)
PP - PRESSURE SENSING POINT
PSE - RUPTURE DISK
PSV - PRESSURE OR VACUUM SAFETY RELIEF VALVE
PVSV - PRESSURE-VACUUM SAFETY RELIEF VALVE
FG - SIGHT GLASS
TG - TEMPERATURE GAUGE (LOCAL)
TJI - MULTIPOINT TEMPERATURE INDICATOR (NON DCS)
TJR - MULTIPOINT TEMPERATURE RECORDER (NON DCS)
TW - TEMPERATURE WELL
XE - FLAME ARRESTER


TYPICAL TAG NUMBER FORMAT

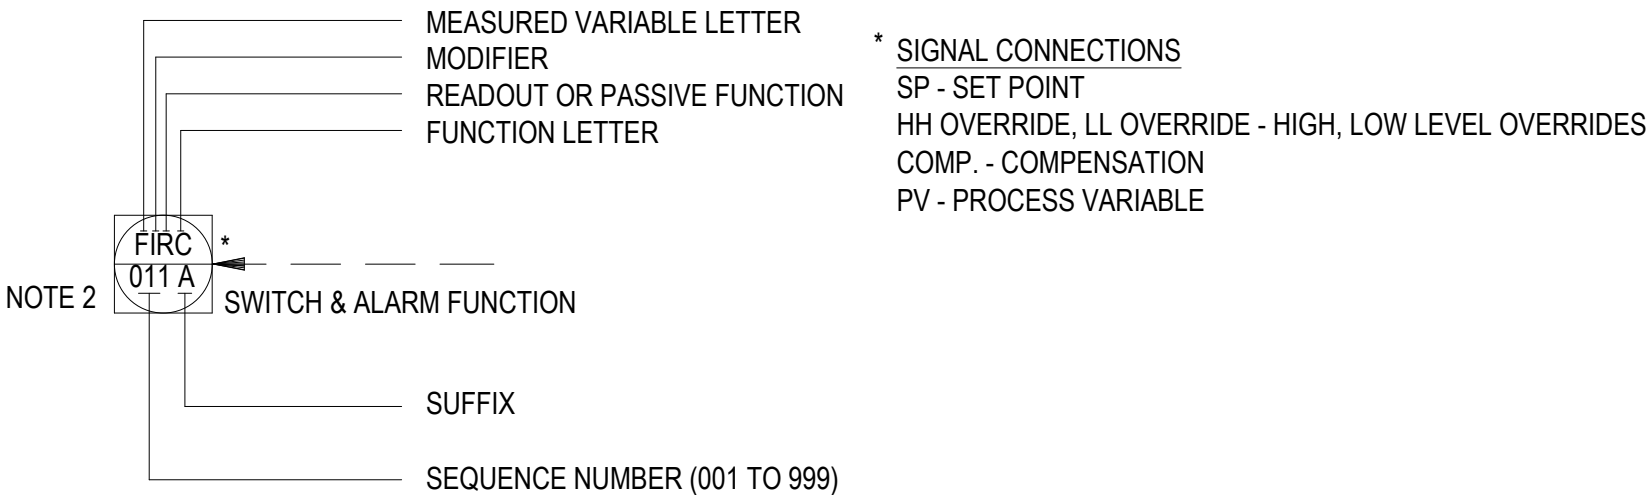


INSTRUMENT LINE DESIGNATIONS

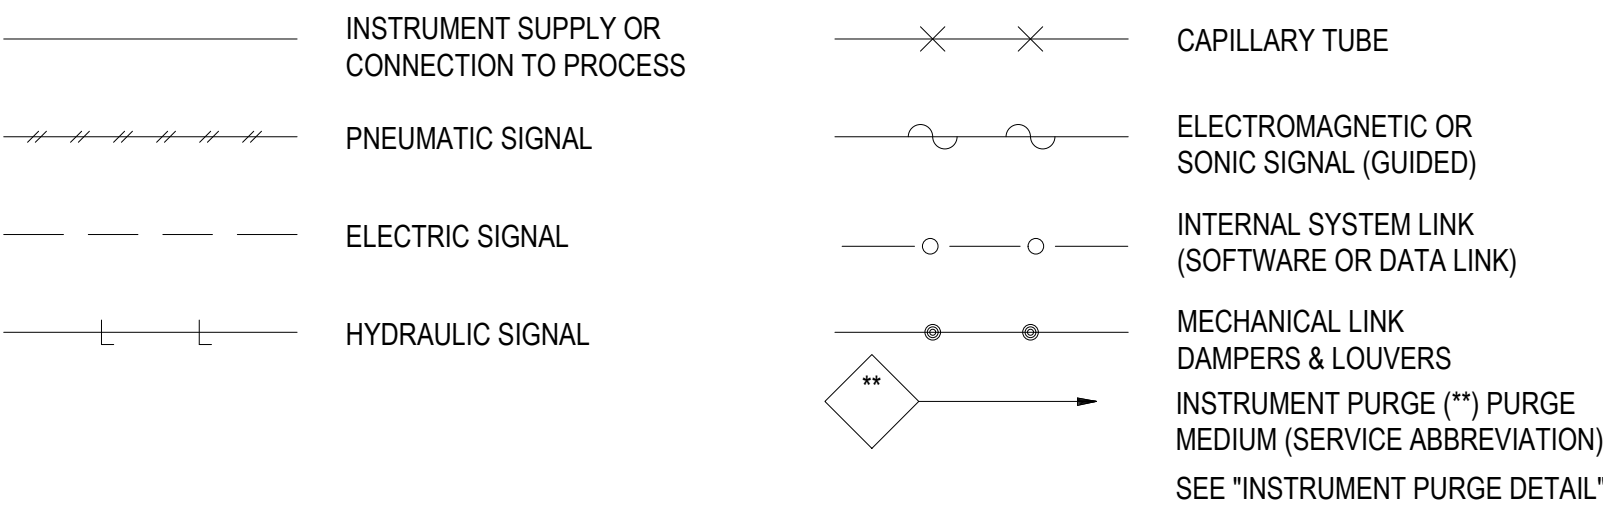


INSTRUMENT SYMBOL & REPRESENTATION

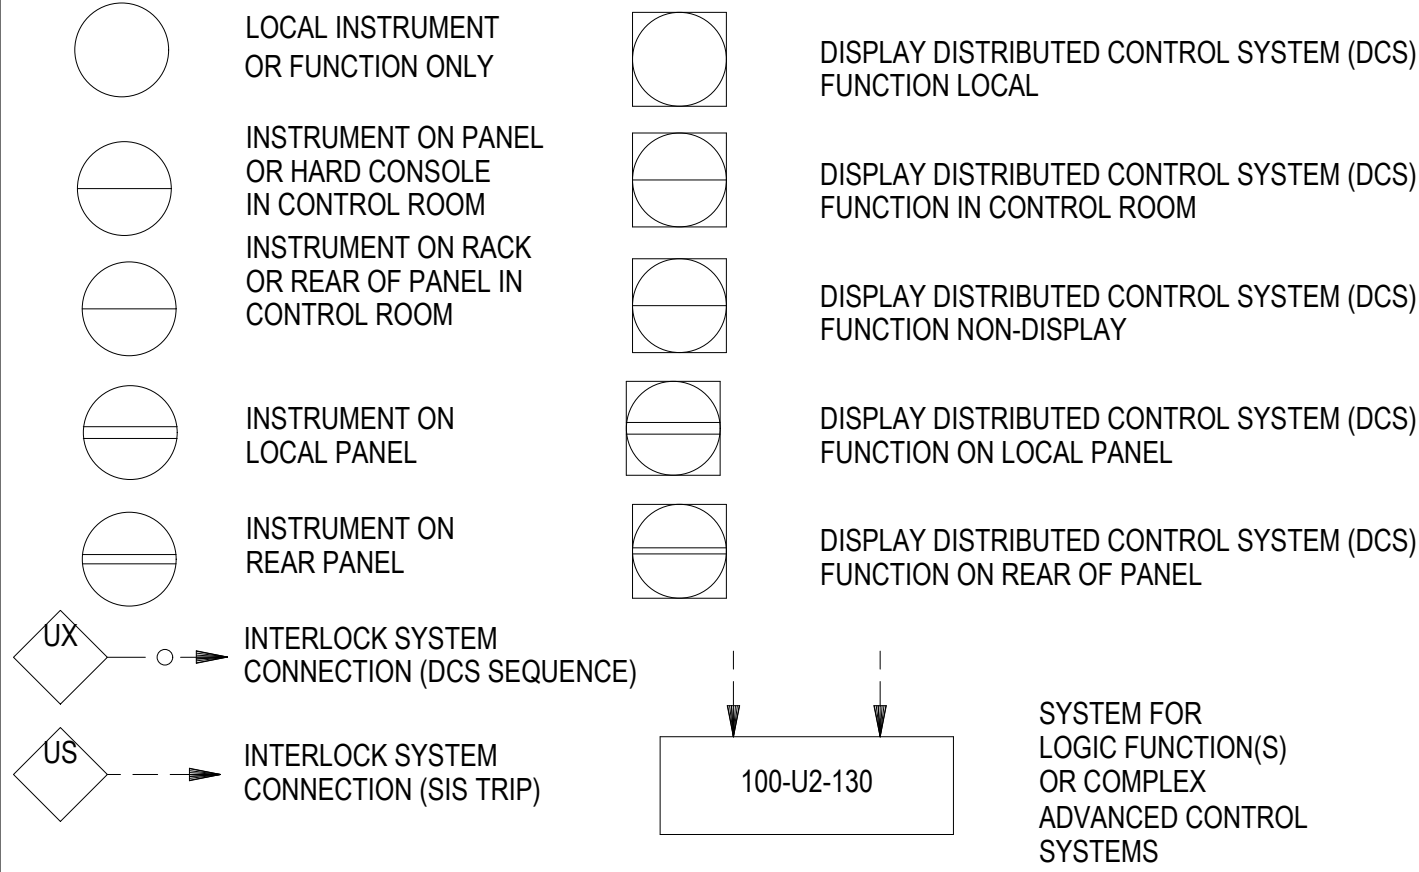


COMPUTER FUNCTION AND LOGIC SYSTEMS

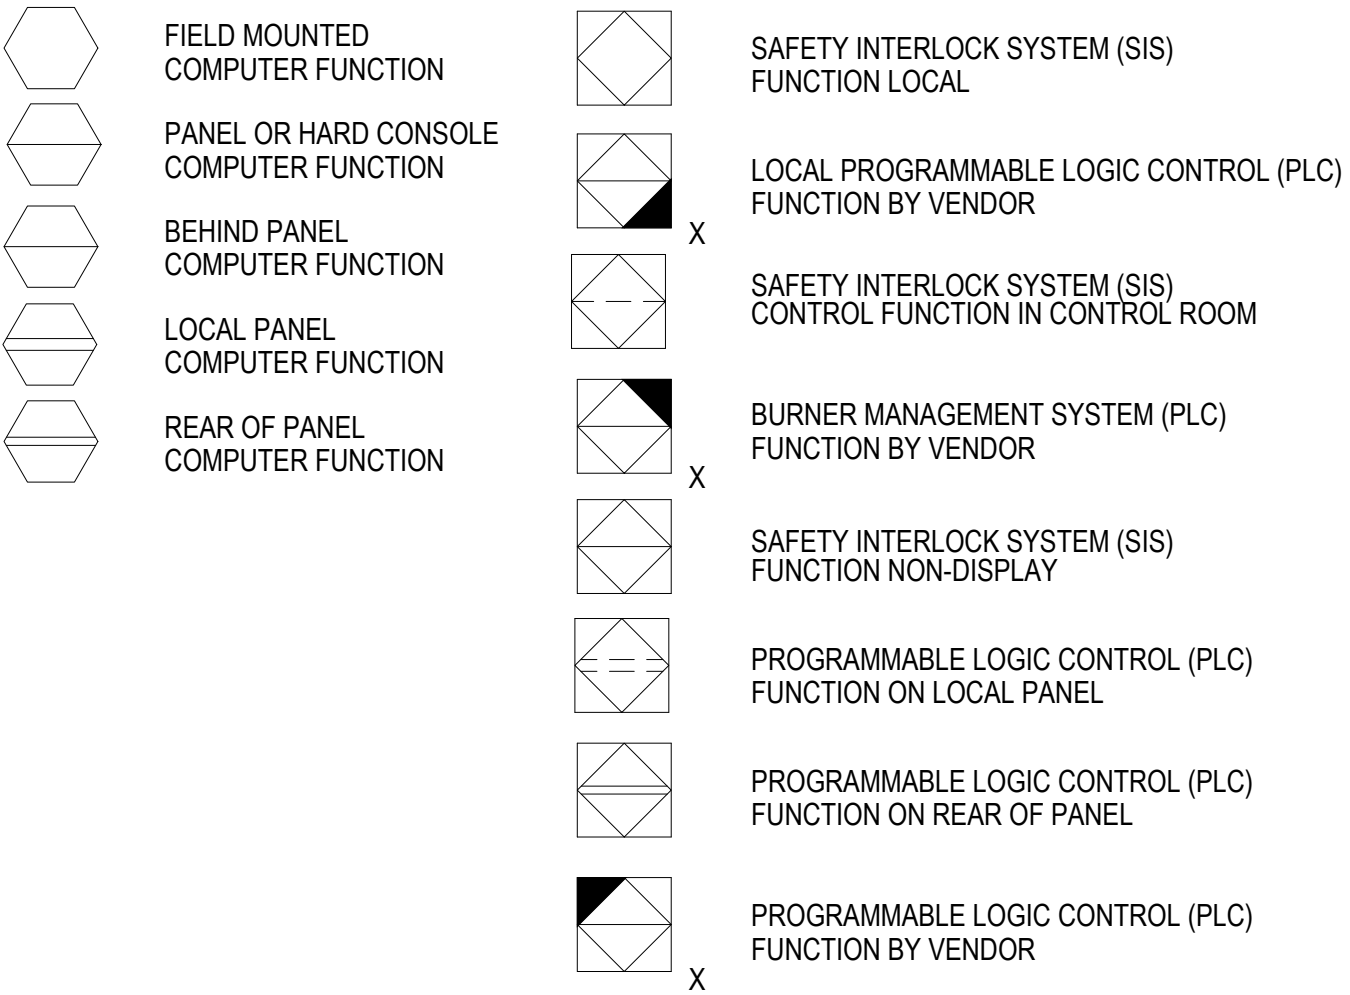


CONVERTERS

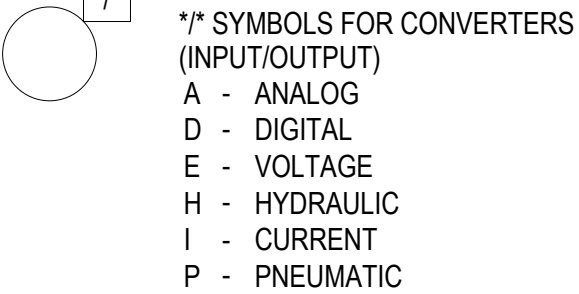


DCS SUB-FUNCTIONS

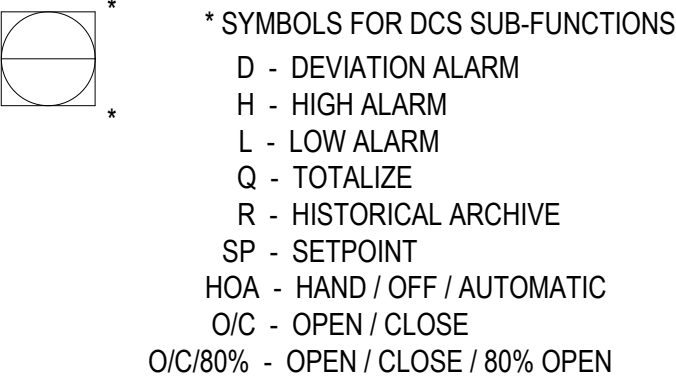


COMPUTER FUNCTIONS

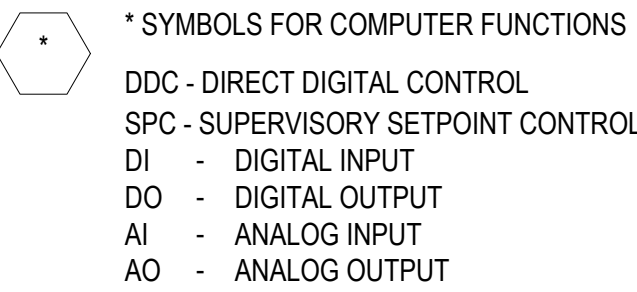


MATH FUNCTIONS

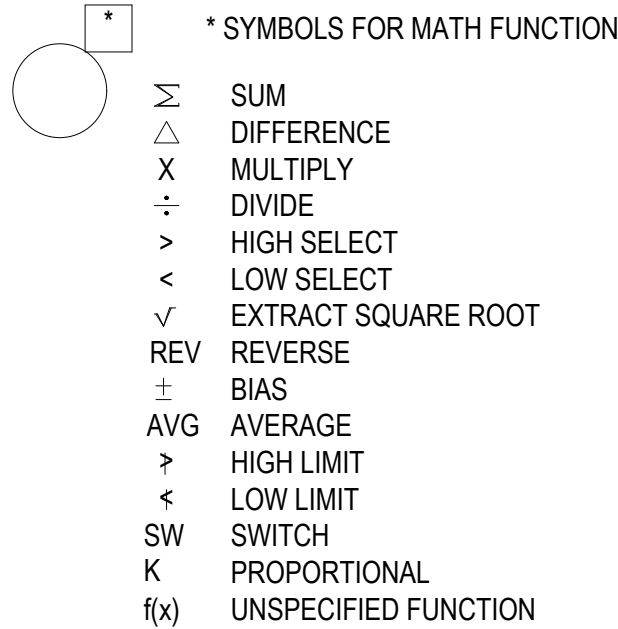


INSTRUMENT PURGE DETAIL

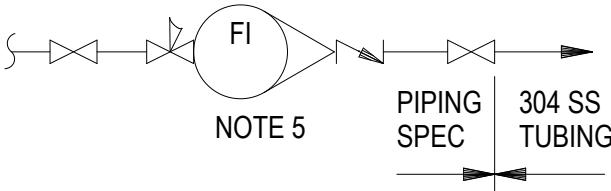


CONTROL VALVE TYPE

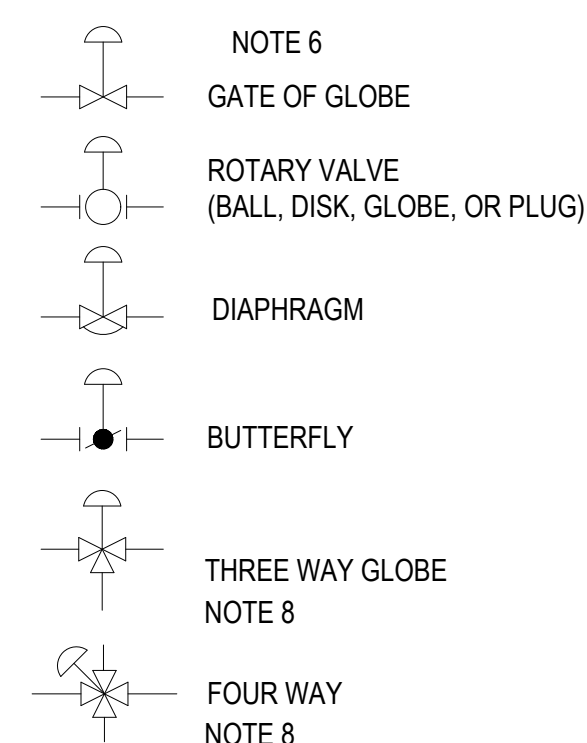


CONTROL ACTUATORS

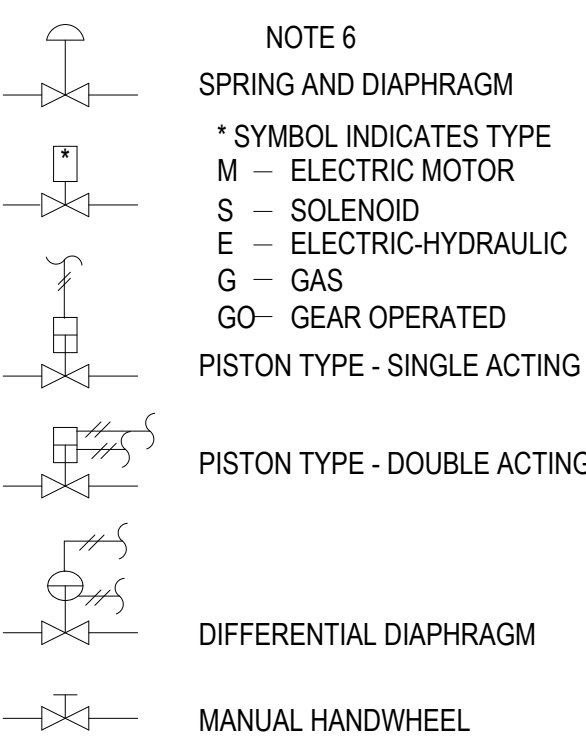


MANUAL OPERATORS

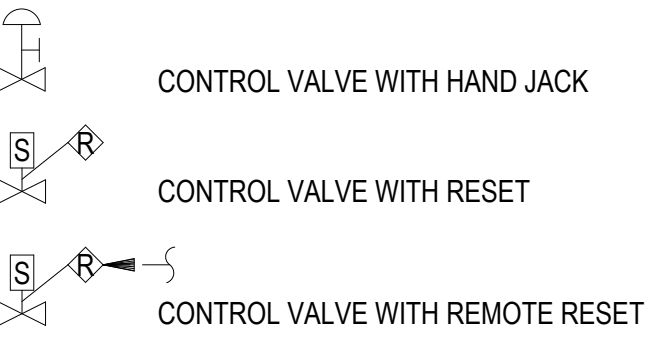

ADDITIONAL INFORMATION

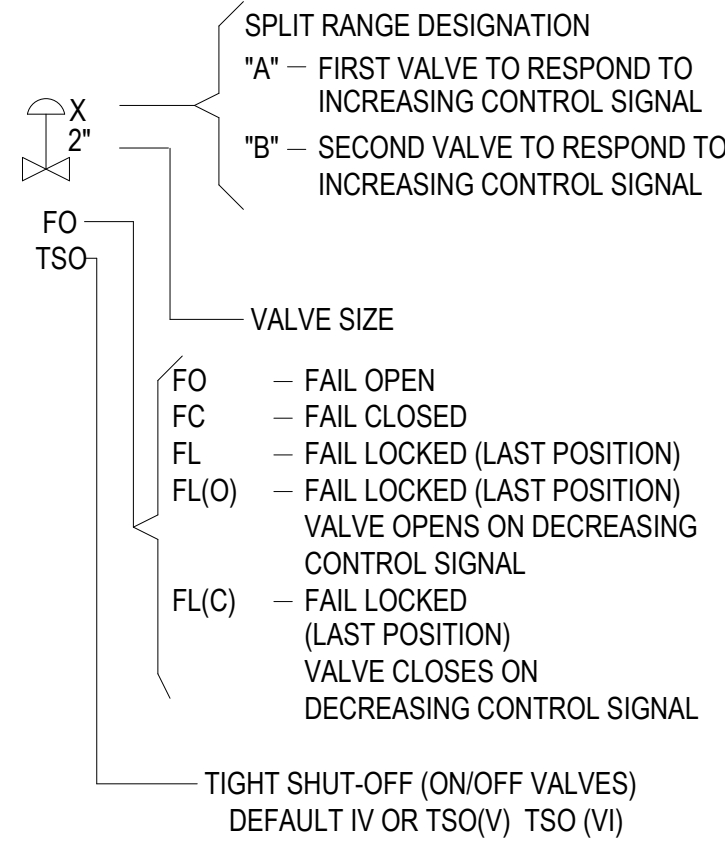


INLINE FLOW INSTRUMENTS

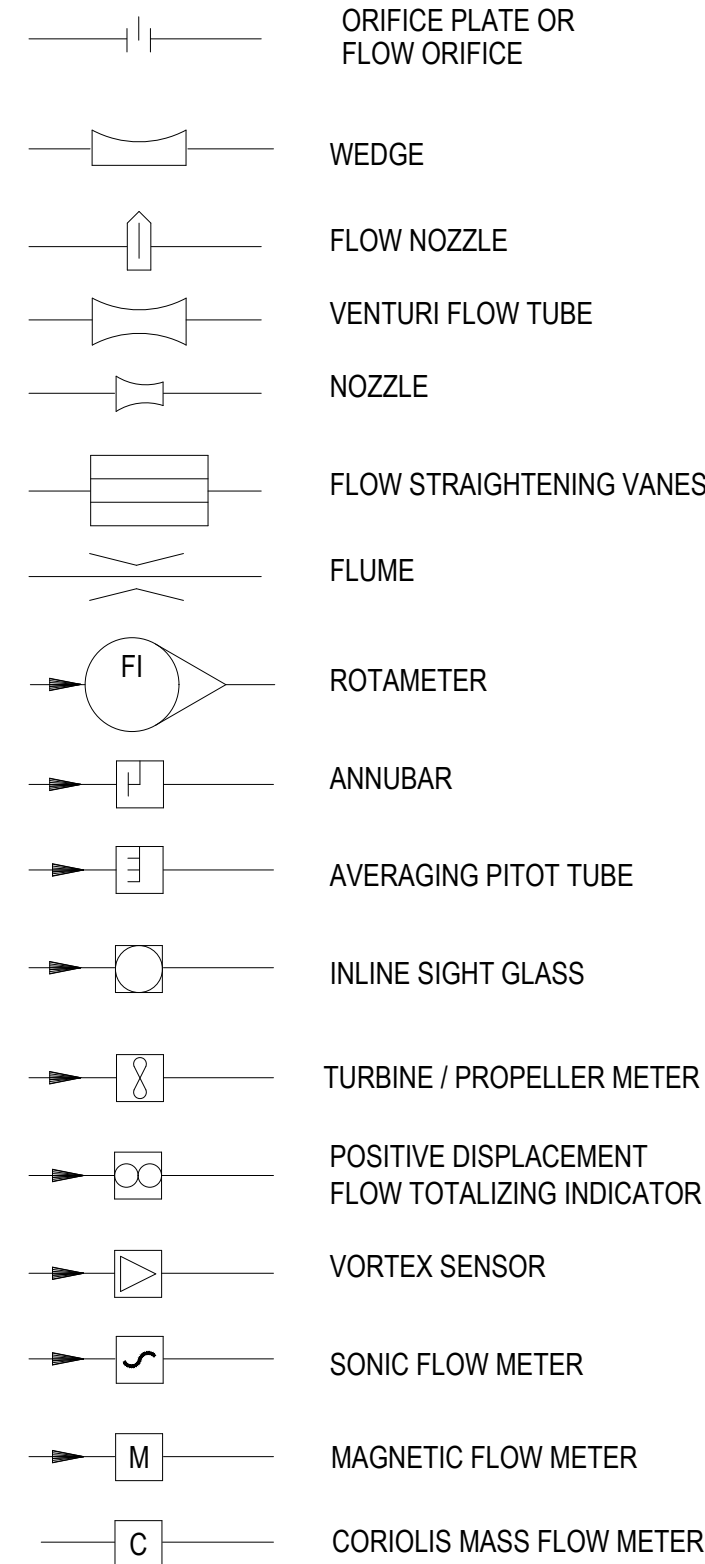


IN LINE INSTRUMENTS



SELF ACTUATED DEVICES

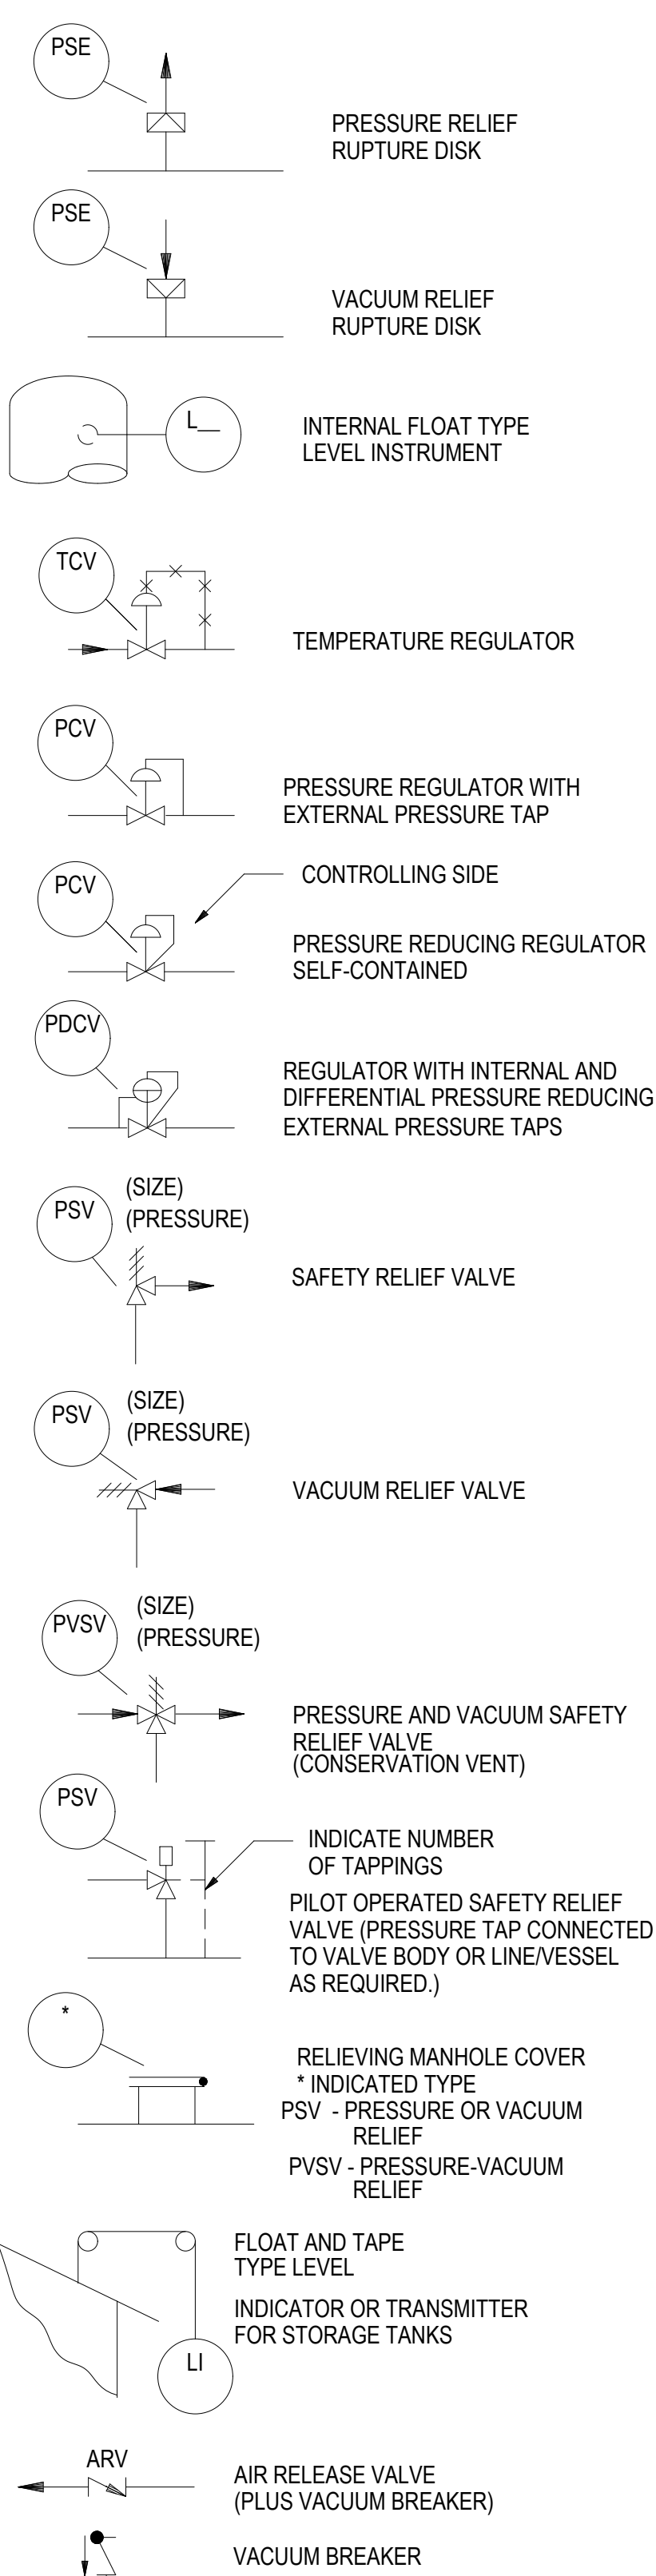

MISCELLANEOUS

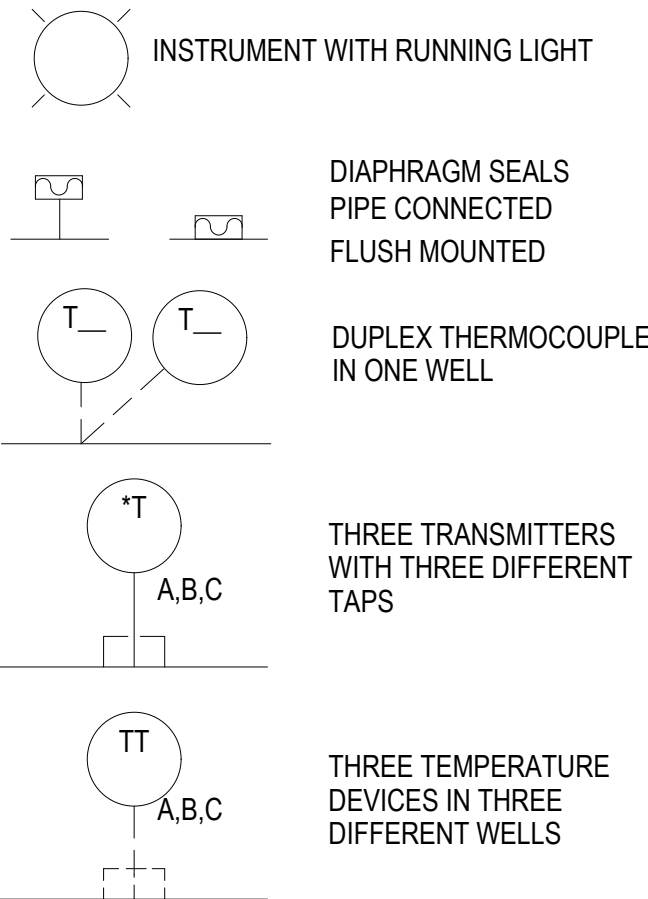

NOTES

- FOR LEGENDS, SYMBOLS, GENERAL NOTES AND ENGINEERING DESIGN NOTES SEE DWG. No. A1-191754-00005A, 00005B, 00005C AND 00005D.
- ALL INSTRUMENT TAG NUMBERS WILL BE PRECEDED BY 4-DIGIT UNIT NUMBER UNLESS OTHERWISE SPECIFIED.
- ALL DIMENSIONS ARE IN mm, WHILE ALL NOZZLE SIZES, LINE SIZES ARE IN inch, UNLESS OTHERWISE SPECIFIED.
- THE INSTRUMENTATION REPRESENTATION ON P&ID'S ARE AS PER ABBREVIATED IS A SYMBOLOGY. COMPLEX OR UNUSUAL LOOPS ARE DEPICTED WITH INDIVIDUAL COMPONENT BALLOONS AS REQUIRED FOR CLARITY.
- NEEDLE VALVE AND CHECK VALVE CAN BE PURCHASED AS AN INTEGRAL PART OF THE ROTAMETER.
- ACTUATORS ARE TYPICALLY SHOWN AS DIAPHRAGMS WHEN NOT YET DETERMINED.
- INSTRUMENT WITH (X) SUFFIX, DEPICTS SUPPLIED BY VENDOR OF AN AN EQUIPMENT PACKAGE.
- INDICATE DIRECTION OF FLOW ON AIR FAILURE.
- MOV'S PROVIDED WITH LOCAL OPEN /CLOSE PUSH BUTTONS UNLESS OTHERWISE NOTED.

MISCELLANEOUS ABBREVIATIONS

APC - ADVANCED PROCESS CONTROL
ARC - AUTO RECIRCULATION VALVE
CCS - COMPRESSOR CONTROL SYSTEM
DCS - DISTRIBUTED CONTROL SYSTEM
DISP - DISPLACER
DP - DIFFERENTIAL PRESSURE
EO - ENERGIZED OPEN
GOV - GEAR OPERATED VALVE
INT - INTERFACE
PLC - PROGRAMMABLE LOGIC CONTROLLER
RTD - RESISTANCE TEMPERATURE DETECTOR
SER - SEQUENTIAL EVENT RECORDER
2.o.o.3 - 2 OUT OF 3
SIS - SAFETY INSTRUMENTED SYSTEM