

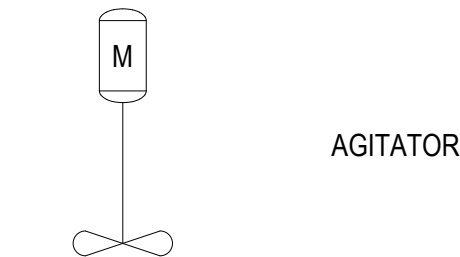
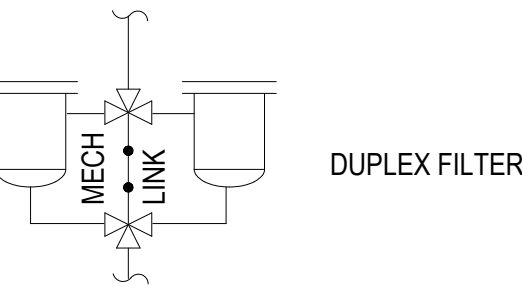



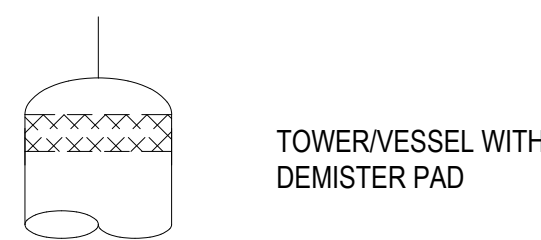
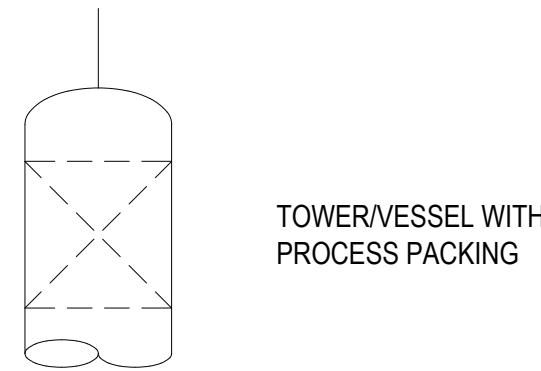
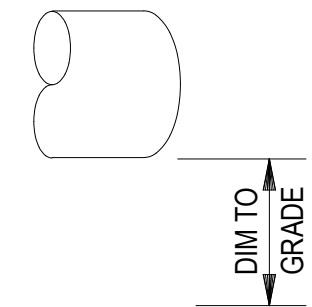
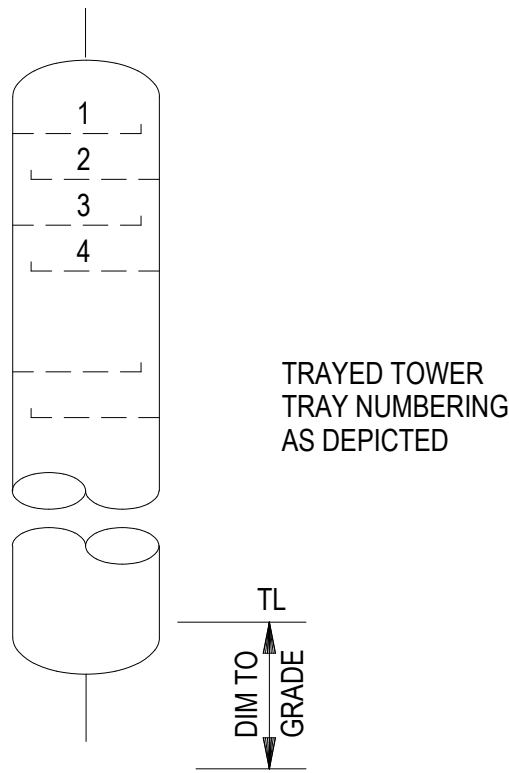
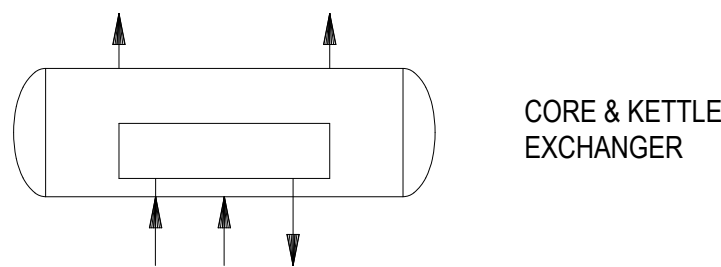
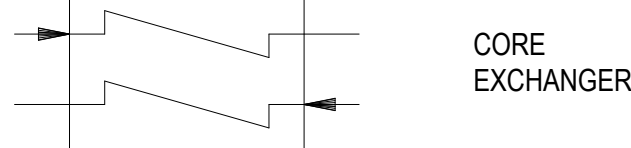
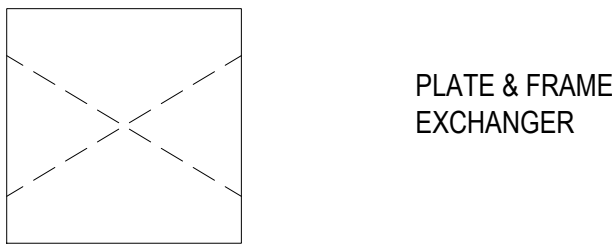
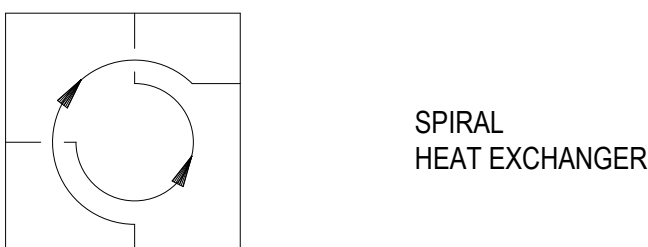
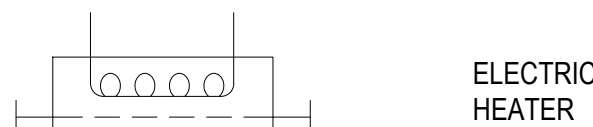
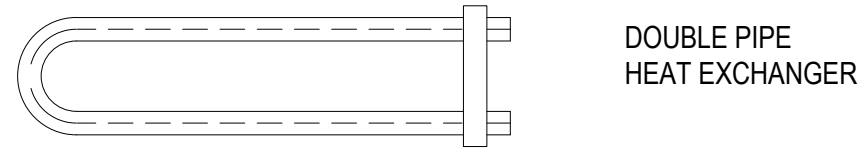
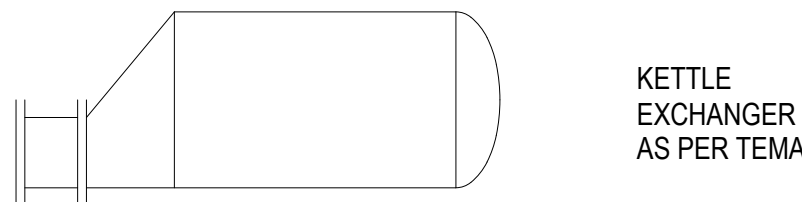
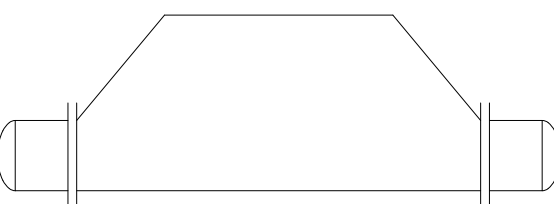
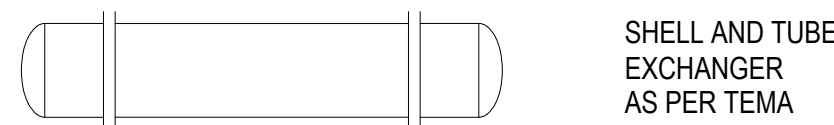
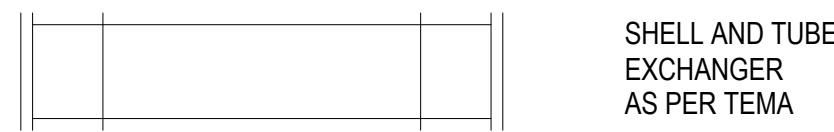
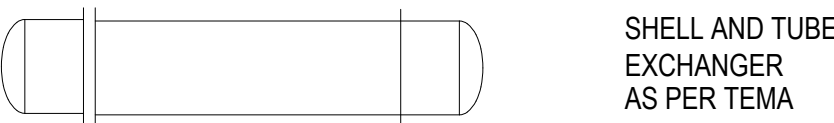
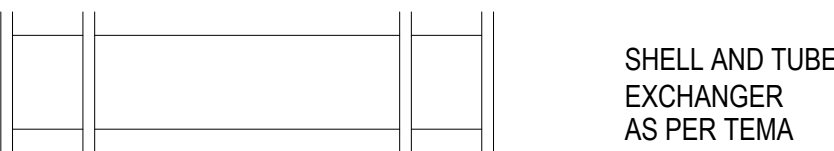
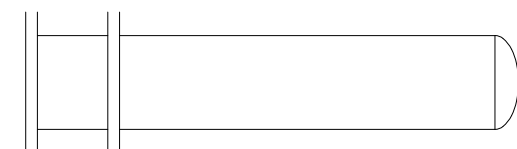
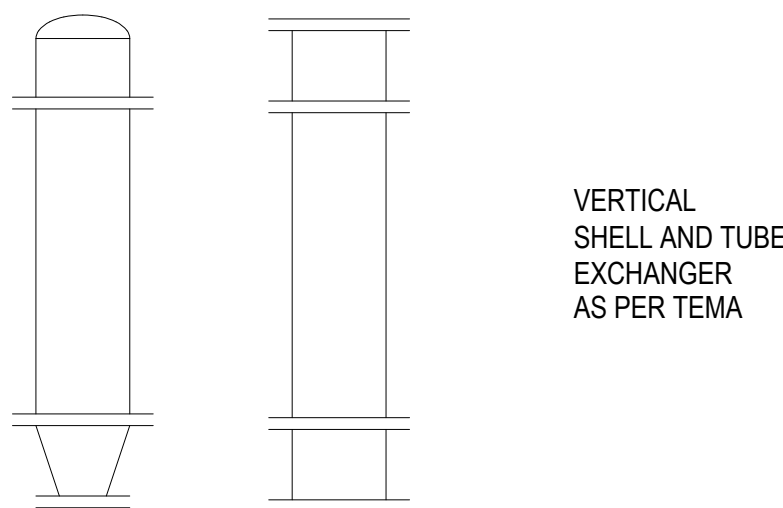
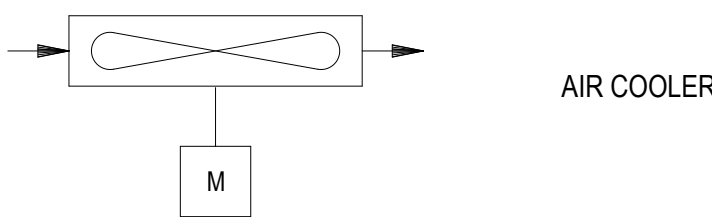










VESSELS

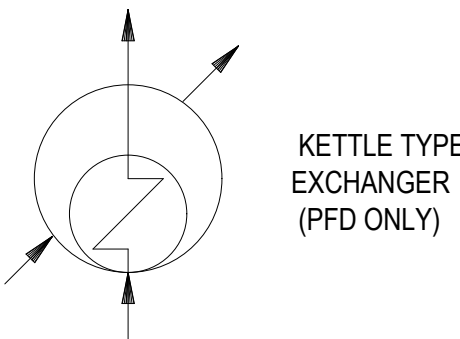




HEAT EXCHANGERS

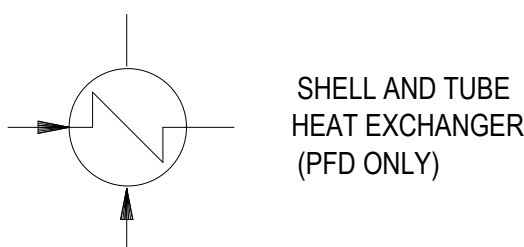




PUMPS

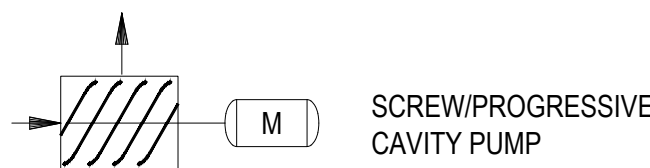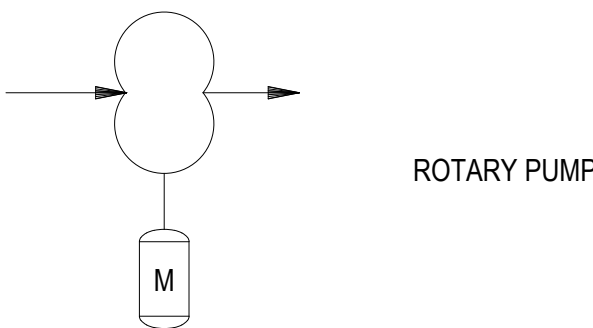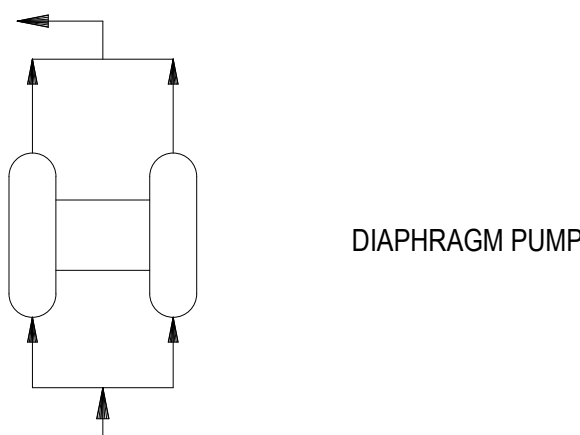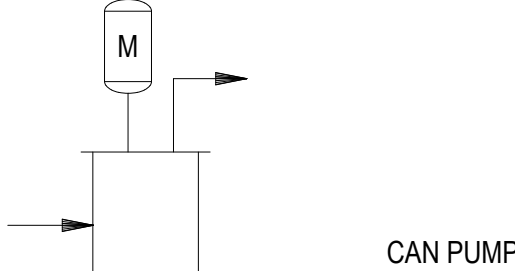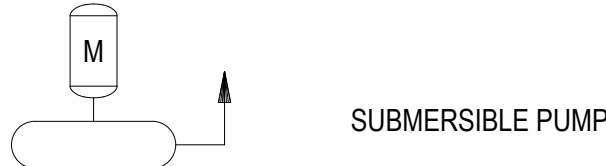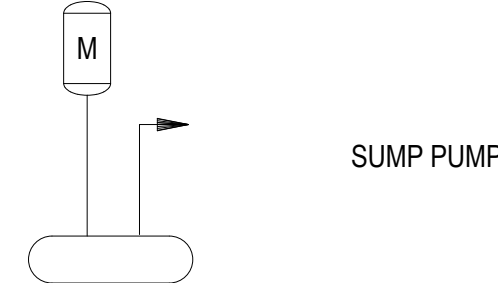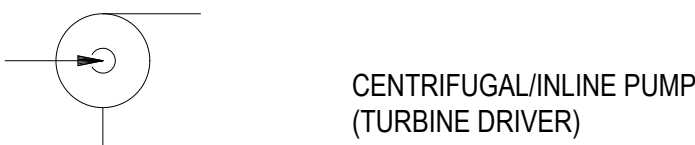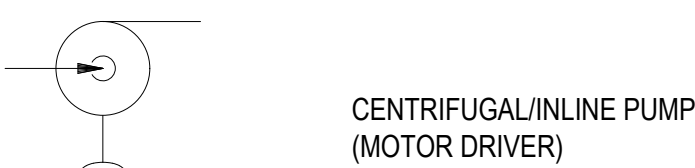



DRIVERS

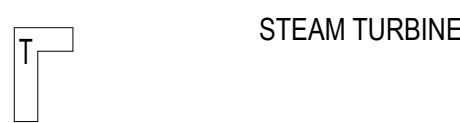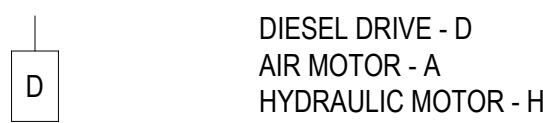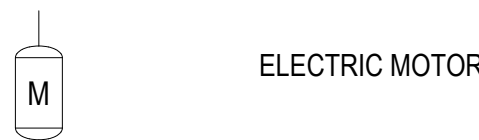

COMPRESSORS

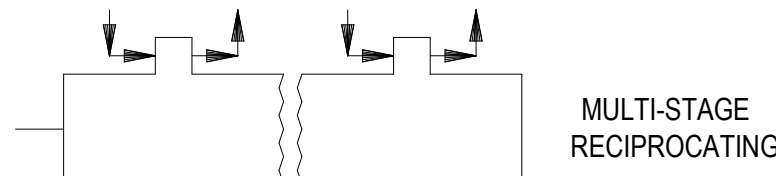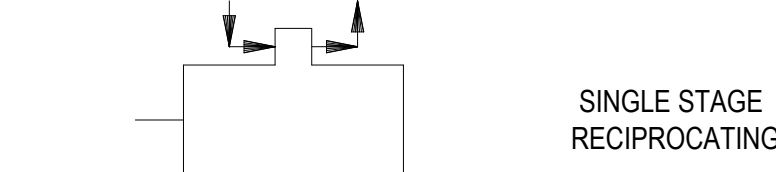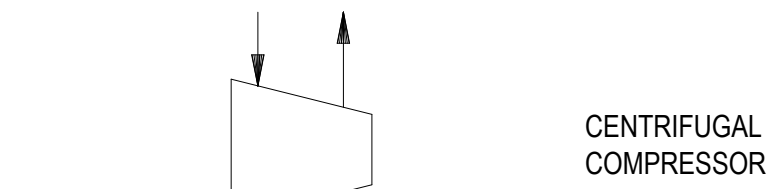

FURNACE

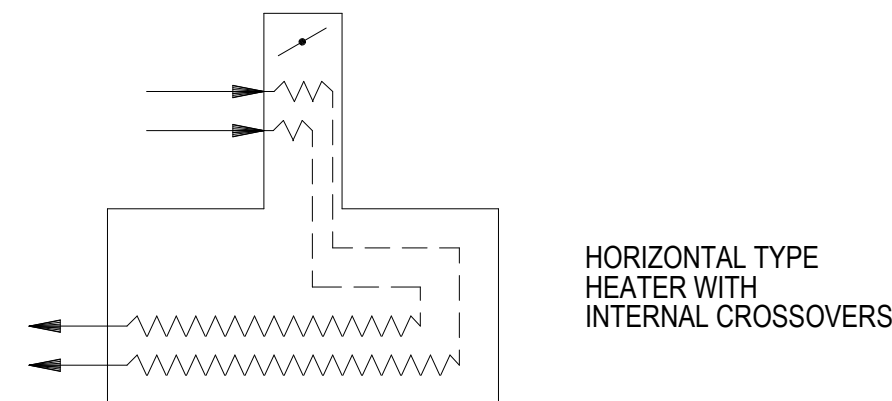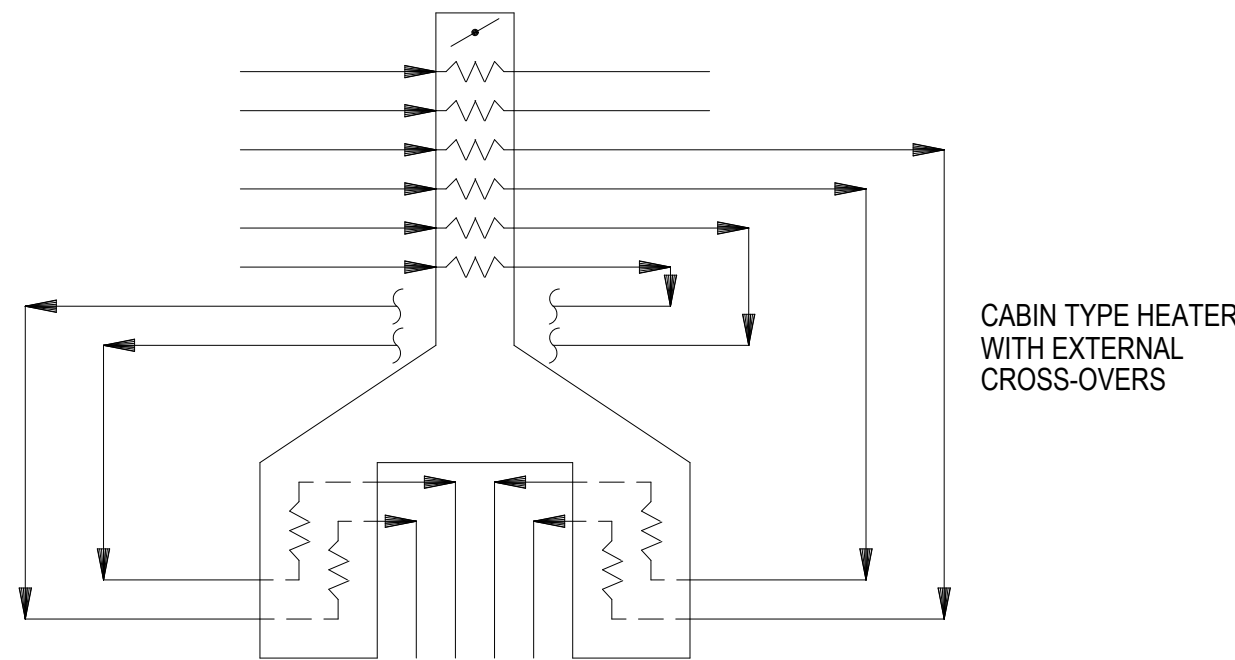

EQUIPMENT CODE

EQUIPMENT CLASSIFICATION	CODE
AGITATOR	A
AIR COOLER	AE
BURNER	B
COMPRESSOR, BLOWER, FAN, VACCUM PUMP	C
TURBINE FOR COMPRESSOR	CT
DRUM, VESSEL, SEPERATOR, DEAERATOR, COALESCER	D
DRYER, TREATER	DR
HEAT EXCHANGER, COLD BOX EXCHANGER	E
ELECTRIC HEATER	EH
FILTER, STRAINER	F
FIRED HEATER	FH
HEATER	H
EJECTOR	J
ELECTRIC MOTOR	M
MIXER	MX
PUMP	P
TURBINE FOR PUMP	PT
PACKAGE UNIT	PU
REACTOR	R
TOWERS	T
TANK	TK

NOTES:

- FOR LEGENDS, SYMBOLS, GENERAL NOTES AND ENGINEERING DESIGN NOTES SEE DWG. No. A1-191754-00005A, 00005B, 00005C AND 00005D.
- ALL INSTRUMENT TAG NUMBERS WILL BE PRECEDED BY 4-DIGIT UNIT NUMBER UNLESS OTHERWISE SPECIFIED.
- ALL DIMENSIONS ARE IN mm, WHILE ALL NOZZLE SIZES, LINE SIZES ARE IN inch, UNLESS OTHERWISE SPECIFIED.

GENERAL NOTES:

- P&ID's ARE DIAGRAMMATIC ONLY. ROUTING OF PIPELINE MUST BE INVESTIGATED FOR VENTING OF HIGH POINTS OF PIPING AND DRAINING OF LOW POINTS OF PIPING AND EQUIPMENT. THESE POINTS ARE NOT SHOWN ON P&ID's.
- VESSEL INTERNALS, HEADERS AND MANIFOLDS ARE SHOWN TO THE EXTENT REQUIRED FOR CLARITY.
- TOWER, VESSEL, DRUM ELEVATION BASED ON PRELIMINARY REBOILER AND NPSH CALCULATION. TO BE CONFIRMED DURING DETAIL DESIGN.
- 9mm WEEP HOLES SHALL BE PROVIDED IN LOW POINTS OF RELIEF VALVES DISCHARGES VENTED TO ATMOSPHERE AT SAFE LOCATION.
- PUMP SEAL FLUSHING AND COOLING DETAILS TO BE PROVIDED BY DETAIL ENGINEERING CONTRACTOR. FOR SPECIAL REQUIREMENTS SEE PUMP DATA SHEETS OR SCHEDULES.
- PUMPS PROVIDED WITH LOCAL START / STOP SWITCHES UNLESS NOTED OTHERWISE.
- DRAIN, VENT AND CHECK VALVE BYPASS VALVES SHALL BE 3/4" SIZE UNLESS NOTED OTHERWISE.