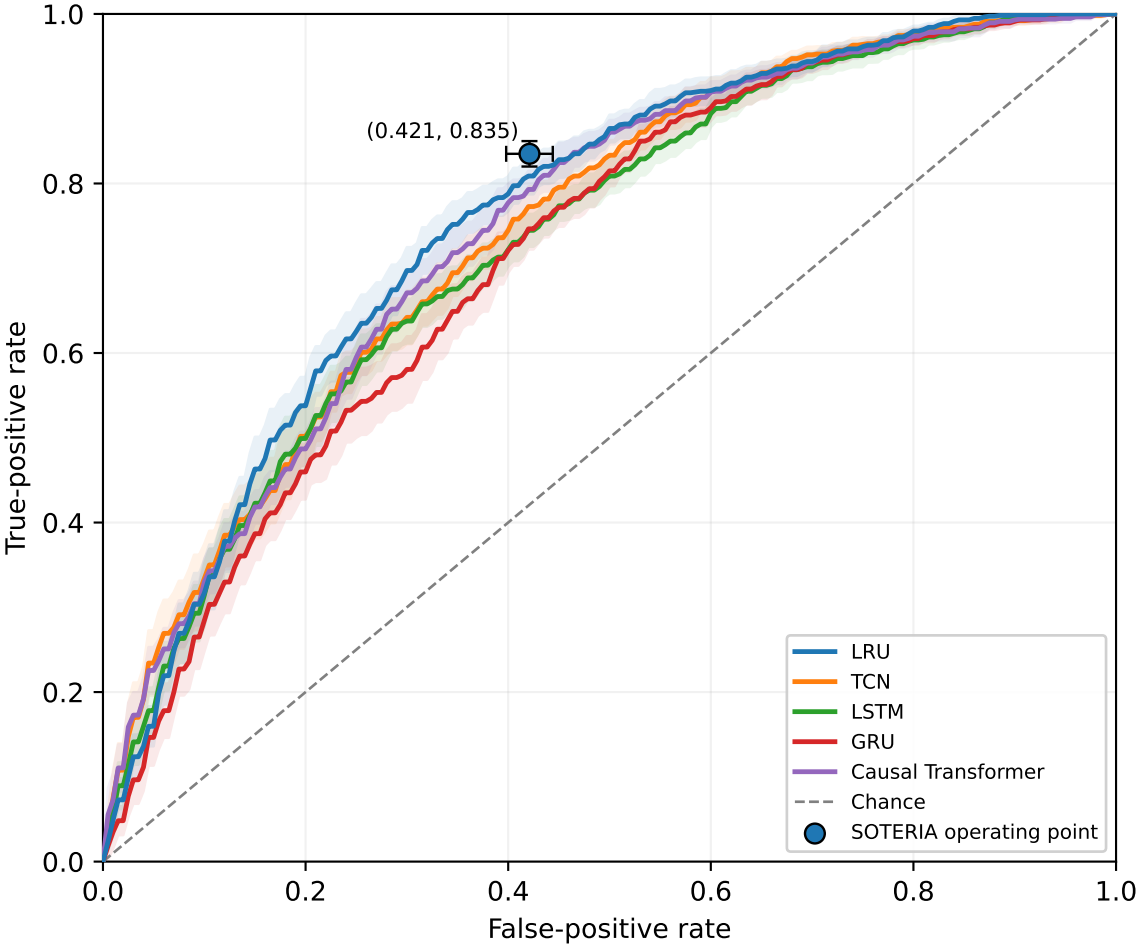
(0.421, 0.835)
True-positive rate
False-positive rate
0.0
0.2
0.4
0.6
0.8
1.0
LRU
TCN
LSTM
GRU
Causal Transformer
Chance
SOTERIA operating point