THIS DOCUMENT CONTAINS PROPRIETARY INFORMATION WITH ALL RIGHTS AND TITLES RESERVED AND MAY NOT BE REPRODUCED IN WHOLE OR PART WITHOUT WRITTEN CONSENT OF CCI.

PARTS LIST

NO	NAME	MATERIAL	QTY	REMARKS
1	BODY	A216 WCB	1	840G Ⓐ
2	BONNET	A216 WCB	1	
3	SEAT	SS 410 + HT	1	
4	SPINDLE	SS 410 + HT	1	
5	N/R	–	–	
6	CAGE	SS 410 + HT	1	
7	N/R	–	–	
8	N/R	–	–	
9	GASKET	304+GRAPHITE	1	
10	GASKET	304+GRAPHITE	1	
11	BONNET STUD	A193–B7	4	
12	HEX, NUT	A194–2H	4	
13	WASHER	SS 304	4	
14	PACKING GLAND	SS 300 SERIES	1	
15	PACKING SET Ⓐ	DOUBLE V–PTFE	2 SET	
16	PACKING SPACER	SS 300 SERIES	2	
17	YOKE	ASTM A216–WCB	1	
18	ACTUATOR	–	1	CCI/MSD–III, 250 DA Ⓐ
19	TUBING	SS 300 SERIES	N/R	
20	FITTING	SS 300 SERIES	N/R	
21	FILTER REGULATOR	–	1	67CF–1663–38550 Ⓑ
22	SOLENOID VALVE	WESTLOCK	1	7304SBY1M2HEK00I5V30–01493 Ⓐ
23	LIMIT SWITCH	WESTLOCK	1	7304SBY1M2HEK00I5V30–01493 Ⓐ
24	BALL VALVE Ⓑ	CCI STANDARD	1	–


ENGINEERING DATA

MAIN ELEMENT	
PRESS. CLASS	300 ASME
DESIGN PRESS..	600 psig(41.37 barg)
DESIGN TEMPERATURE	255°F
HYDROSTATIC SHELL TEST PRESSURE	1112 psig(76.7 barg)
MAX. Cv AT 100% STROKE	0.6
MAX. SEAT LEAKAGE	0.1 ml/min @667.17psig(46barg)/MSS–SP–61
BONNET FLANGE NUT TORQUE	107–118 N.m (79–87 lbf–ft)


OPERATOR	
TYPE	PNEUMATIC DIAPHRAGM
SUPPLY	80–120 psig (5.5–8.3 barg)
SIGNAL	N/A
INCREASING SIGNAL	N/A
FAILURE POSITION / MECHANISM	TO OPEN THE VALVE
NOMINAL STROKE	0.787 INCH±0.157 INCH
STROKE TIME (SEC)	5–10 Sec OPEN & CLOSE
VALVE AND OPERATOR WEIGHT (APPROX.)	143 lbs (65 Kg)

NOTES:


1. VALVE ORIENTATION TO BE STEM VERTICAL WITH ACTUATOR UP.
2. ALL DIMENSIONS WITHOUT STATED TOLERANCES ARE FOR REFERENCE ONLY.
3. ALL DIMENSIONS ARE IN INCHES, UNLESS OTHERWISE SPECIFIED.
4. STANDARD CCI TAGGING ONLY.

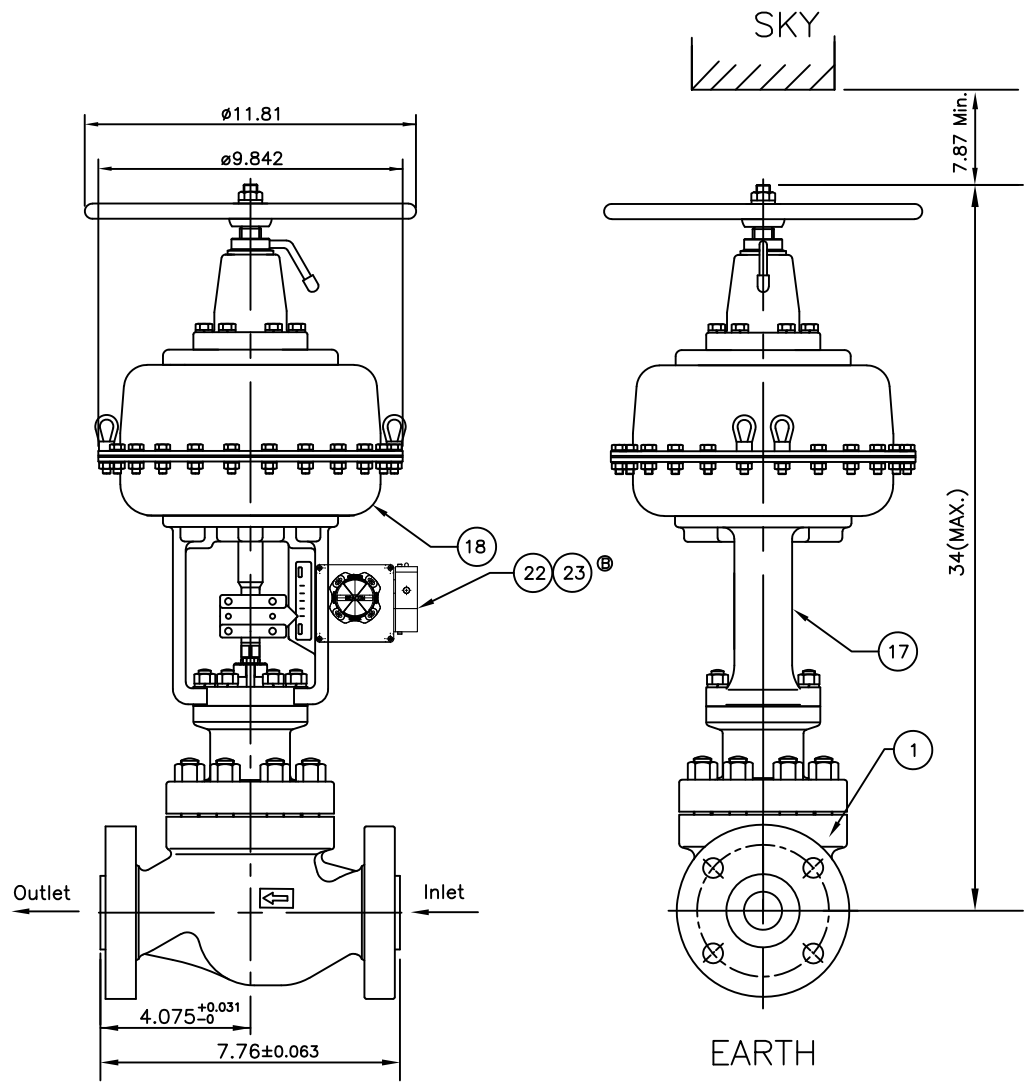

ACAD Generated Dwg.	REV.NO	DESCRIPTIONS	DATE	APPROVED
	0	FIRST ISSUE	14–Dec–17	VS
	A	UPDATED CUSTOMER COMMENTS	30–Jan–18	VS
	B	AS–BUILT DRAWING SUBMITTAL	01–Aug–18	VS

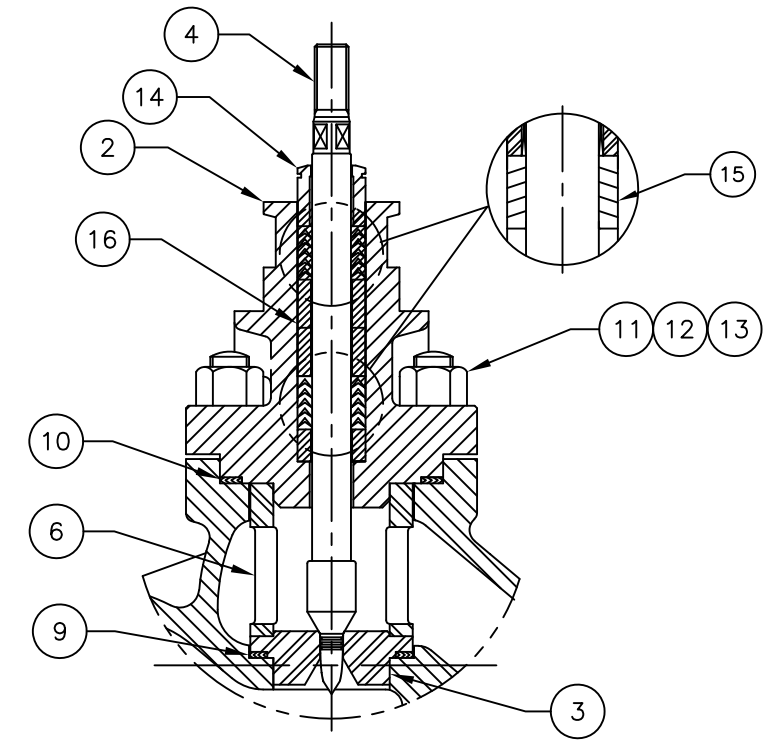

BODY SECTIONAL VIEW

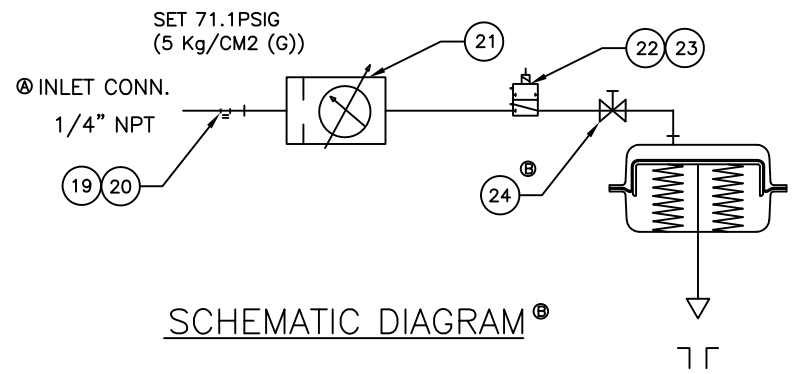

SCHEMATIC DIAGRAM Ⓑ

INLET CONNECTION 1" ASME 300RF	OUTLET CONNECTION 1" ASME 300RF
FLANGE TYPE AND CLASS ASME 300RF BOLT CIRCLE DIA 3.5 NUMBER OF BOLTS 4 BOLT HOLE DIA 3/4 HOLES TO STRADDLE CENTER LINE	SAME AS INLET

204363–2–03	03–AD–TV–121
204363–2–02	02–AD–TV–121
204363–2–01	01–AD–TV–121
VALVE SERIAL NO.	TAG NO.

CERTIFICATION	
CUSTOMER	BECHTEL CORP
PO	26068–230–POA–JV07–00001
PROJECT	CRICKET VALLEY
STATION	CRICKET VALLEY ENERGY

Cricket Valley

840G

PREP	MB	11–Dec–17
CHK	RG	13–Dec–17
DSGN	MB	11–Dec–17
PROJ	MB	11–Dec–17
APVD	VS	14–Dec–17

IMI CCI, #900, North R–1, SriCity SEZ, India 517588

Aux Steam Drain HDR Attemperator Spray Valve

TOP ASSEMBLY

SIZE D | DRAWING NUMBER 204363–2 | PLOT SCALE: NTS | SHEET 1 OF 1 | Rev.B

Document Status: RELEASED

IMI CCI – Digital Paper System