
IMI CCI – Digital Paper System


THIS DOCUMENT CONTAINS PROPRIETARY INFORMATION WITH ALL RIGHTS AND TITLES RESERVED AND MAY NOT BE REPRODUCED IN WHOLE OR IN PART WITHOUT WRITTEN CONSENT OF IMI CCI.

SolidWorks Generated Dwg.


REVISIONS

EO NUMBER	REV	DESCRIPTION	DATE	APPROVED
2017001108	NC	RELEASED	30OCT17	RJG
1960	A	ADDED DIM, BALLOONS & PART LIST	12JAN18	NS
2201	B	IMI-FK JOB NO. WAS TDB	27 FEB 18	NS

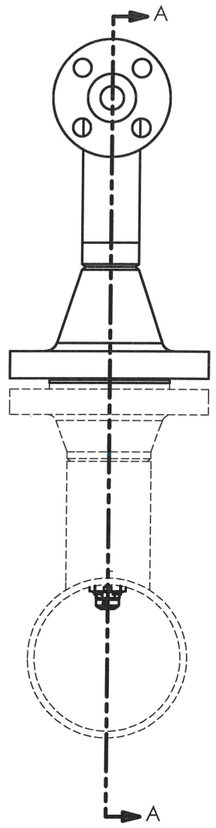

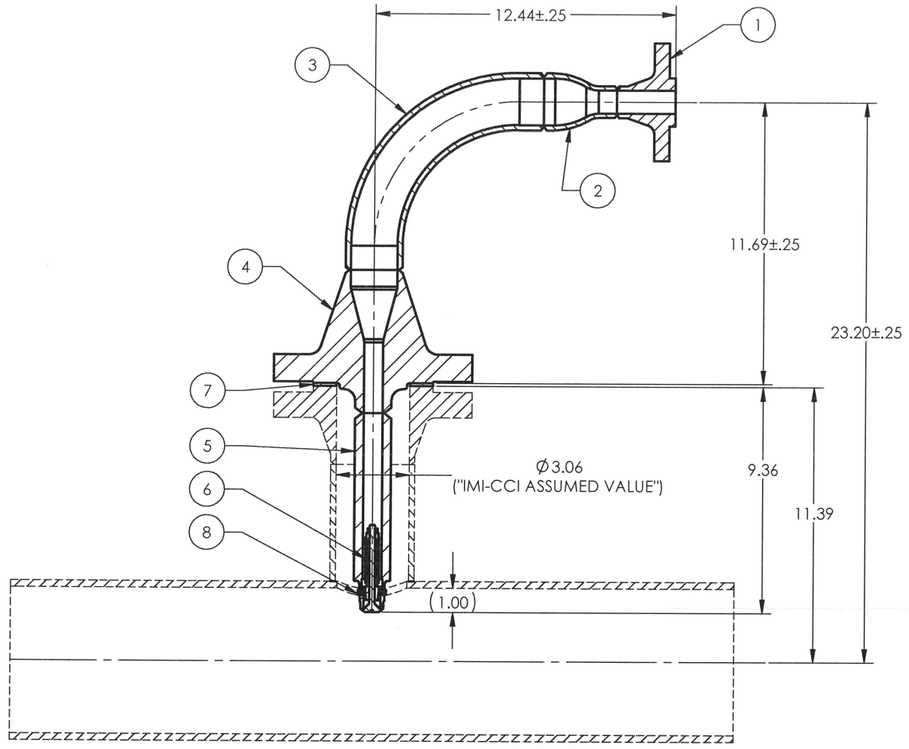

SECTION A-A
SCALE 1 : 3

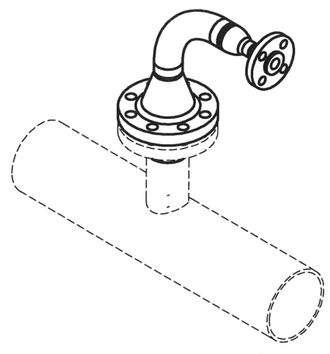

WEIGHT: 168 lbs (APPROX)

DESIGN CONDITIONS		
STEAM INLET	80 psi G	640 deg F
STEAM OUTLET	80 psi G	640 deg F
WATER:	600 psi G	255 deg F
HYDROTEST STEAM PIPE	125 psi G (IN-LINE)	
HYDROTEST SPRAYWATER MANIFOLD	900 psi G (IN-LINE)	
TAG NO.	01-AD-TX-121, 02-AD-TX-121, 03-AD-TX-121	
S/N NO.	108439-010-01, 108439-010-02, 108439-010-03	

ITEM NO.	QTY	NAME	DESCRIPTION	MATERIAL
8	1	TAB WASHER	OP 20-HT	AISI 316
7	1	GASKET, FLEXITALLIC	CGI 3", 300#	GRAPHITE / 300 SS
6	1	NOZZLE	OP 2025-HT	INCONEL 718
5	1	PROBE, NOZZLE HOUSING	1.5" OD x .79" ID	2.25Cr-1Mo
4	1	FLANGE	3", 300 #RF	ASTM-A182-F22
3	1	PIPE	2" SCH 80	ASTM-A335-P22
2	1	REDUCER	1" X 2" SCH 80	ASTM-A234-WP22
1	1	FLANGE	1", 300 #RF	ASTM-A182-F22

NOTES:

1. DESIGN AND TEST REQUIREMENTS: ASME B31.1 2016 EDITION
2. BOLT HOLES OF FLANGES TO STRADDLE PIPE CENTER LINE
3. TAGGING / MARKING AND NUMBERING REQUIRED ON DRAIN DESUPERHEATERS PER CUSTOMER SPECIFICATION
4. ALL DASHED COMPONENTS ARE IN CUSTOMER SCOPE OF SUPPLY
5. ALL BOLTING IS UNDER CUSTOMER SCOPE OF SUPPLY
6. NOZZLE SPRAY ANGLE IS 45°
7. REFER TO 204363-1-CVDS FOR NOZZLE CV
8. TORQUE VALVE APPLIED TO NOZZLE = 45 ft-lbf

STEAM CONNECTION: 3", 300# RF	
FLANGE:	RF FLANGE
FLANGE CLASS:	300#
BOLT CIRCLE DIA.:	6.63
NO. OF BOLTS:	8
HOLE DIA.:	.88
HOLES TO STRADDLE CENTER LINE	

WATER CONNECTION: 1", 300#RF	
FLANGE:	RF FLANGE
FLANGE CLASS:	300#
BOLT CIRCLE DIA.:	3.50
NO. OF BOLTS:	4
HOLE DIA.:	.75
HOLES TO STRADDLE CENTER LINE	

CUSTOMER: BECHTEL
PROJECT: CRICKET VALLEY

DO NOT SCALE DRAWINGS
MUST CONFORM TO ES 100
GEOMETRIC SYMBOLS PER ANSI Y14.5
MACHINED SURFACES 125 PER ANSI B46.1
WELDING SYMBOLS PER ANSI Y32.3 OR AWS A2.0
ABBREVIATIONS PER MIL-STD-12

3rd ANGLE PROJECTION

PREP	JZAMORA	20OCT17
CHK	N.STANTZ	20OCT17
DSGN	JZAMORA	20OCT17
APVD	R.GRABLE	20OCT17

UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES TOLERANCES ANGLE ± 2 DEG. (.0)±.1 (.00)±.03 (.000)±.010

MATERIAL(S): SEE B/M

IMI FLUID KINETICS. IMI Critical Engineering
1108 Industrial Road
Winfield, KS 67156, USA

IMI-FK Job No.: 171308
Work Order Line: 204363-1
AUX STEAM DRAIN HDR ATTEMPERATOR

SIZE D | DRAWING NUMBER 204363-1 | SCALE 1:1 | SHEET 1 OF 1

Document Status: RELEASED