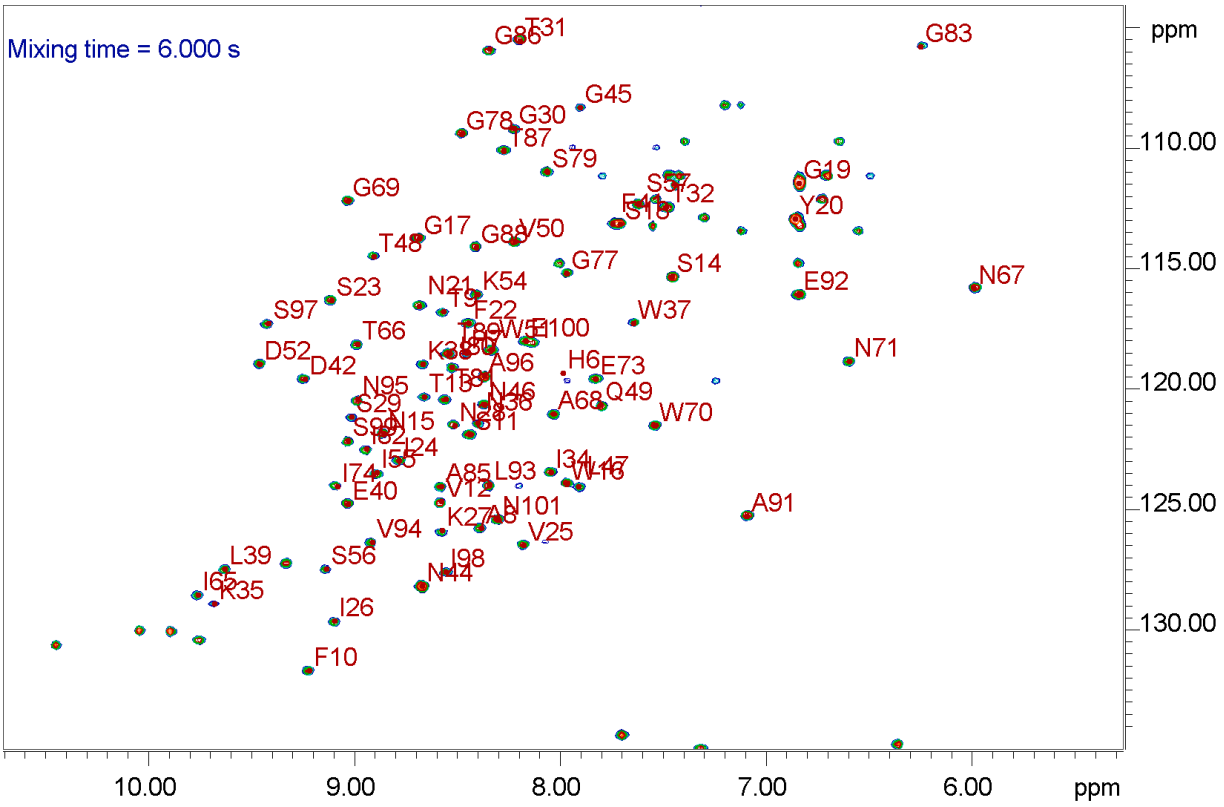
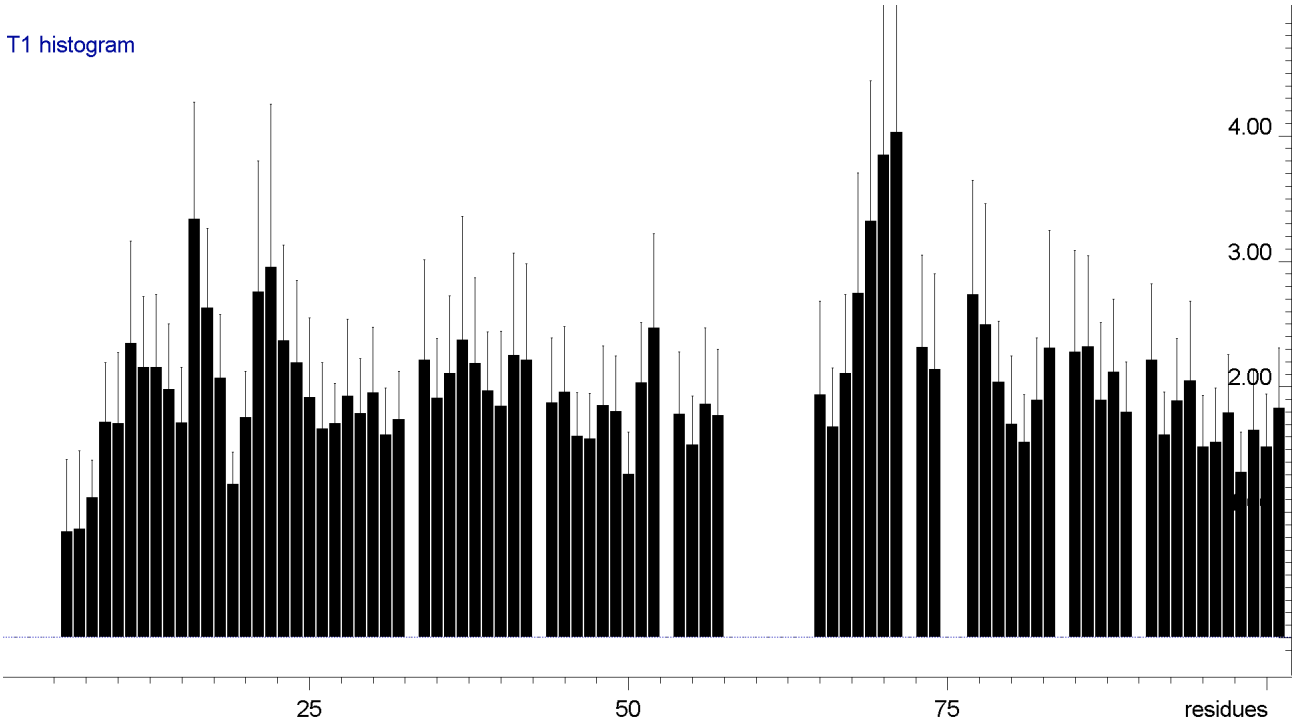
• T1 Analysis

sample name:	15N-BaCBM2 (107uM) 25 mM NaAc pH 5.0 10 mM NaCl
Description/Title:	
Origin:	in-house
Date of preparation:	18 Jan 2024
Solvent:	D2O
pH:	7.0
Sample tube:	normal
Tube diameter (mm):	3
Concentration (mM):	10.00
Temperature (K):	308.0
Weight (Daltons):	8900
Correlation time (ns):	4.00
Labelling:	15N
Sequence format:	FASTA file
Sequence file:	???
PDB file:	???


Mixing time = 6.000 s
ppm
110.00
115.00
120.00
125.00
130.00
10.00
9.00
8.00
7.00
6.00
ppm

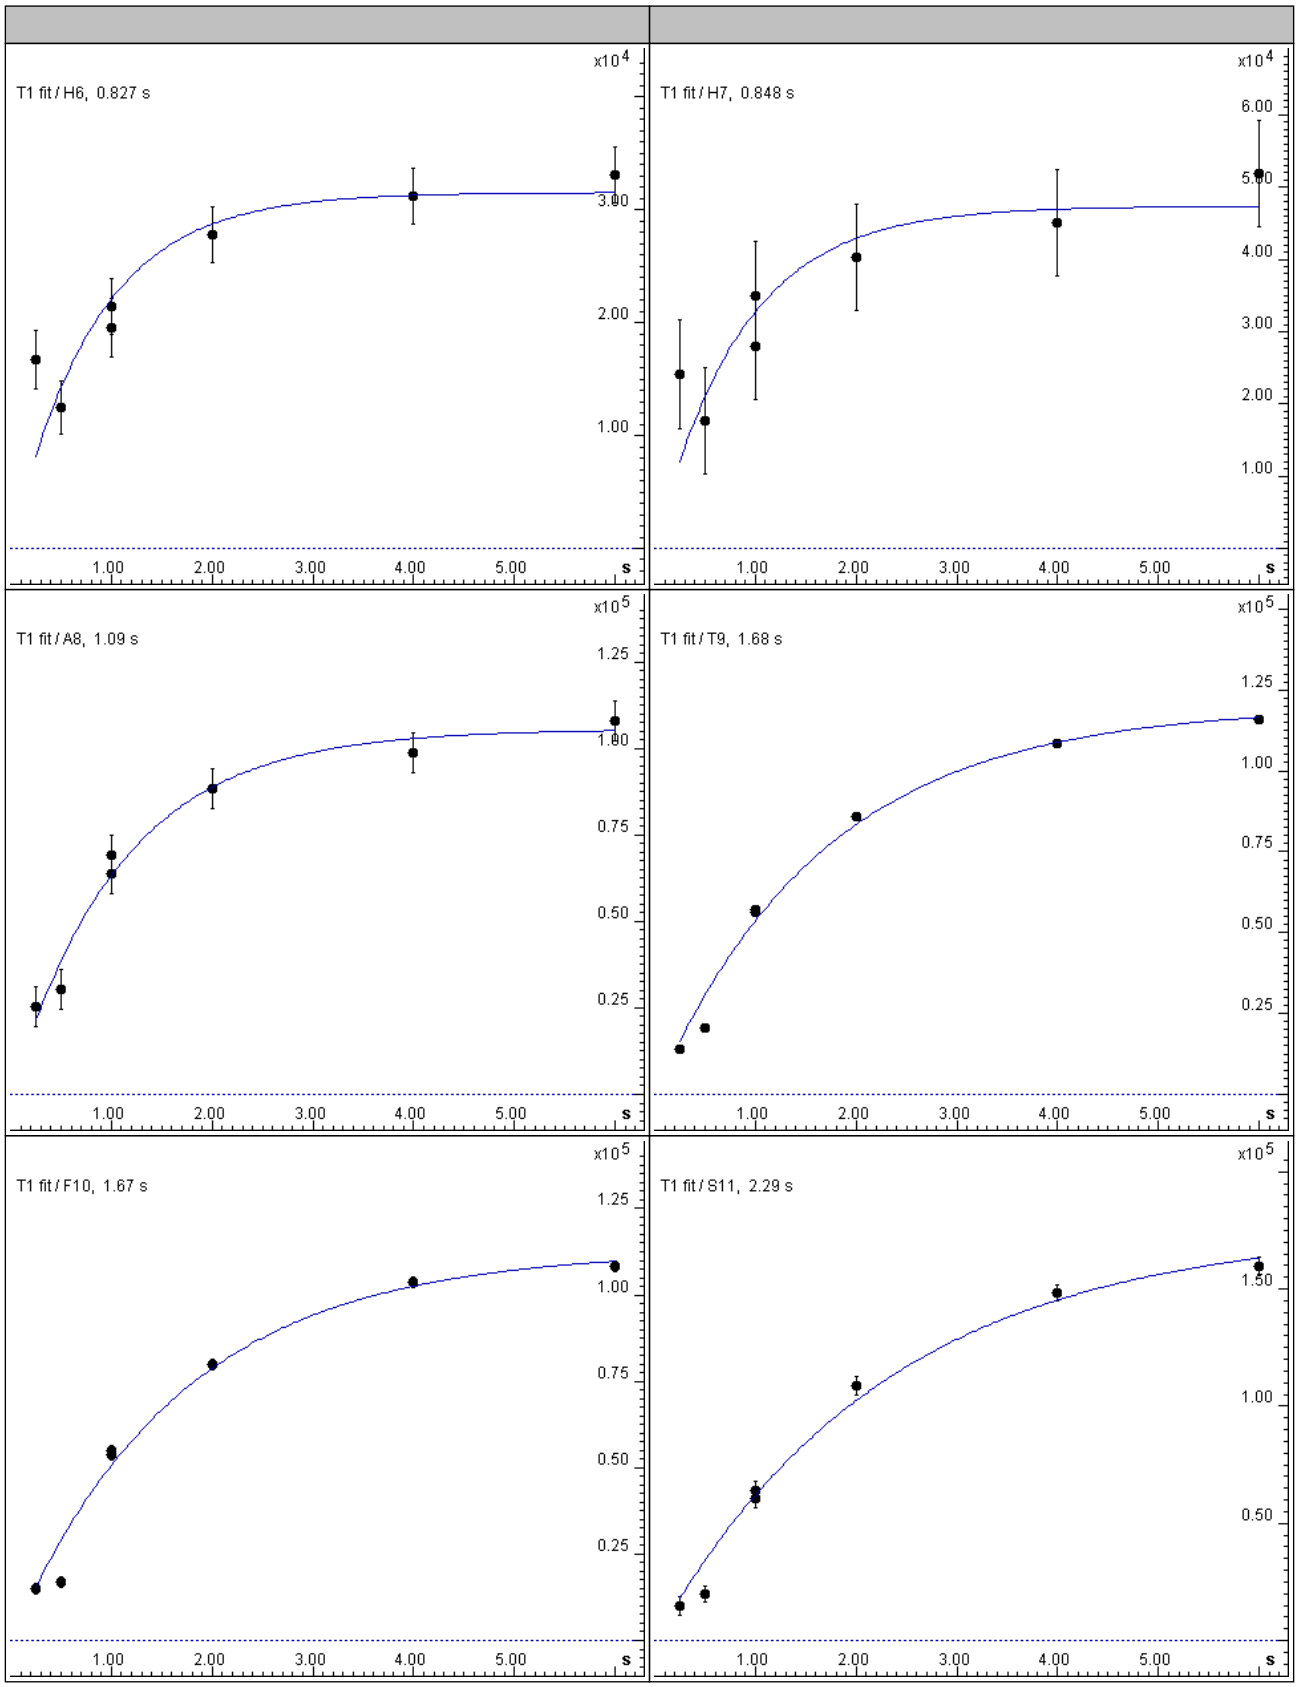

T1 histogram
4.00
3.00
2.00
25
50
75
residues

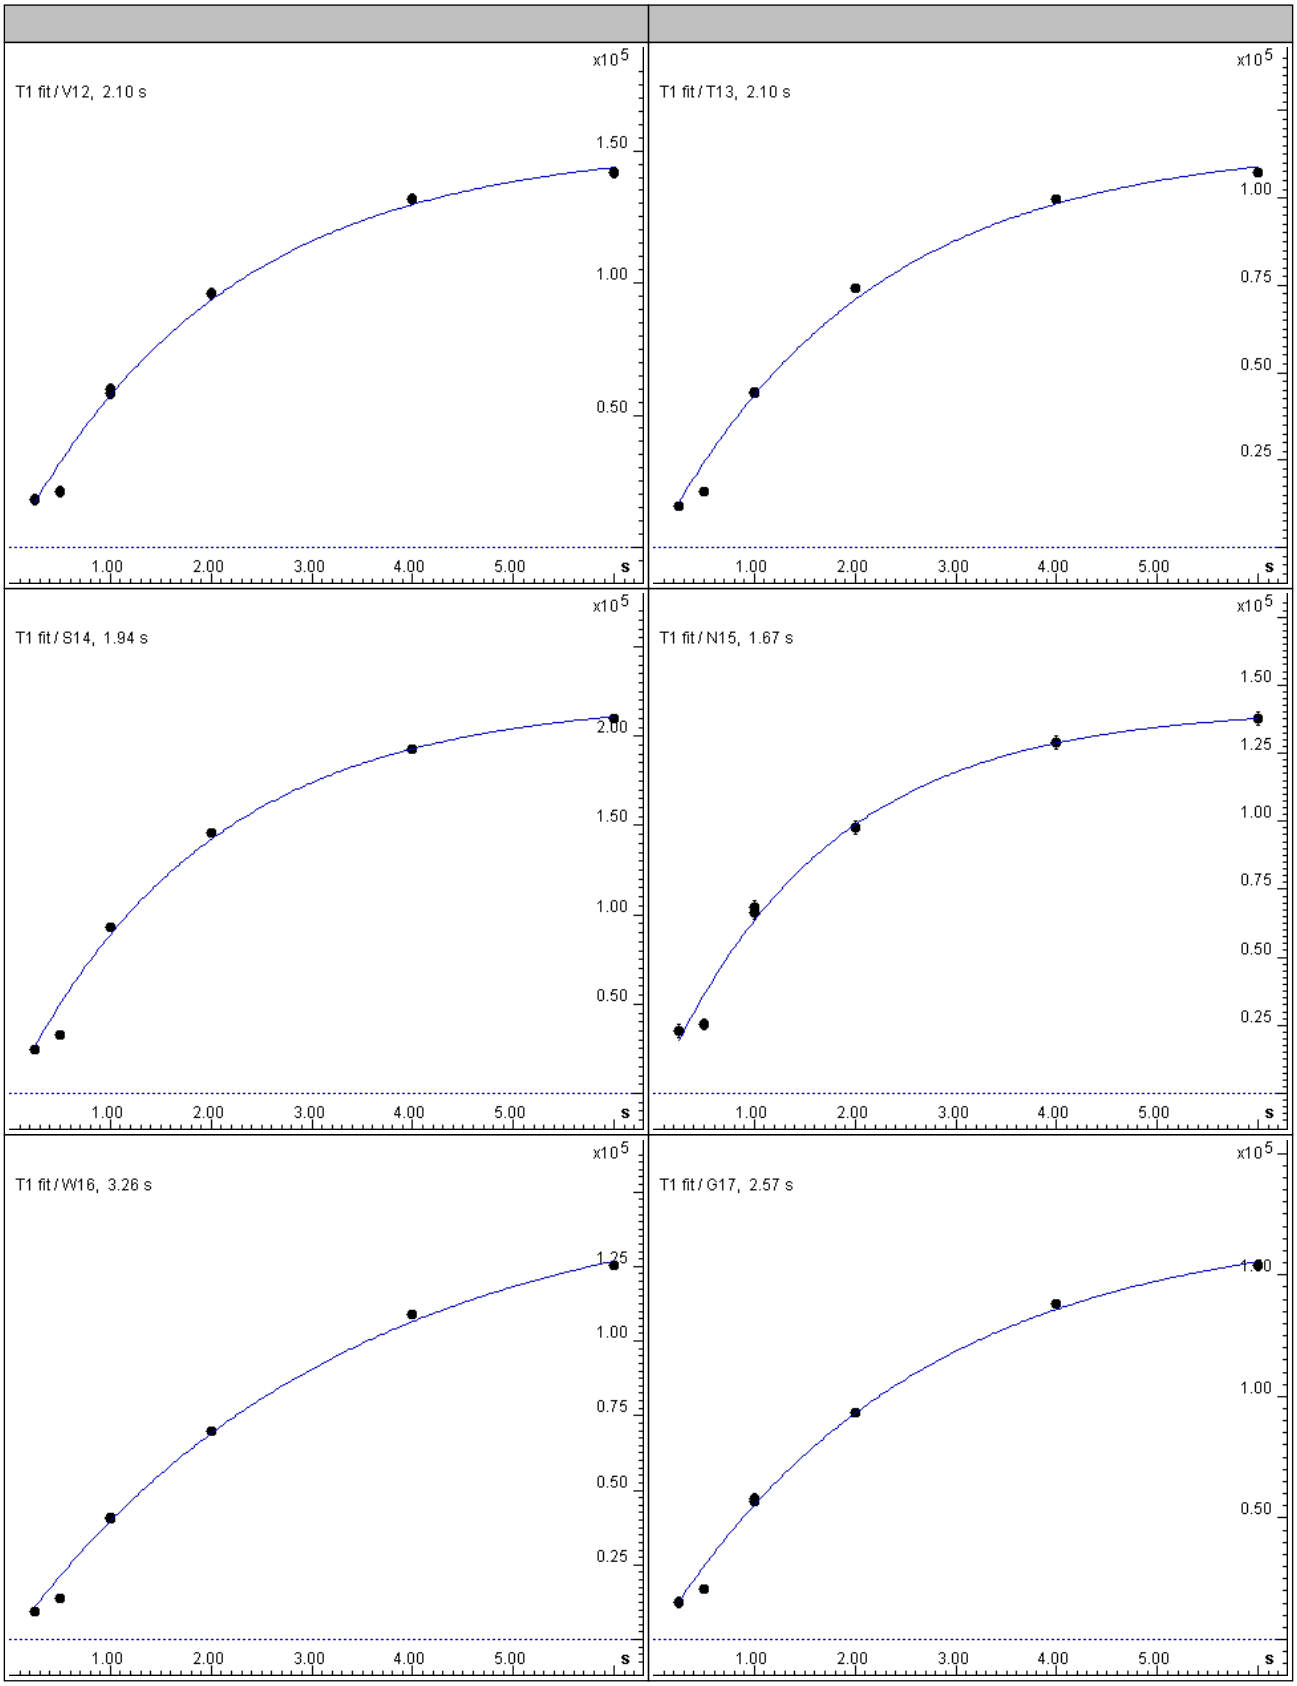
Fitted function:	f(t) = Io * [1-exp(-t/T1)]
Random error estimation of data:	RMS per spectrum (or trace/plane)
Systematic error estimation of data:	worst case per peak scenario
Fit parameter Error estimation method:	from fit using arbitrary y uncertainties
Confidence level:	95%
Used peaks:	peaks from peaklist.xml at spectrum
Used integrals:	peak intensities
Used Mixing time:	all values (including replicates) used

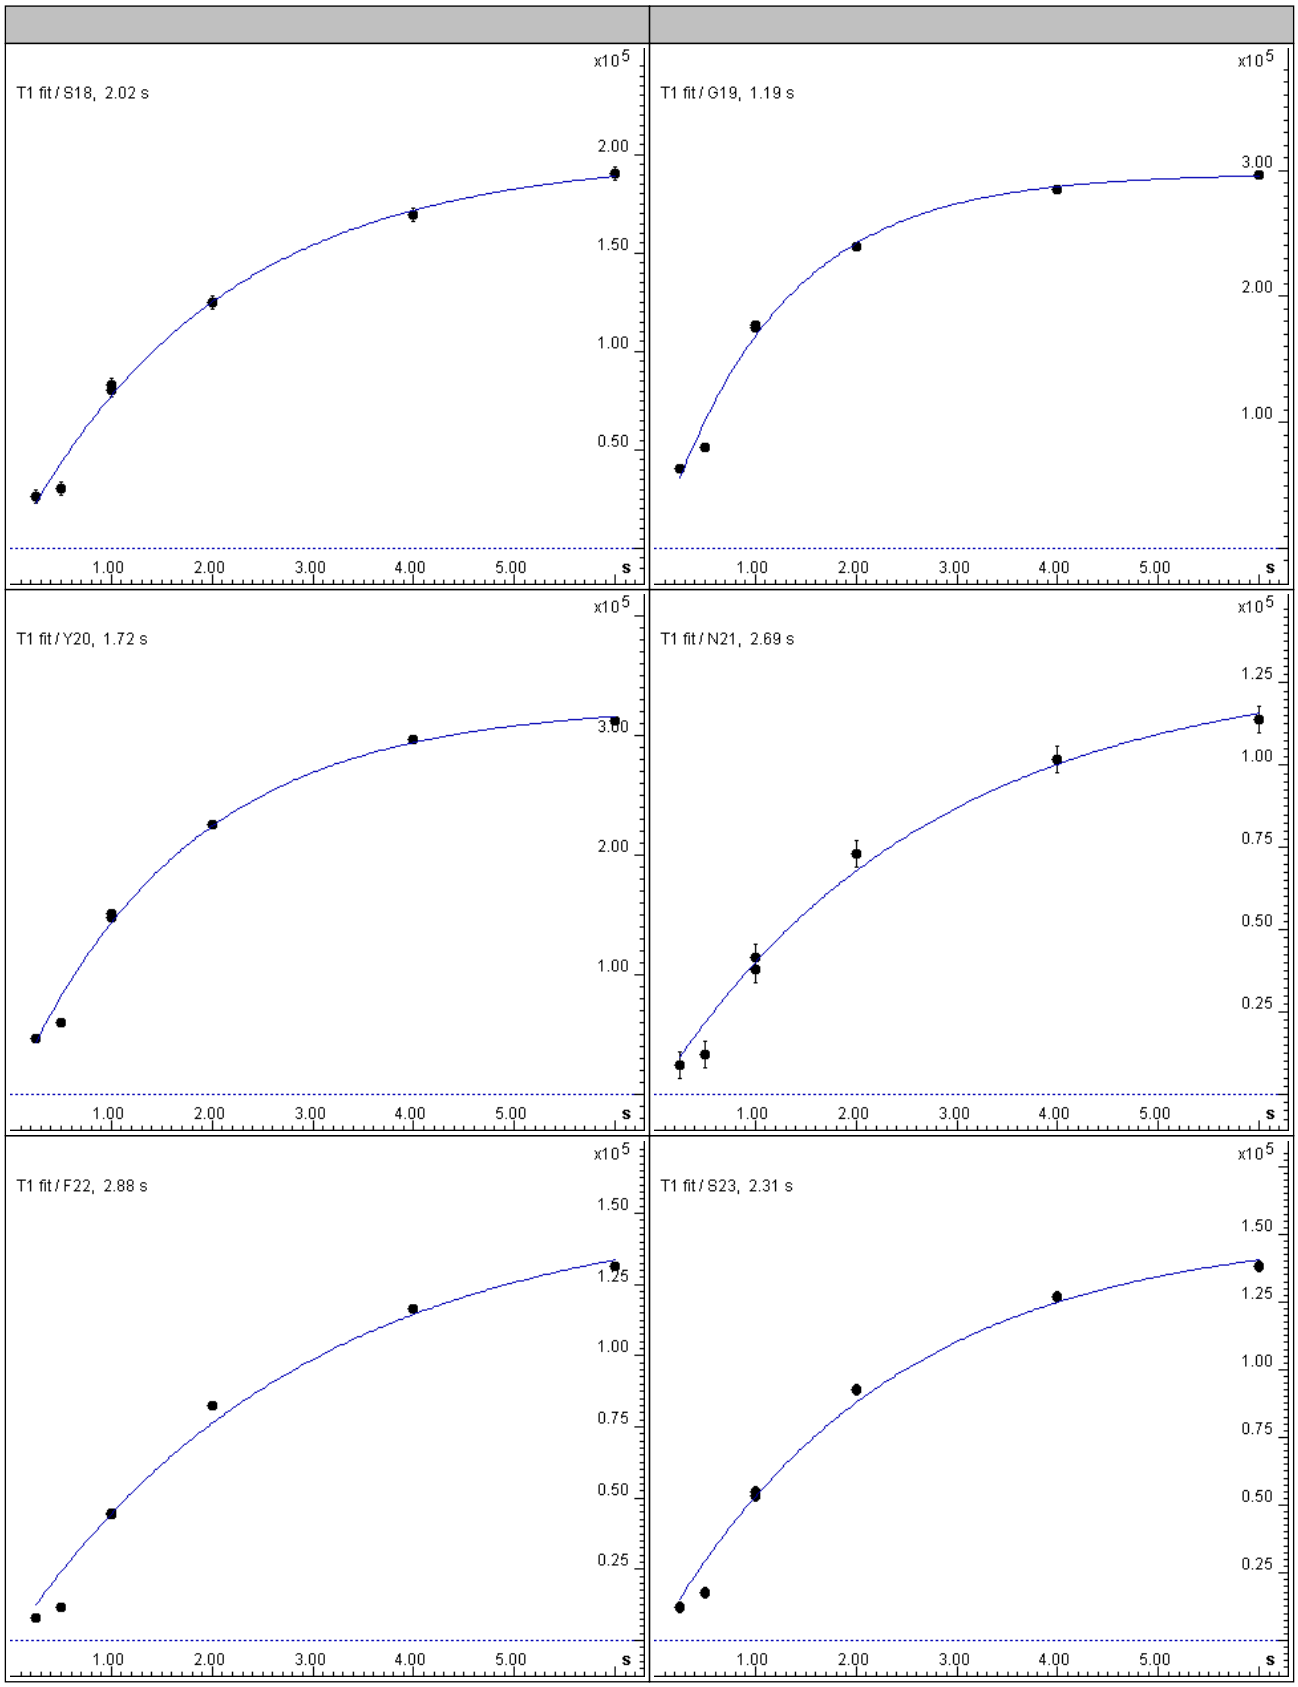
Peak name	F1 [ppm]	F2 [ppm]	Io	error	T1 [s]	error	fitInfo
H6	119.318	7.983	3.16e+04	7335	0.827	0.5666	Done
H7	118.470	8.452	4.75e+04	1.172e+04	0.848	0.6125	Done
A8	125.738	8.382	1.06e+05	1.059e+04	1.09	0.2959	Done
T9	116.775	8.564	1.20e+05	1.373e+04	1.68	0.4634	Done
F10	131.674	9.215	1.13e+05	1.554e+04	1.67	0.5552	Done
S11	121.862	8.435	1.76e+05	2.833e+04	2.29	0.8001	Done
V12	124.648	8.576	1.53e+05	1.795e+04	2.10	0.5543	Done
T13	120.287	8.658	1.16e+05	1.404e+04	2.10	0.5720	Done
S14	115.321	7.455	2.21e+05	2.530e+04	1.94	0.5108	Done
N15	121.862	8.857	1.42e+05	1.529e+04	1.67	0.4357	Done
W16	123.921	7.965	1.51e+05	2.259e+04	3.26	0.9153	Done
G17	113.746	8.681	1.72e+05	2.013e+04	2.57	0.6225	Done
S18	113.141	7.707	2.00e+05	2.153e+04	2.02	0.4959	Done
G19	111.445	6.839	2.98e+05	2.356e+04	1.19	0.2499	Done
Y20	112.898	6.856	3.26e+05	2.887e+04	1.72	0.3643	Done
N21	116.532	8.681	1.30e+05	2.418e+04	2.69	1.021	Done
F22	117.259	8.441	1.53e+05	3.416e+04	2.88	1.274	Done
S23	116.290	9.110	1.52e+05	2.262e+04	2.31	0.7447	Done
I24	122.952	8.781	1.22e+05	1.650e+04	2.14	0.6429	Done
V25	126.465	8.177	1.30e+05	1.849e+04	1.87	0.6205	Done
I26	129.614	9.092	1.02e+05	1.335e+04	1.63	0.5162	Done
K27	125.859	8.570	1.02e+05	7935	1.67	0.3147	Done
N28	121.499	8.511	1.07e+05	1.470e+04	1.88	0.6001	Done
S29	121.135	9.010	7.27e+04	7528	1.75	0.4315	Done
G30	109.143	8.224	1.37e+05	1.591e+04	1.91	0.5152	Done
T31	105.509	8.194	1.30e+05	1.224e+04	1.58	0.3669	Done
T32	112.414	7.484	1.69e+05	1.551e+04	1.70	0.3756	Done
I34	123.437	8.042	1.30e+05	2.124e+04	2.16	0.7829	Done
K35	128.888	9.679	5.71e+04	6084	1.87	0.4642	Done
N36	121.377	8.400	9.68e+04	1.260e+04	2.06	0.6050	Done
W37	117.259	7.643	1.01e+05	1.949e+04	2.32	0.9645	Done
K38	118.955	8.664	1.10e+05	1.550e+04	2.14	0.6704	Done
L39	127.434	9.626	1.06e+05	1.097e+04	1.92	0.4611	Done
E40	124.769	9.028	1.23e+05	1.702e+04	1.80	0.5880	Done
F41	113.141	7.742	1.86e+05	3.079e+04	2.20	0.8010	Done

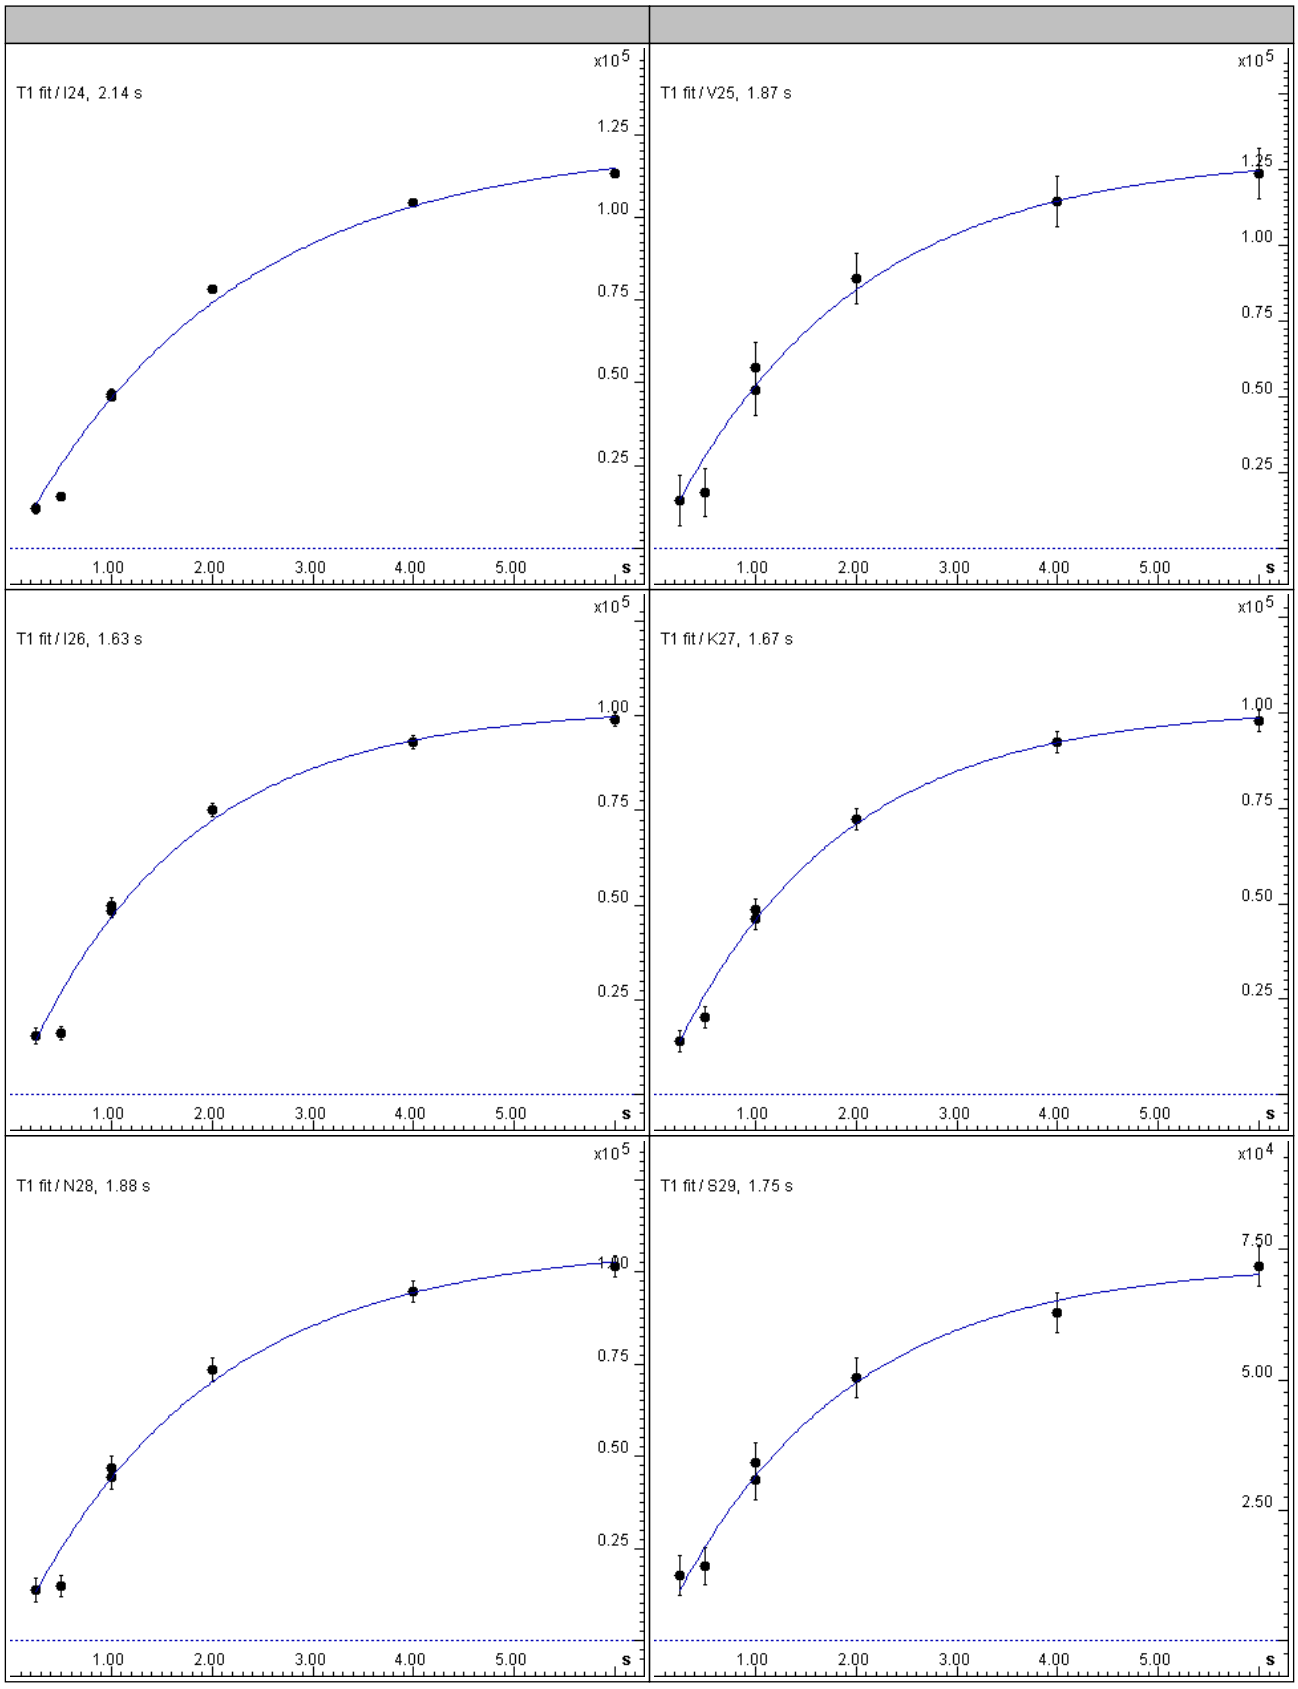
Peak name	F1 [ppm]	F2 [ppm]	Io	error	T1 [s]	error	fitInfo
D42	119.561	9.239	1.29e+05	2.033e+04	2.16	0.7541	Done
N44	128.161	8.670	2.29e+05	2.698e+04	1.83	0.5064	Done
G45	108.295	7.901	7.24e+04	8413	1.91	0.5149	Done
N46	120.651	8.364	9.80e+04	8648	1.57	0.3412	Done
L47	124.042	7.907	1.04e+05	9651	1.55	0.3545	Done
T48	114.473	8.904	1.05e+05	1.137e+04	1.81	0.4634	Done
Q49	120.651	7.801	1.83e+05	1.899e+04	1.76	0.4361	Done
V50	113.867	8.218	1.62e+05	1.597e+04	1.27	0.3281	Done
W51	118.349	8.335	1.52e+05	1.573e+04	1.99	0.4702	Done
D52	118.955	9.456	1.28e+05	1.843e+04	2.41	0.7390	Done
K54	116.048	8.400	1.34e+05	1.566e+04	1.74	0.4843	Done
I55	123.437	8.887	1.18e+05	1.206e+04	1.50	0.3818	Done
S56	127.434	9.133	9.43e+04	1.317e+04	1.82	0.5985	Done
S57	112.293	7.619	1.64e+05	2.059e+04	1.73	0.5198	Done
I65	128.524	9.755	1.06e+05	1.766e+04	1.89	0.7313	Done
T66	118.107	8.981	1.22e+05	1.405e+04	1.64	0.4590	Done
N67	115.805	5.988	1.62e+05	2.144e+04	2.06	0.6175	Done
A68	121.014	8.030	1.46e+05	2.505e+04	2.68	0.9373	Done
G69	112.172	9.028	1.63e+05	2.923e+04	3.25	1.095	Done
W70	121.499	7.537	2.07e+05	3.727e+04	3.76	1.194	Done
N71	118.834	6.592	1.63e+05	3.487e+04	3.94	1.462	Done
E73	119.561	7.825	1.55e+05	2.266e+04	2.26	0.7213	Done
I74	124.042	9.080	1.08e+05	1.714e+04	2.09	0.7477	Done
G77	115.200	7.965	1.29e+05	2.107e+04	2.67	0.8908	Done
G78	109.386	8.476	1.63e+05	2.978e+04	2.44	0.9462	Done
S79	110.960	8.059	1.82e+05	1.909e+04	1.99	0.4779	Done
I80	119.076	8.523	1.30e+05	1.717e+04	1.66	0.5323	Done
T81	120.408	8.552	1.25e+05	1.223e+04	1.52	0.3699	Done
I82	122.468	8.940	1.15e+05	1.286e+04	1.85	0.4855	Done
G83	105.752	6.246	8.52e+04	1.590e+04	2.26	0.9197	Done
A85	124.042	8.576	1.38e+05	2.230e+04	2.22	0.7921	Done
G86	105.873	8.341	1.42e+05	2.031e+04	2.27	0.7083	Done
T87	110.112	8.271	1.17e+05	1.639e+04	1.85	0.6058	Done
G88	114.110	8.405	1.37e+05	1.672e+04	2.07	0.5699	Done
T89	118.470	8.540	1.89e+05	1.770e+04	1.75	0.3910	Done
A91	125.254	7.091	1.67e+05	2.065e+04	2.16	0.5951	Done
E92	116.048	6.839	1.87e+05	1.627e+04	1.58	0.3371	Done
L93	123.921	8.341	1.40e+05	1.573e+04	1.85	0.4869	Done
V94	126.344	8.910	1.21e+05	1.655e+04	2.00	0.6236	Done
N95	120.408	8.981	1.32e+05	1.439e+04	1.49	0.4049	Done
A96	119.439	8.364	2.49e+05	2.813e+04	1.52	0.4262	Done
S97	117.259	9.415	1.26e+05	1.381e+04	1.75	0.4569	Done
I98	127.555	8.552	9.42e+04	8814	1.29	0.3133	Done
S99	122.104	9.028	1.19e+05	1.410e+04	1.61	0.4674	Done
E100	117.986	8.165	1.48e+05	1.658e+04	1.49	0.4147	Done

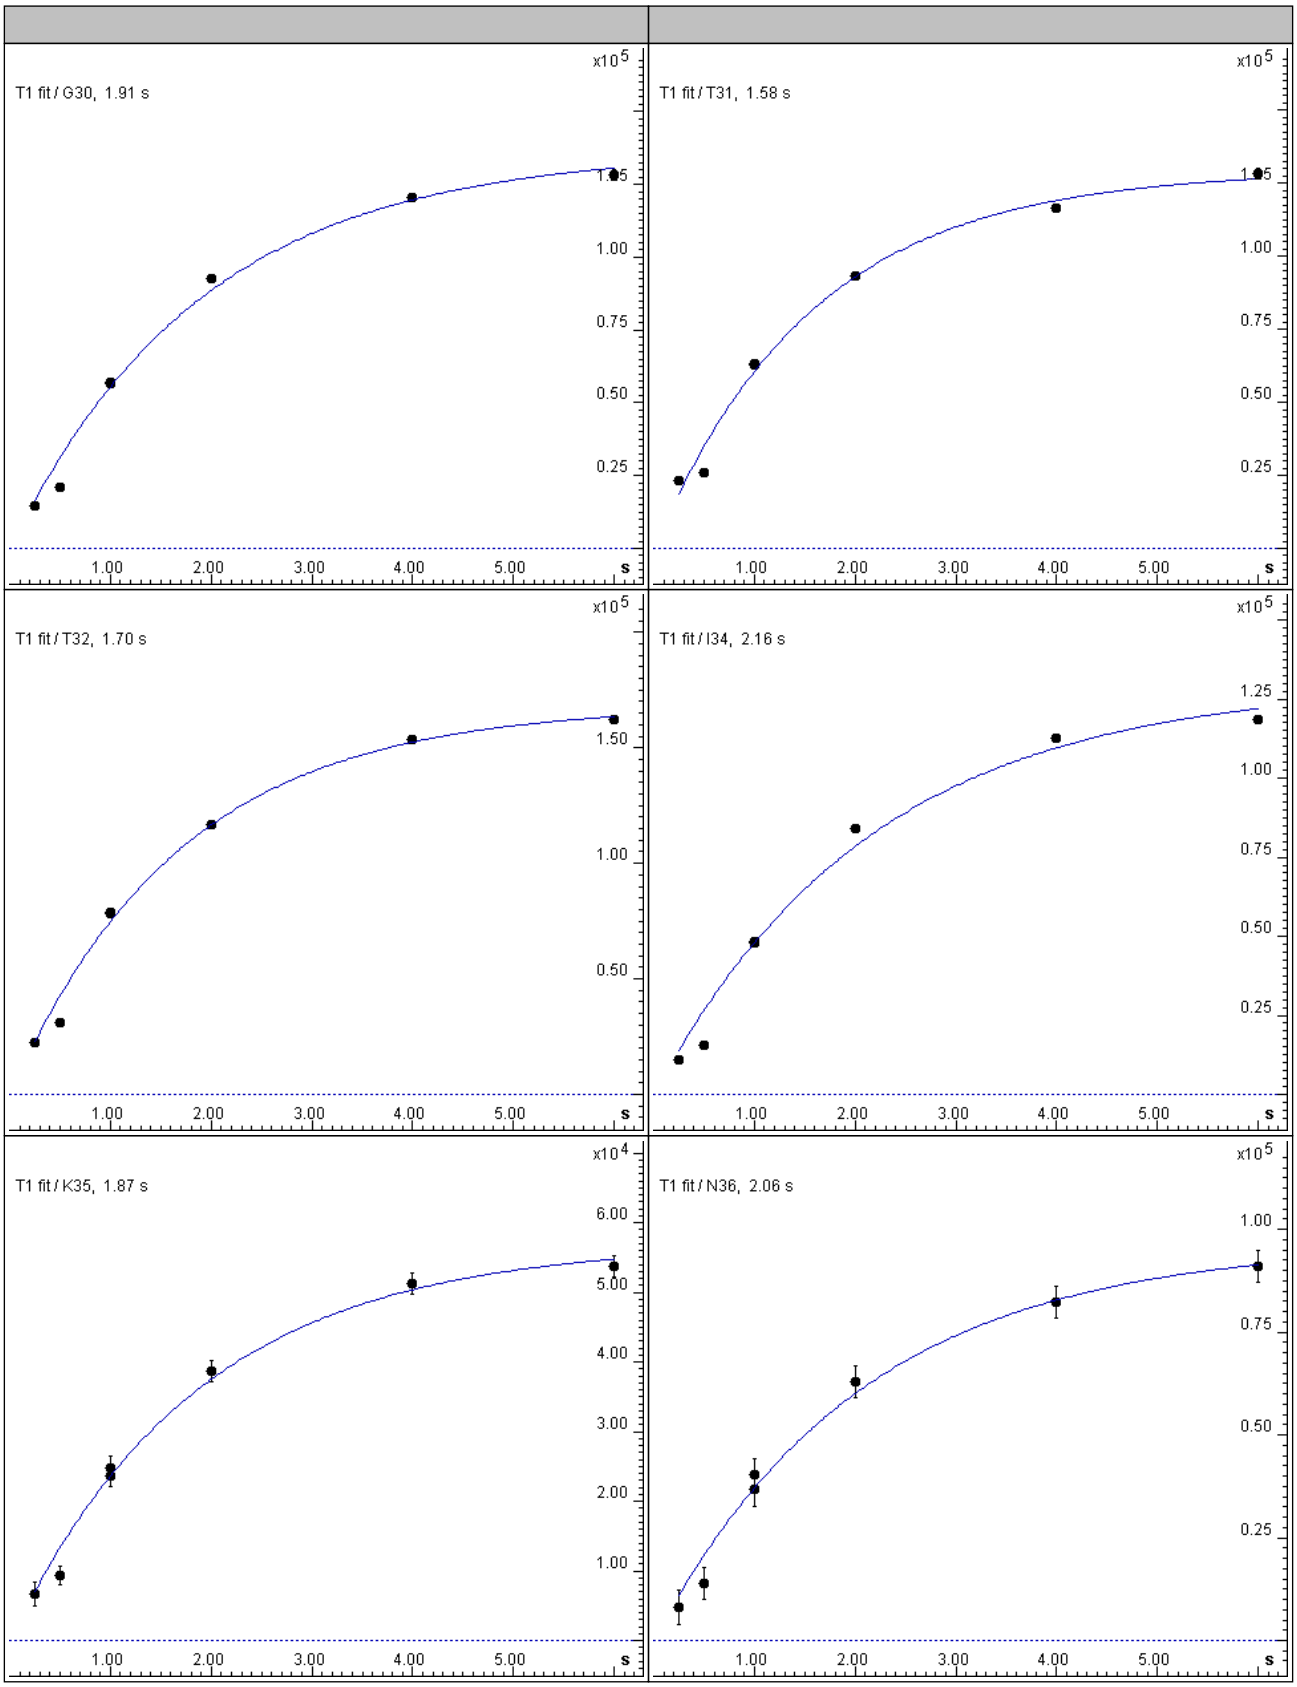
Peak name	F1 [ppm]	F2 [ppm]	Io	error	T1 [s]	error	fitInfo
N101	125.375	8.300	1.76e+05	1.969e+04	1.79	0.4725	Done

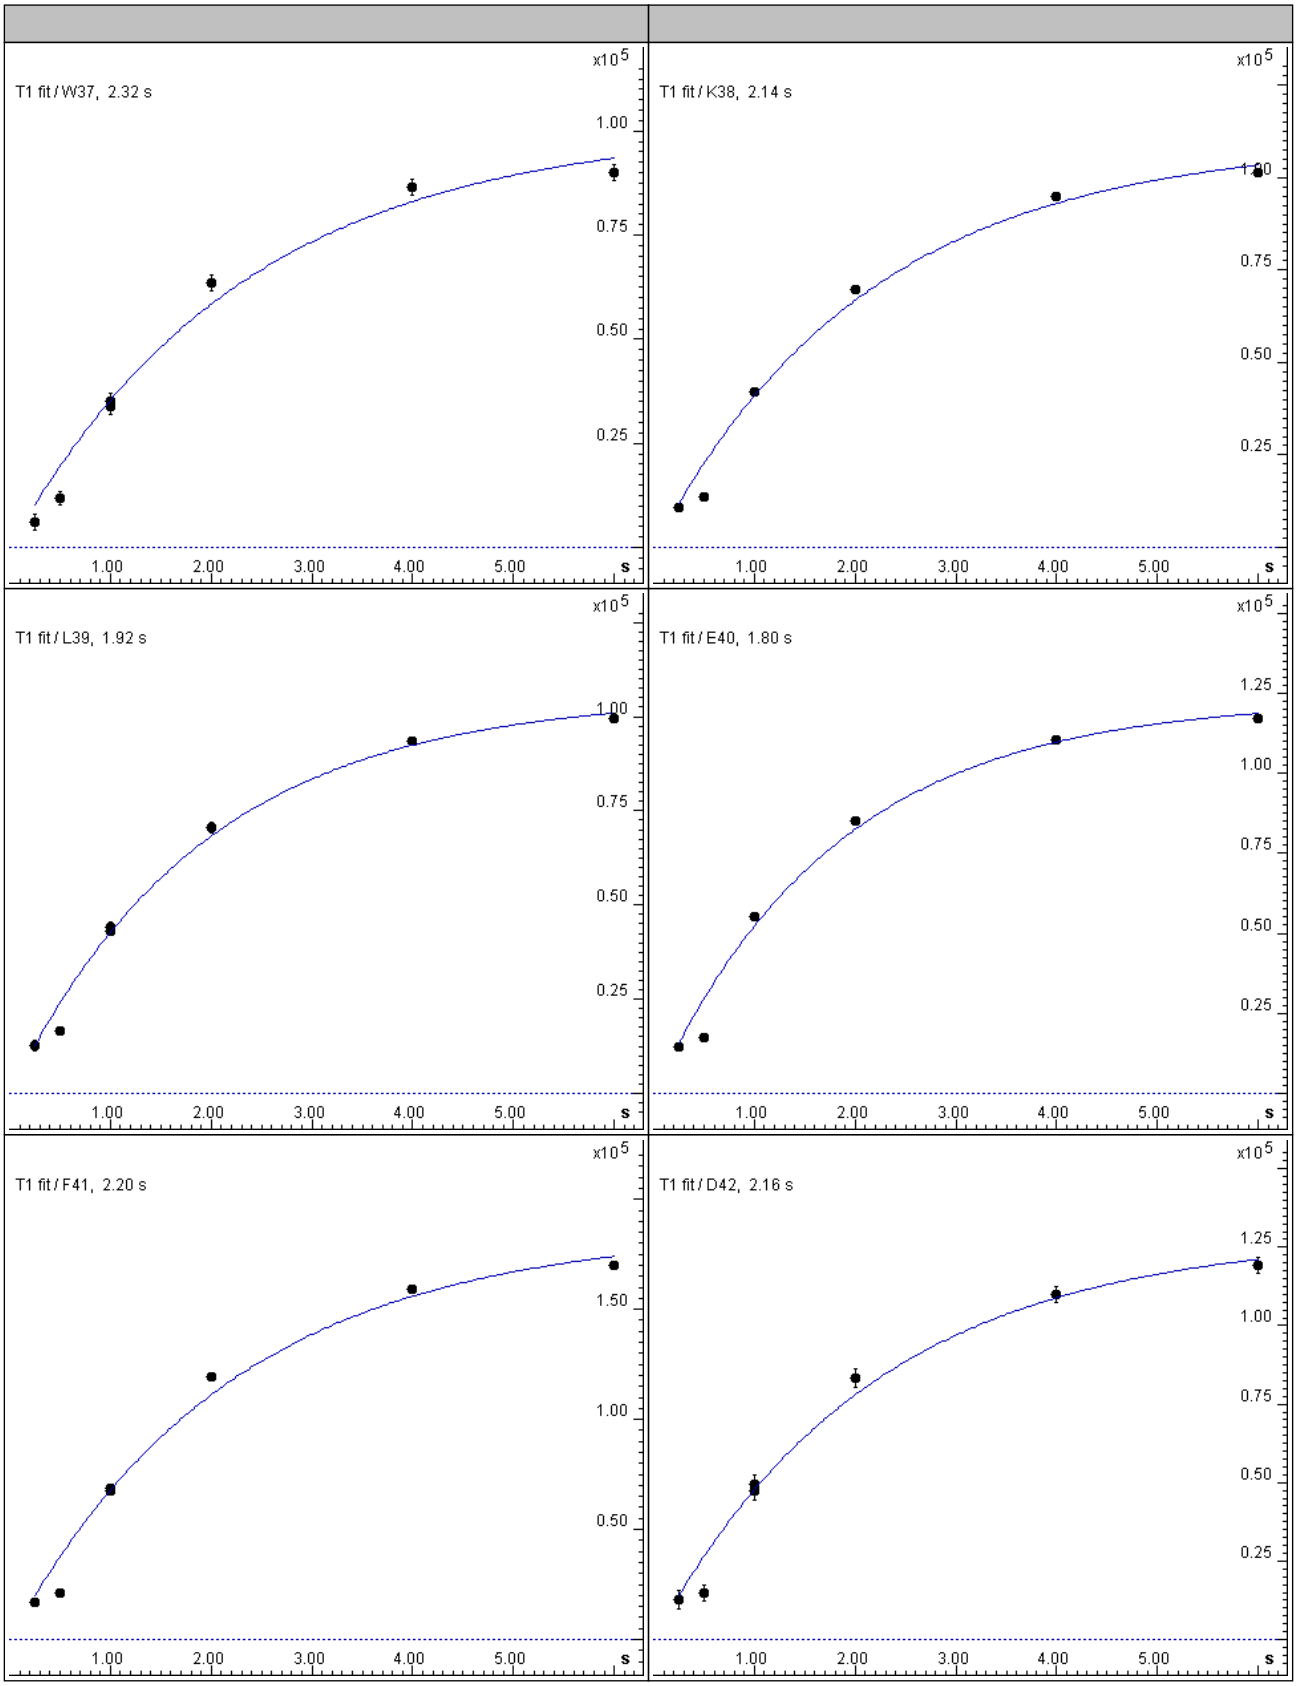

T1 fit / H6, 0.827 s
x10 4
3.00
2.00
1.00
1.00 2.00 3.00 4.00 5.00 s
T1 fit / H7, 0.848 s
x10 4
6.00
5.00
4.00
3.00
2.00
1.00
1.00 2.00 3.00 4.00 5.00 s
T1 fit / A8, 1.09 s
x10 5
1.25
1.00
0.75
0.50
0.25
1.00 2.00 3.00 4.00 5.00 s
T1 fit / T9, 1.68 s
x10 5
1.25
1.00
0.75
0.50
0.25
1.00 2.00 3.00 4.00 5.00 s
T1 fit / F10, 1.67 s
x10 5
1.25
1.00
0.75
0.50
0.25
1.00 2.00 3.00 4.00 5.00 s
T1 fit / S11, 2.29 s
x10 5
1.50
1.00
0.50
1.00 2.00 3.00 4.00 5.00 s

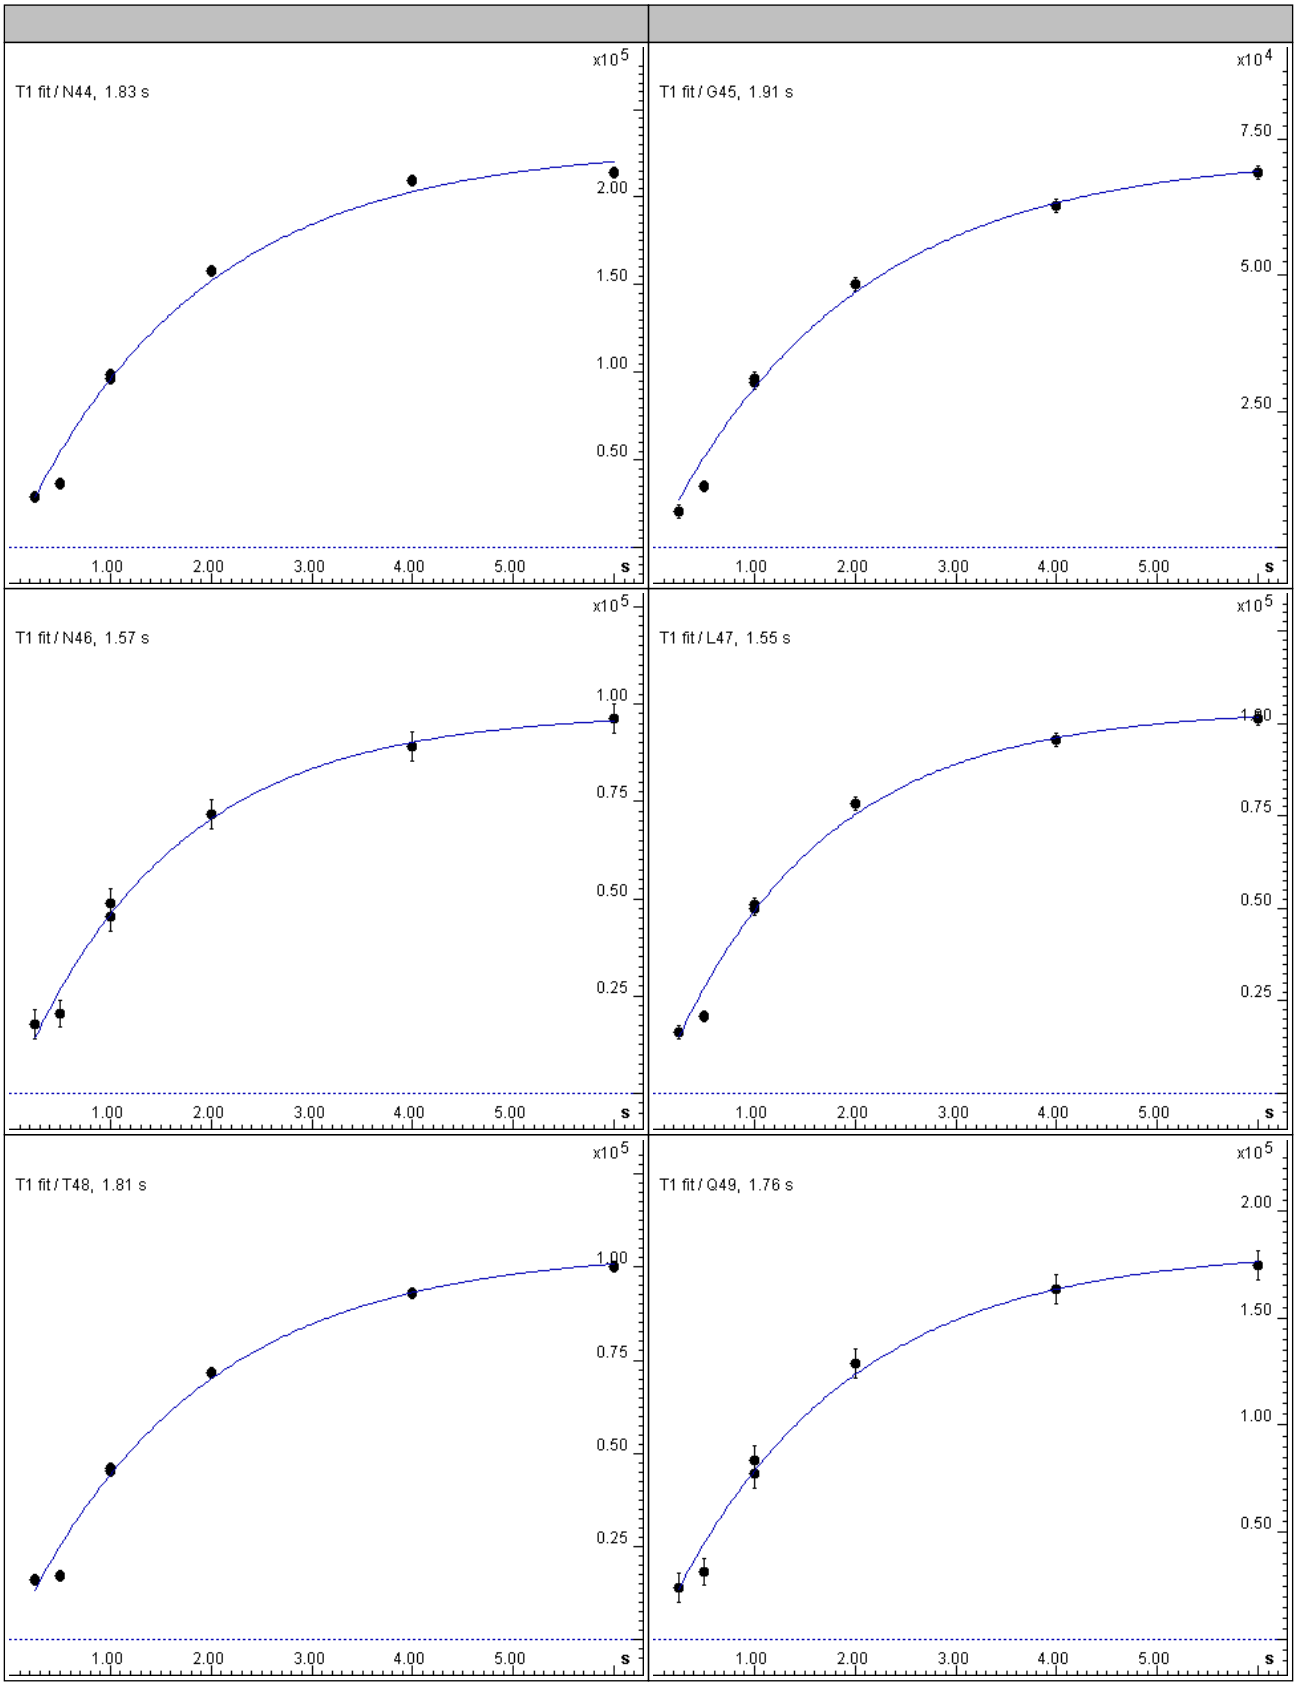

T1 fit / V12, 2.10 s
T1 fit / T13, 2.10 s
T1 fit / S14, 1.94 s
T1 fit / N15, 1.67 s
T1 fit / W16, 3.26 s
T1 fit / G17, 2.57 s
x10^5
s

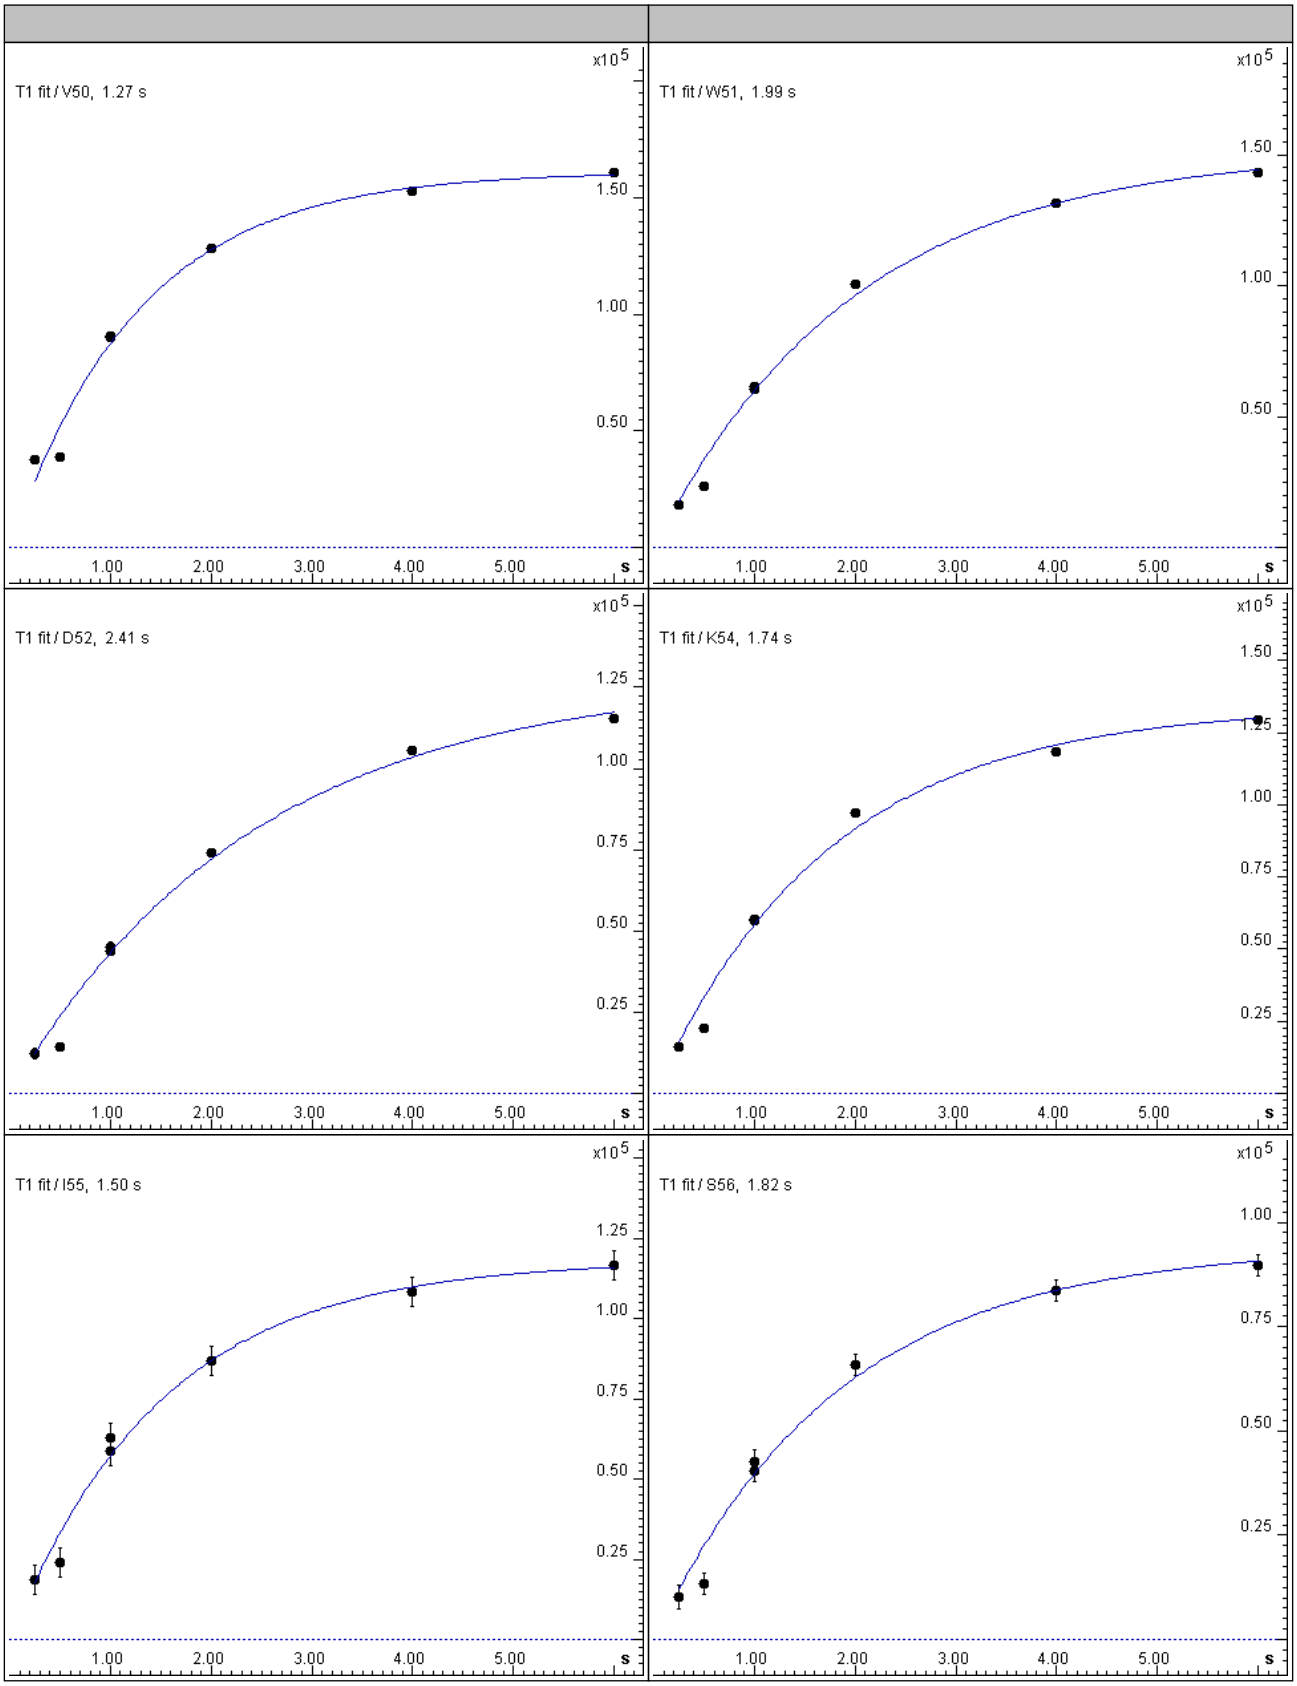

T1 fit / S18, 2.02 s
T1 fit / G19, 1.19 s
T1 fit / Y20, 1.72 s
T1 fit / N21, 2.69 s
T1 fit / F22, 2.88 s
T1 fit / S23, 2.31 s
x10^5
s

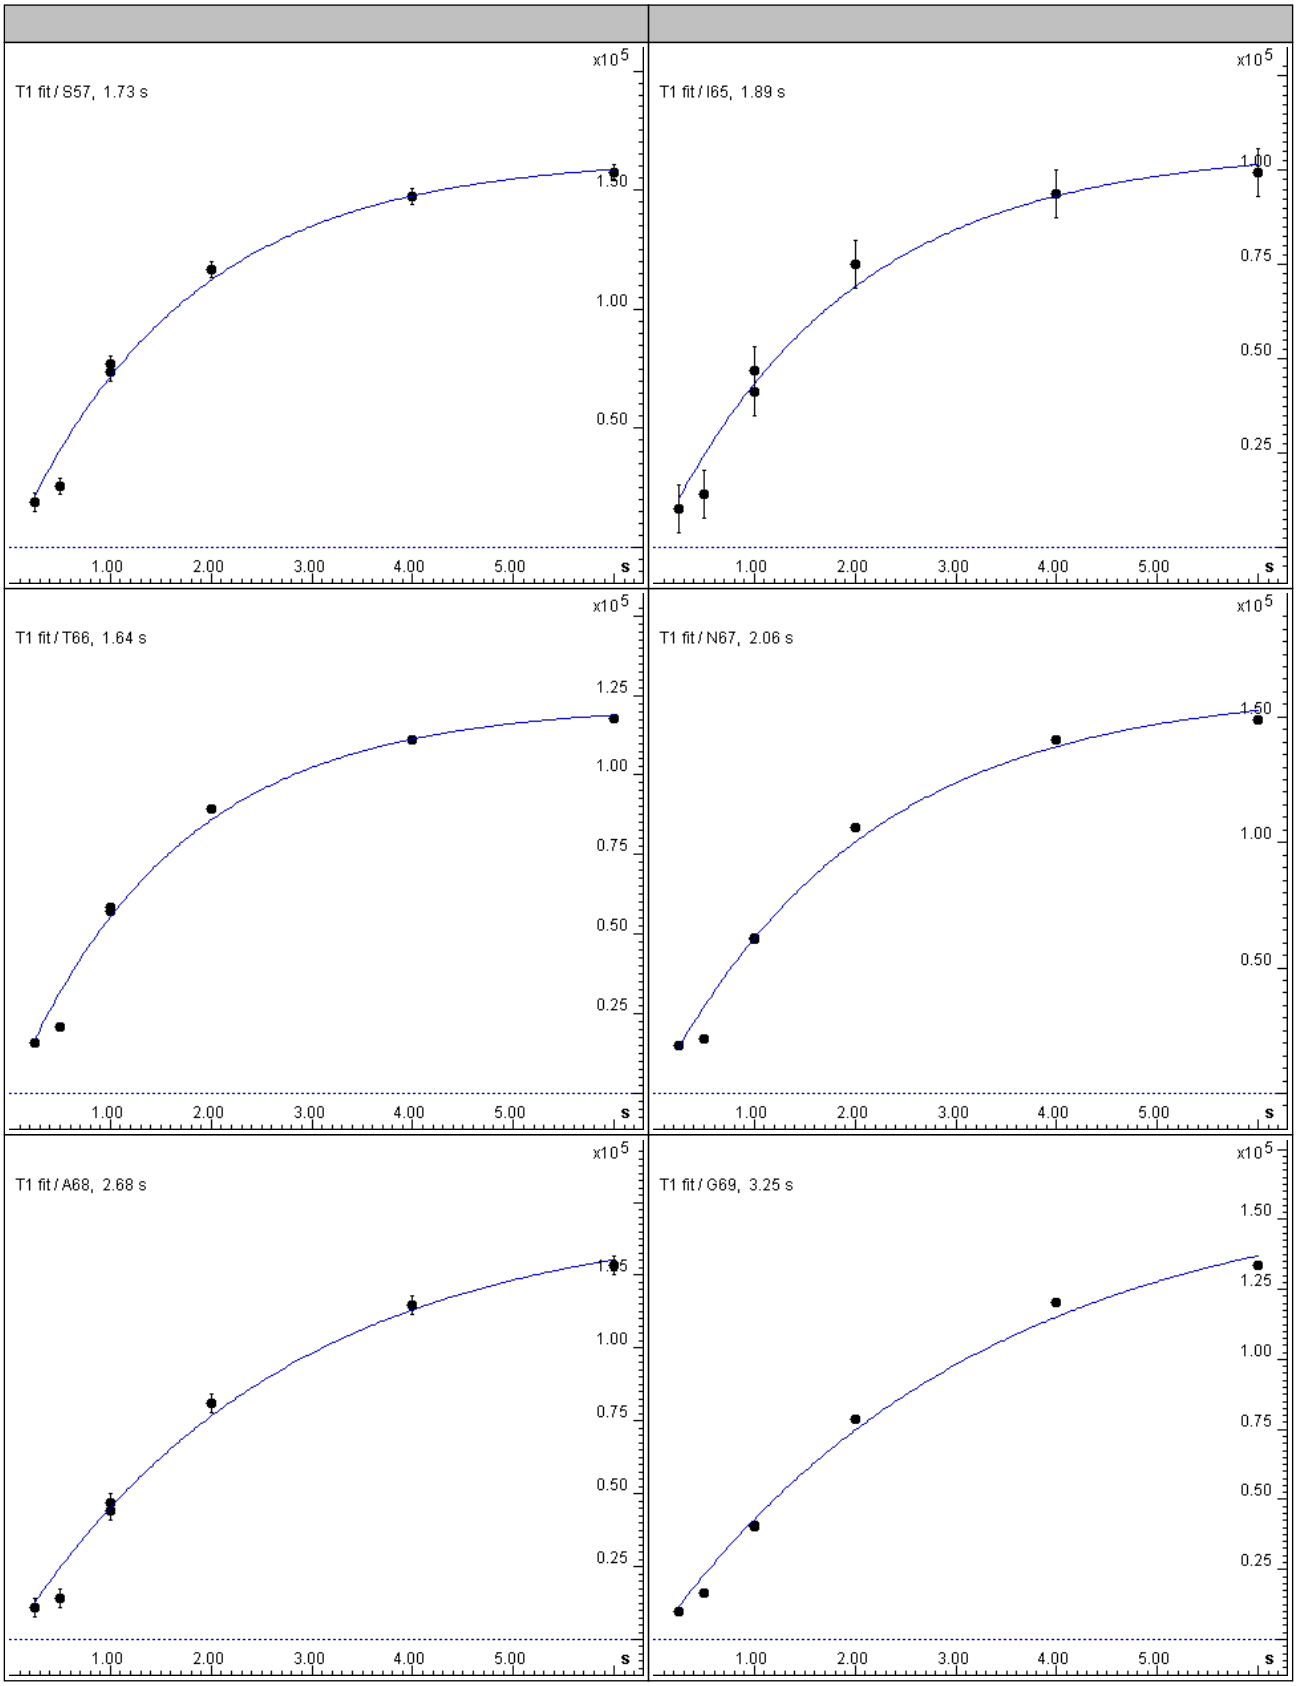

T1 fit / I24, 2.14 s
x10^5
1.25
1.00
0.75
0.50
0.25
1.00 2.00 3.00 4.00 5.00 s
T1 fit / V25, 1.87 s
x10^5
1.25
1.00
0.75
0.50
0.25
1.00 2.00 3.00 4.00 5.00 s
T1 fit / I26, 1.63 s
x10^5
1.00
0.75
0.50
0.25
1.00 2.00 3.00 4.00 5.00 s
T1 fit / K27, 1.67 s
x10^5
1.00
0.75
0.50
0.25
1.00 2.00 3.00 4.00 5.00 s
T1 fit / N28, 1.88 s
x10^5
1.00
0.75
0.50
0.25
1.00 2.00 3.00 4.00 5.00 s
T1 fit / S29, 1.75 s
x10^4
7.50
5.00
2.50
1.00 2.00 3.00 4.00 5.00 s

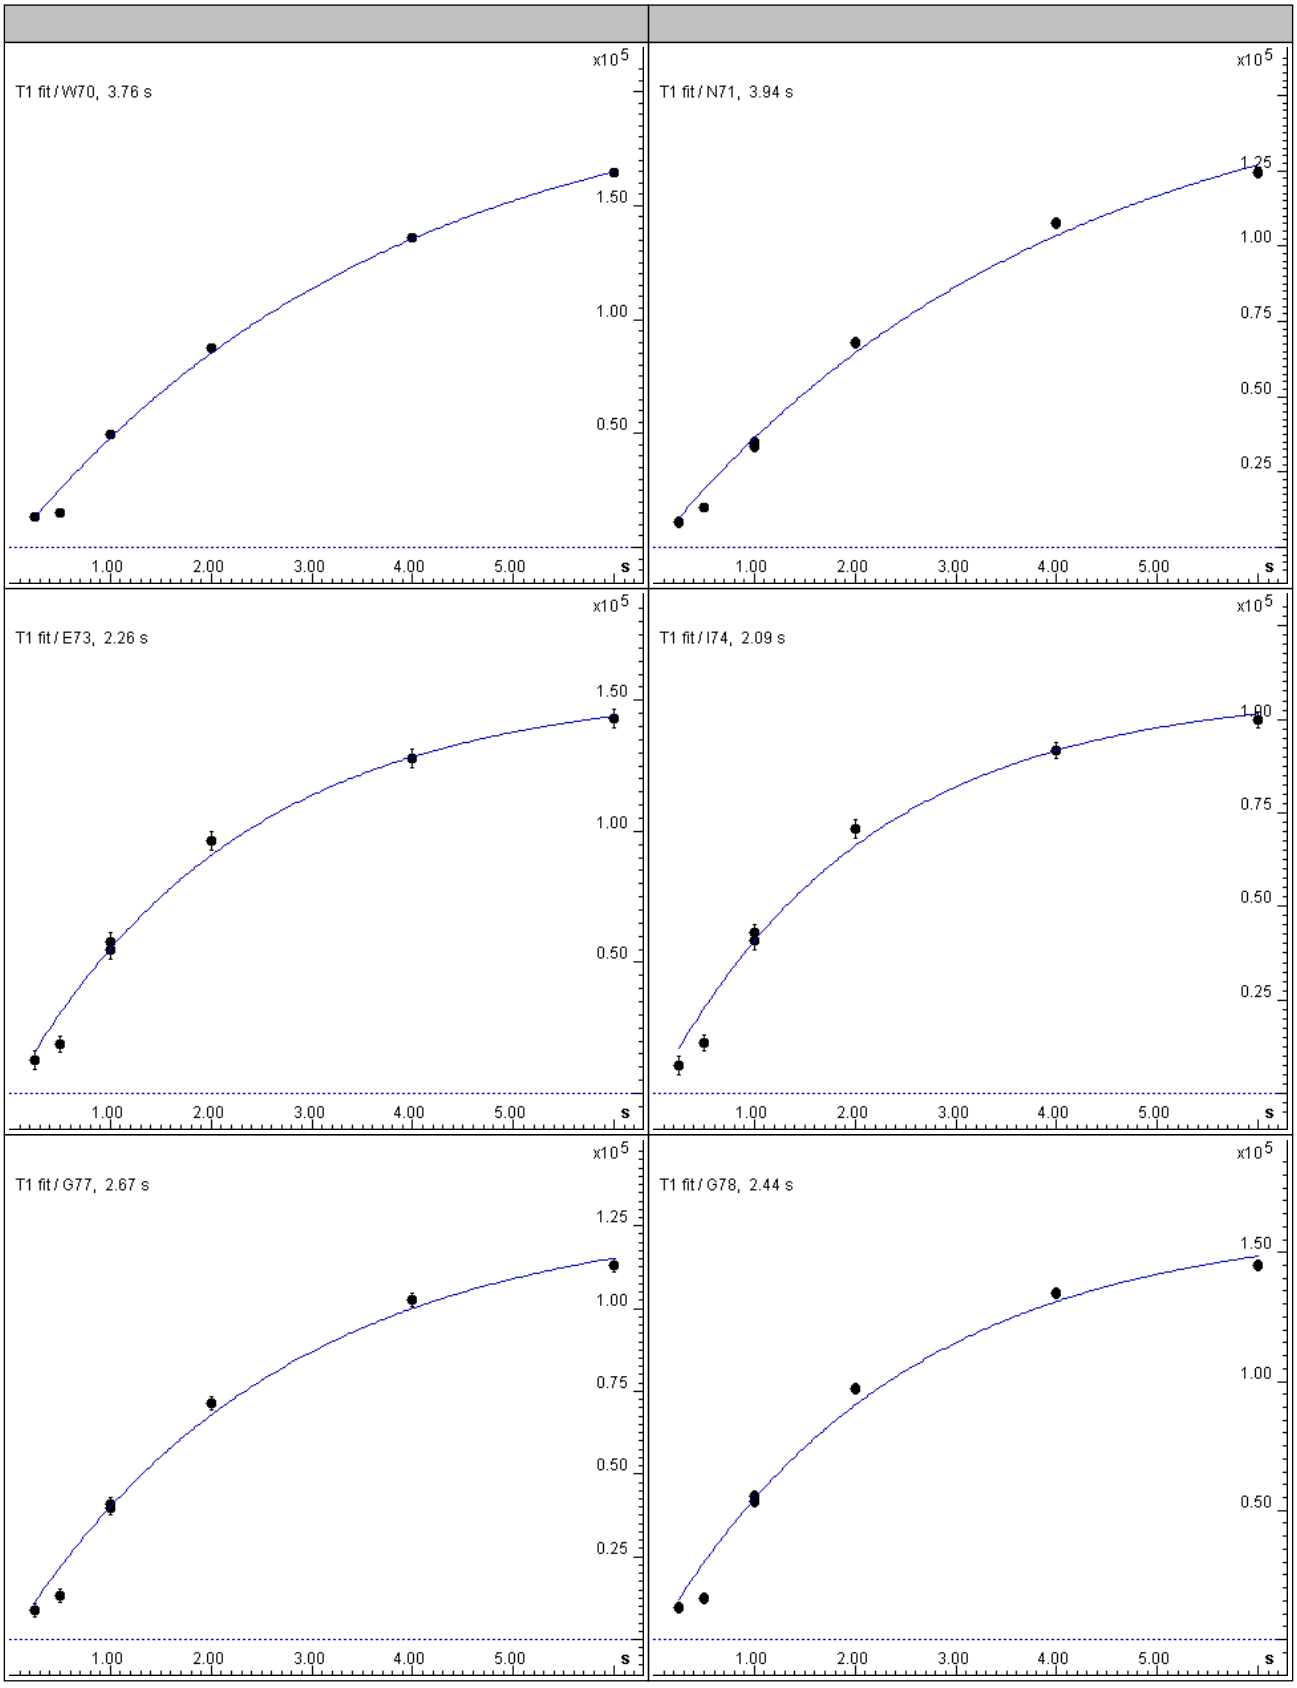

T1 fit / G30, 1.91 s
x10^5
1.25
1.00
0.75
0.50
0.25
1.00 2.00 3.00 4.00 5.00 s
T1 fit / T31, 1.58 s
x10^5
1.25
1.00
0.75
0.50
0.25
1.00 2.00 3.00 4.00 5.00 s
T1 fit / T32, 1.70 s
x10^5
1.50
1.00
0.50
1.00 2.00 3.00 4.00 5.00 s
T1 fit / I34, 2.16 s
x10^5
1.25
1.00
0.75
0.50
0.25
1.00 2.00 3.00 4.00 5.00 s
T1 fit / K35, 1.87 s
x10^4
6.00
5.00
4.00
3.00
2.00
1.00
1.00 2.00 3.00 4.00 5.00 s
T1 fit / N36, 2.06 s
x10^5
1.00
0.75
0.50
0.25
1.00 2.00 3.00 4.00 5.00 s

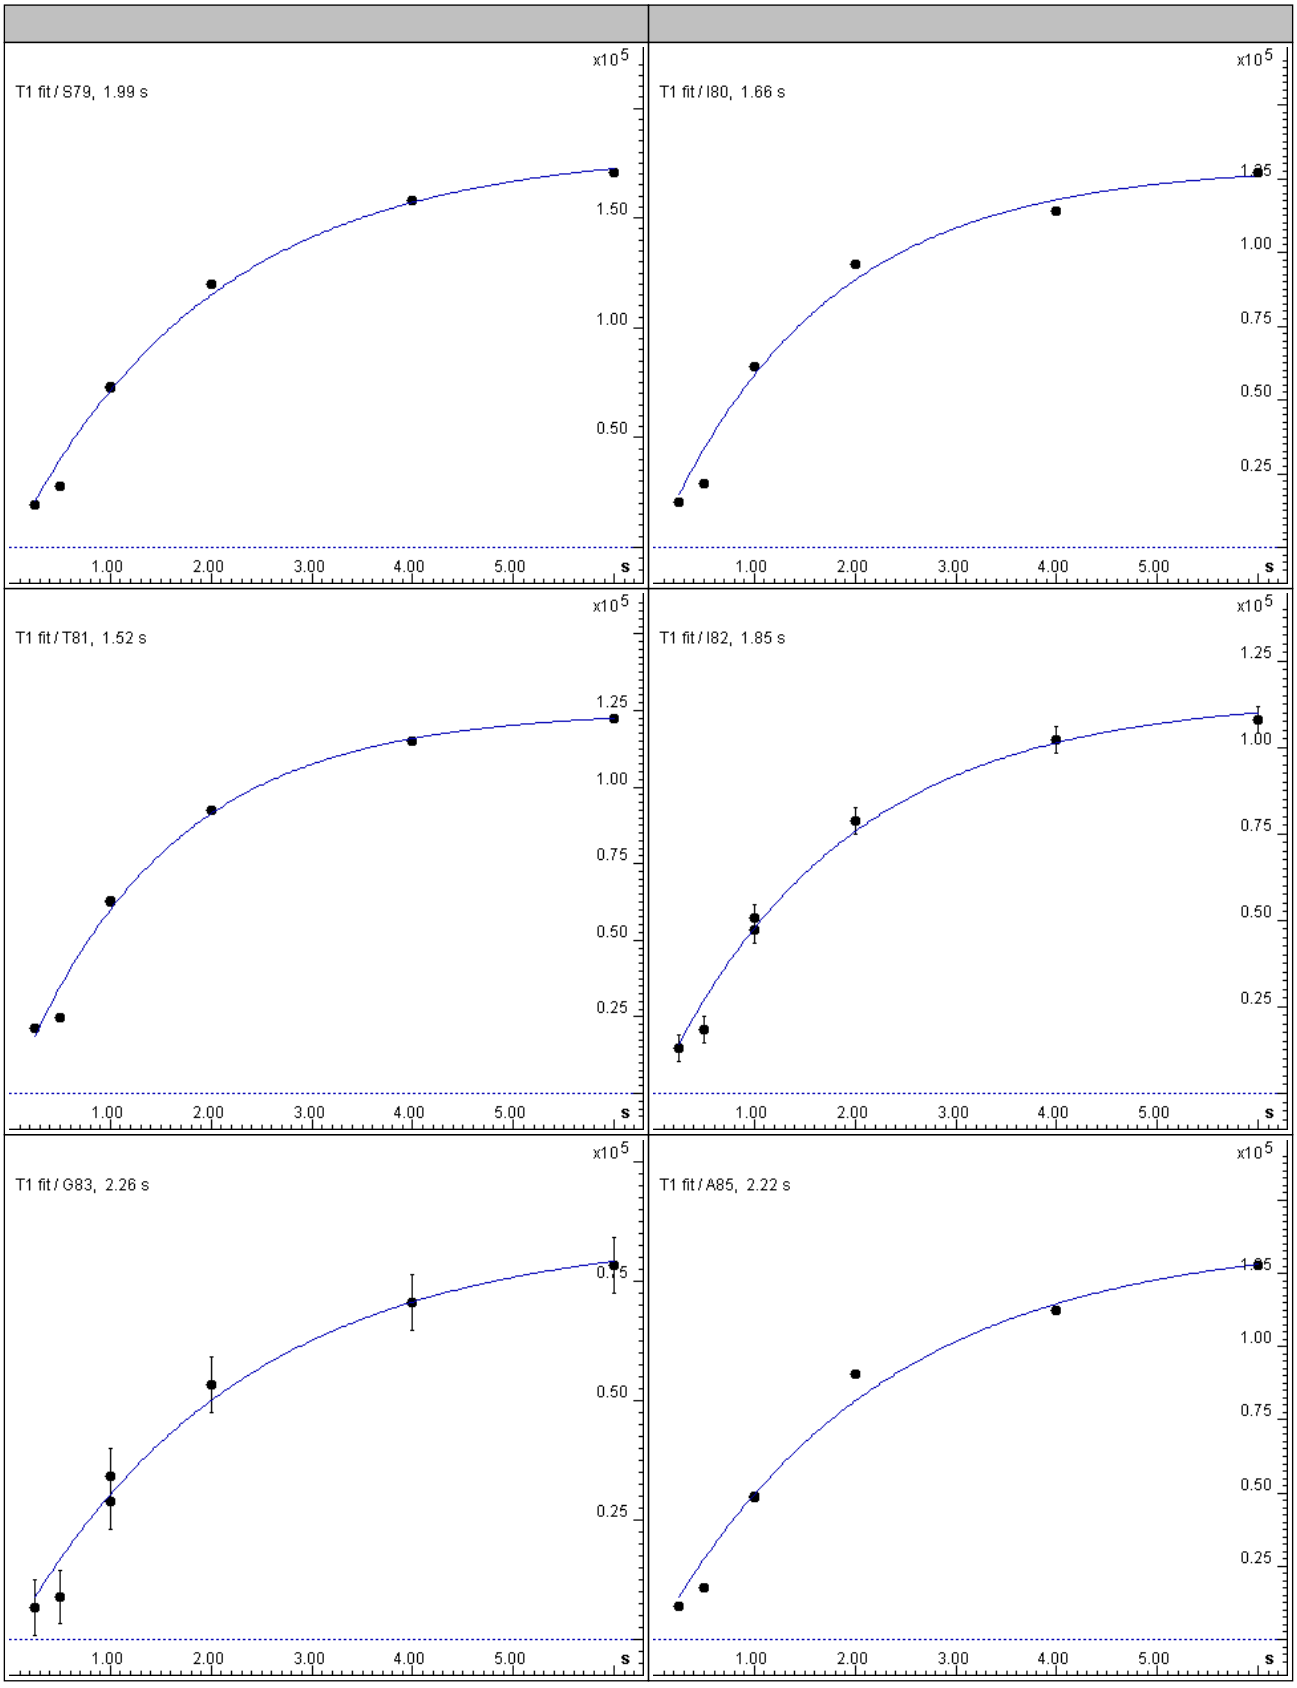

T1 fit / W37, 2.32 s
T1 fit / K38, 2.14 s
T1 fit / L39, 1.92 s
T1 fit / E40, 1.80 s
T1 fit / F41, 2.20 s
T1 fit / D42, 2.16 s
x10^5
s

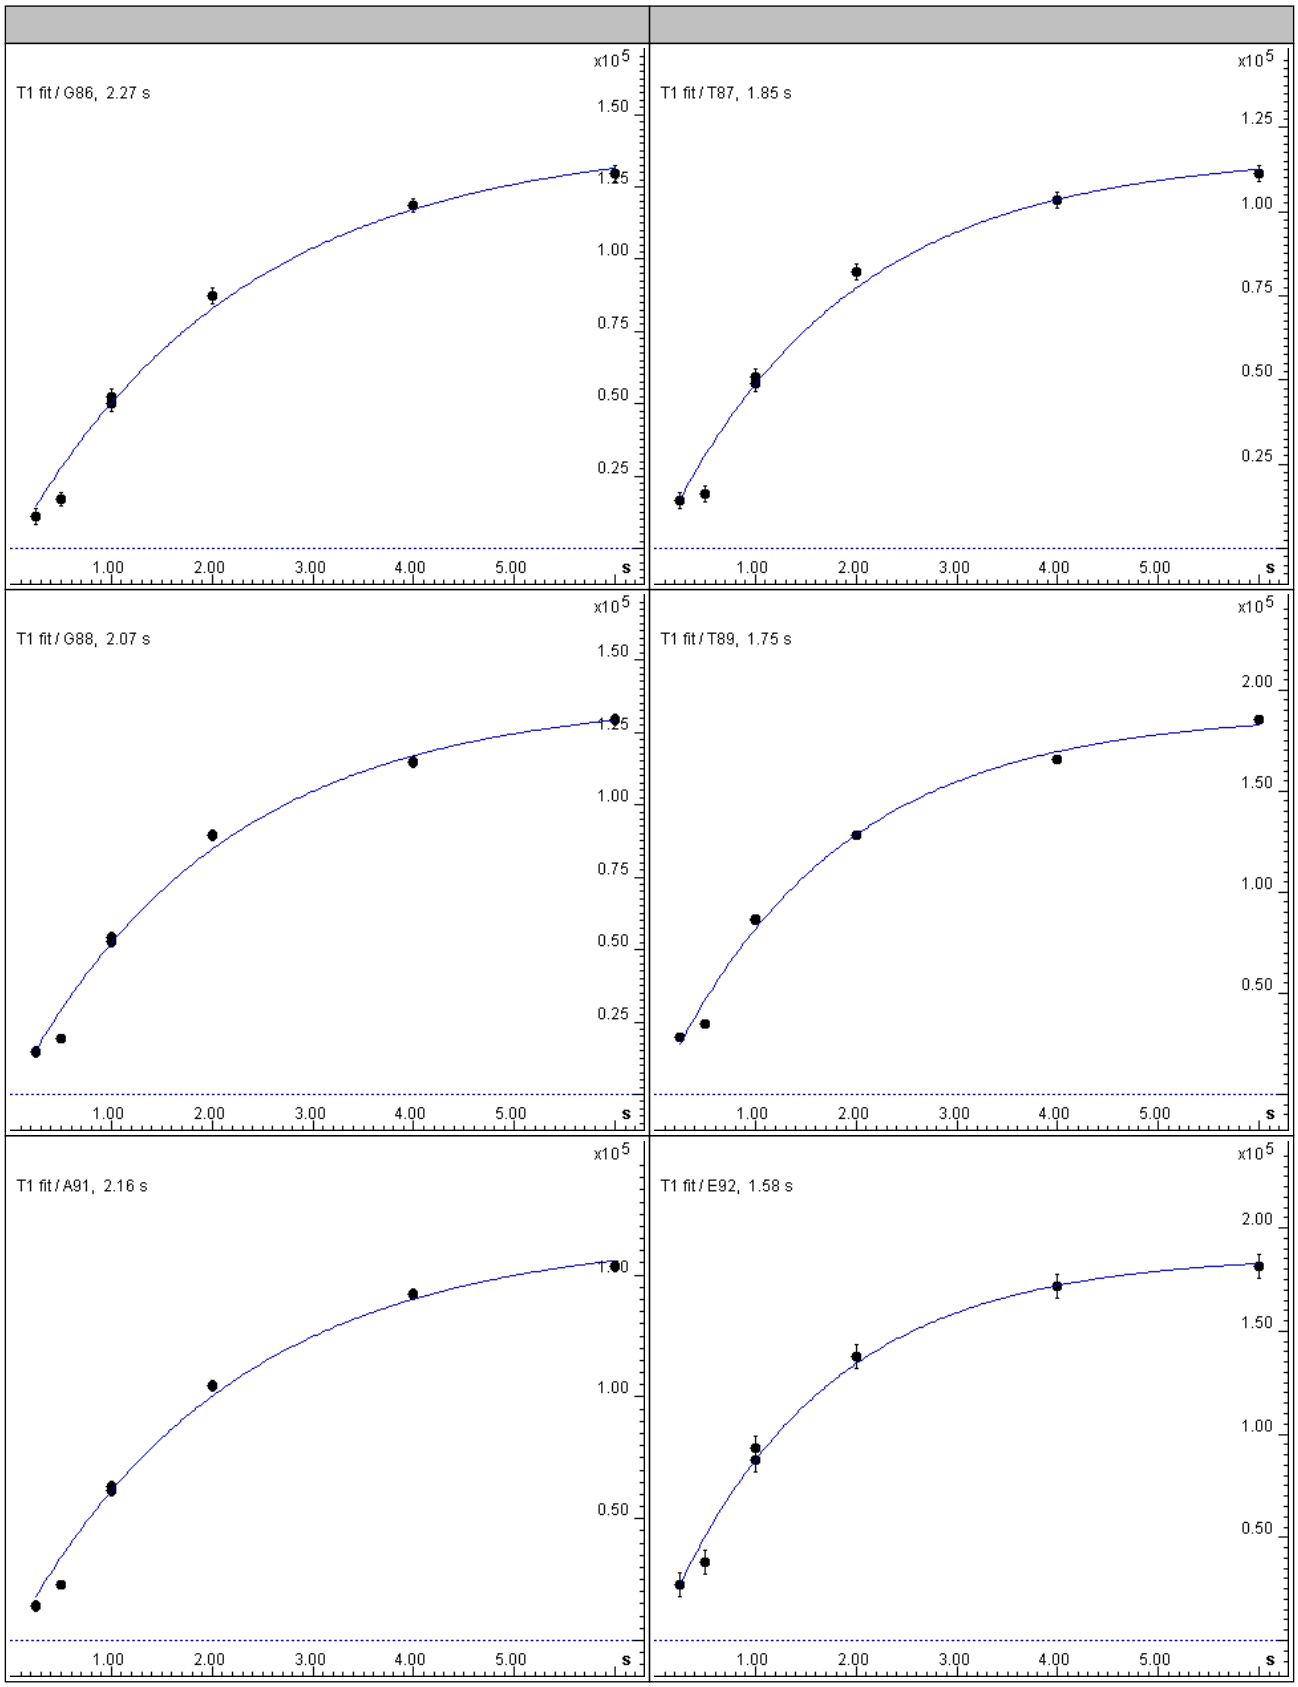

T1 fit / N44, 1.83 s
x10^5
2.00
1.50
1.00
0.50
1.00 2.00 3.00 4.00 5.00 s
T1 fit / G45, 1.91 s
x10^4
7.50
5.00
2.50
1.00 2.00 3.00 4.00 5.00 s
T1 fit / N46, 1.57 s
x10^5
1.00
0.75
0.50
0.25
1.00 2.00 3.00 4.00 5.00 s
T1 fit / L47, 1.55 s
x10^5
0.75
0.50
0.25
1.00 2.00 3.00 4.00 5.00 s
T1 fit / T48, 1.81 s
x10^5
1.00
0.75
0.50
0.25
1.00 2.00 3.00 4.00 5.00 s
T1 fit / Q49, 1.76 s
x10^5
2.00
1.50
1.00
0.50
1.00 2.00 3.00 4.00 5.00 s

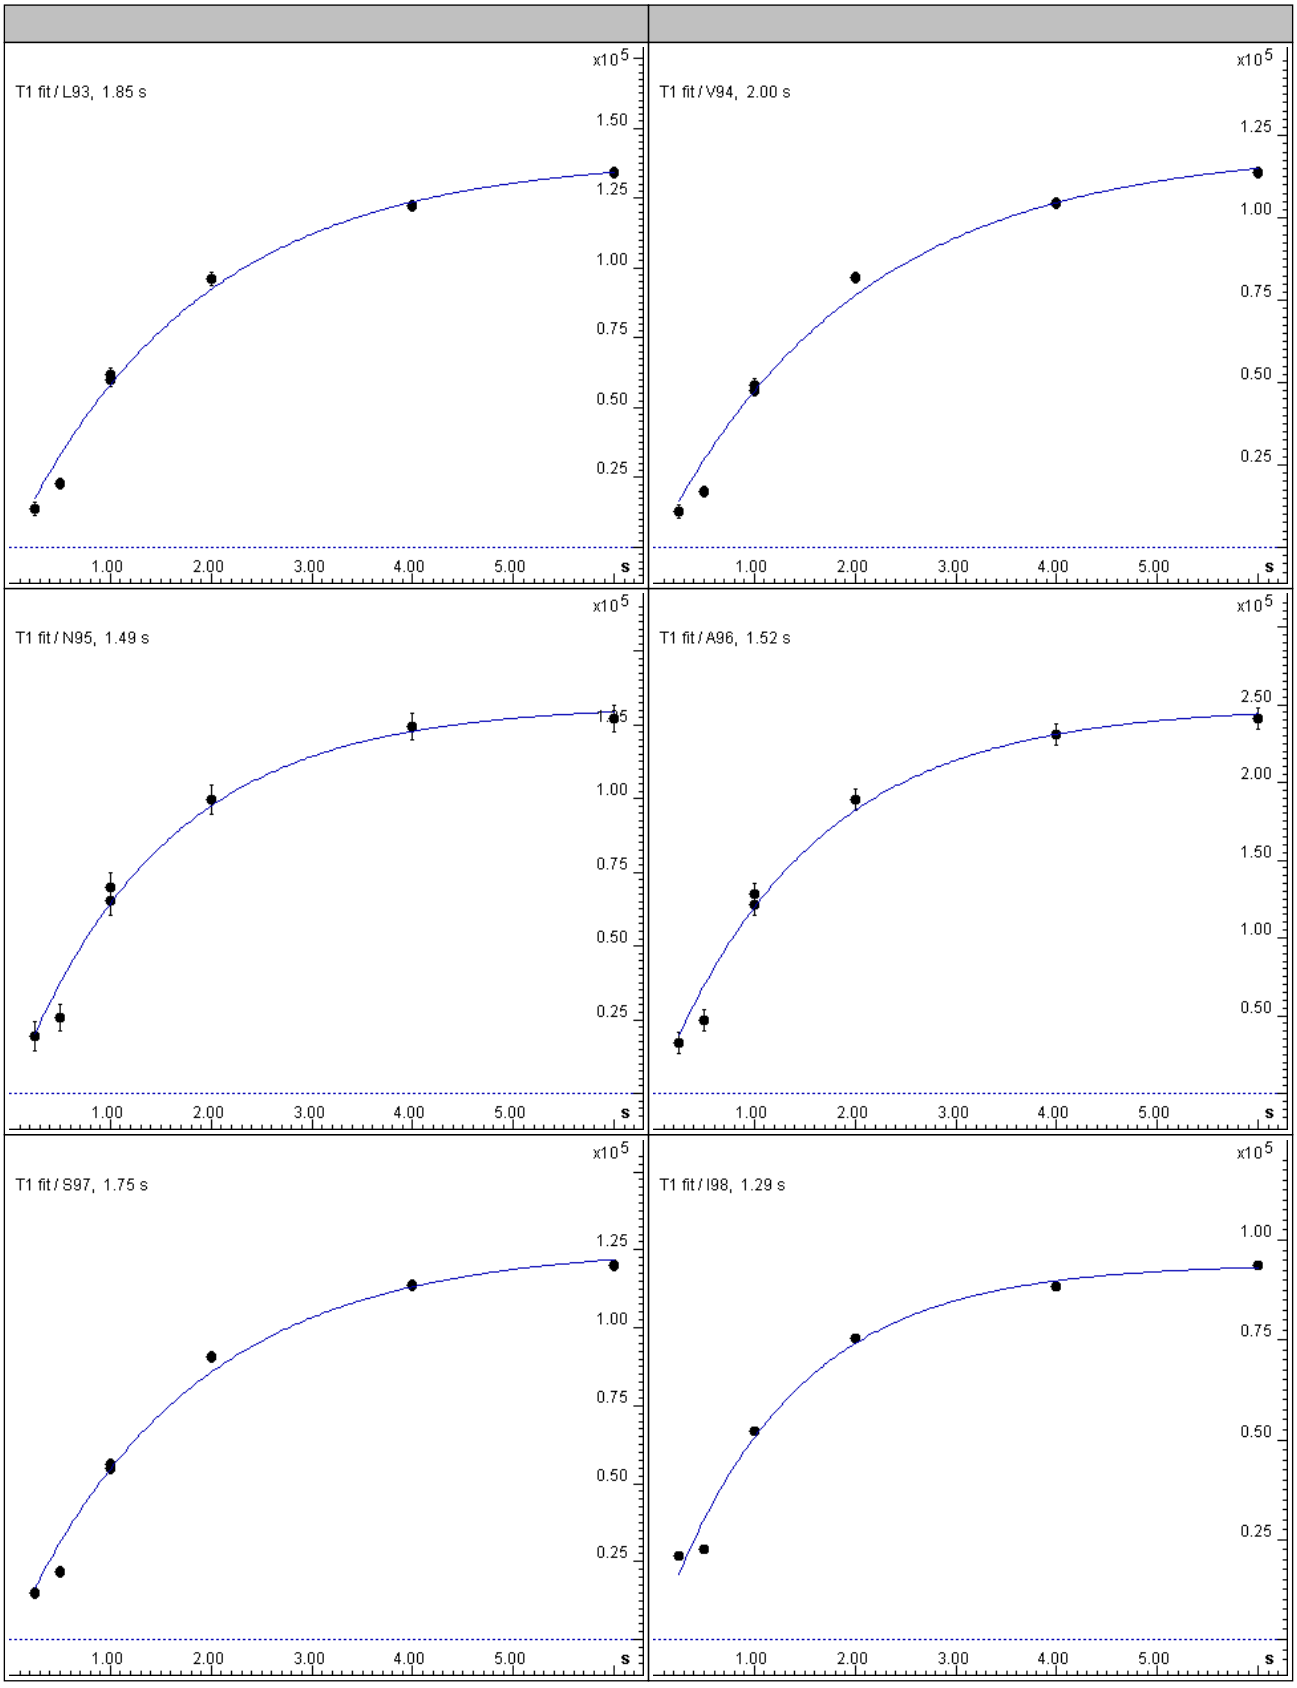

T1 fit / V50, 1.27 s
T1 fit / W51, 1.99 s
T1 fit / D52, 2.41 s
T1 fit / K54, 1.74 s
T1 fit / I55, 1.50 s
T1 fit / S56, 1.82 s
x10^5
s

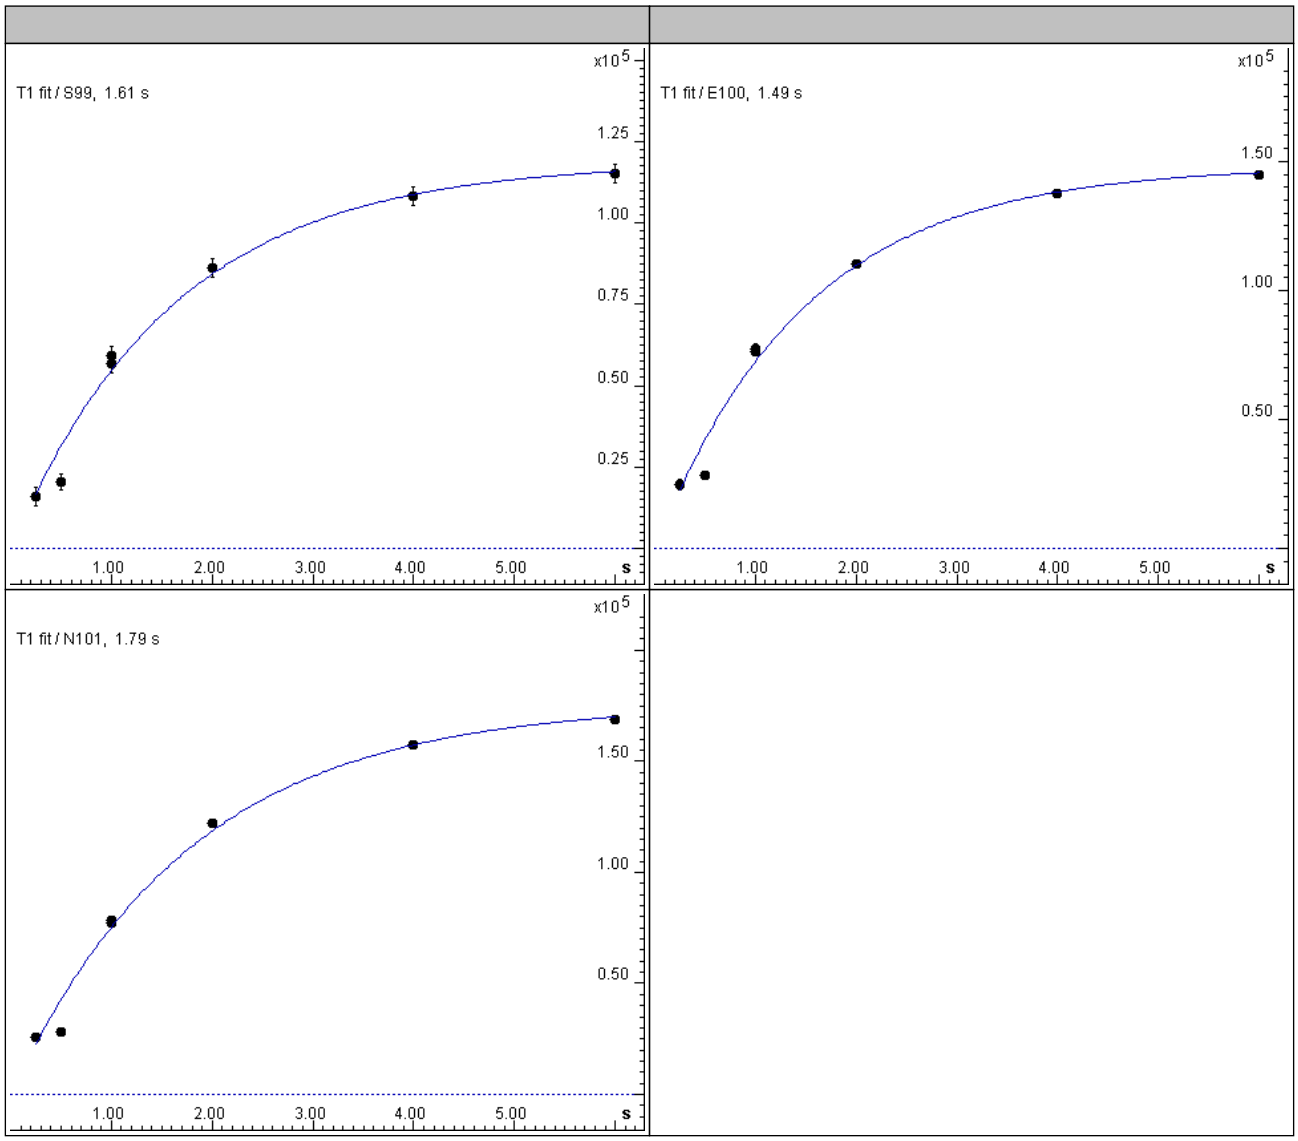

T1 fit / S57, 1.73 s
T1 fit / I65, 1.89 s
T1 fit / T66, 1.64 s
T1 fit / N67, 2.06 s
T1 fit / A68, 2.68 s
T1 fit / G69, 3.25 s
x10^5
s


T1 fit / W70, 3.76 s
T1 fit / N71, 3.94 s
T1 fit / E73, 2.26 s
T1 fit / I74, 2.09 s
T1 fit / G77, 2.67 s
T1 fit / G78, 2.44 s
x10^5
s


T1 fit / S79, 1.99 s
T1 fit / I80, 1.66 s
T1 fit / T81, 1.52 s
T1 fit / I82, 1.85 s
T1 fit / G83, 2.26 s
T1 fit / A85, 2.22 s
x10 5
s


T1 fit / G86, 2.27 s
T1 fit / T87, 1.85 s
T1 fit / G88, 2.07 s
T1 fit / T89, 1.75 s
T1 fit / A91, 2.16 s
T1 fit / E92, 1.58 s
x10^5
s


T1 fit / L93, 1.85 s
T1 fit / V94, 2.00 s
T1 fit / N95, 1.49 s
T1 fit / A96, 1.52 s
T1 fit / S97, 1.75 s
T1 fit / I98, 1.29 s
x10^5
s


T1 fit / S99, 1.61 s
x10^5
1.25
1.00
0.75
0.50
0.25
1.00
2.00
3.00
4.00
5.00
s
T1 fit / E100, 1.49 s
x10^5
1.50
1.00
0.50
1.00
2.00
3.00
4.00
5.00
s
T1 fit / N101, 1.79 s
x10^5
1.50
1.00
0.50
1.00
2.00
3.00
4.00
5.00
s