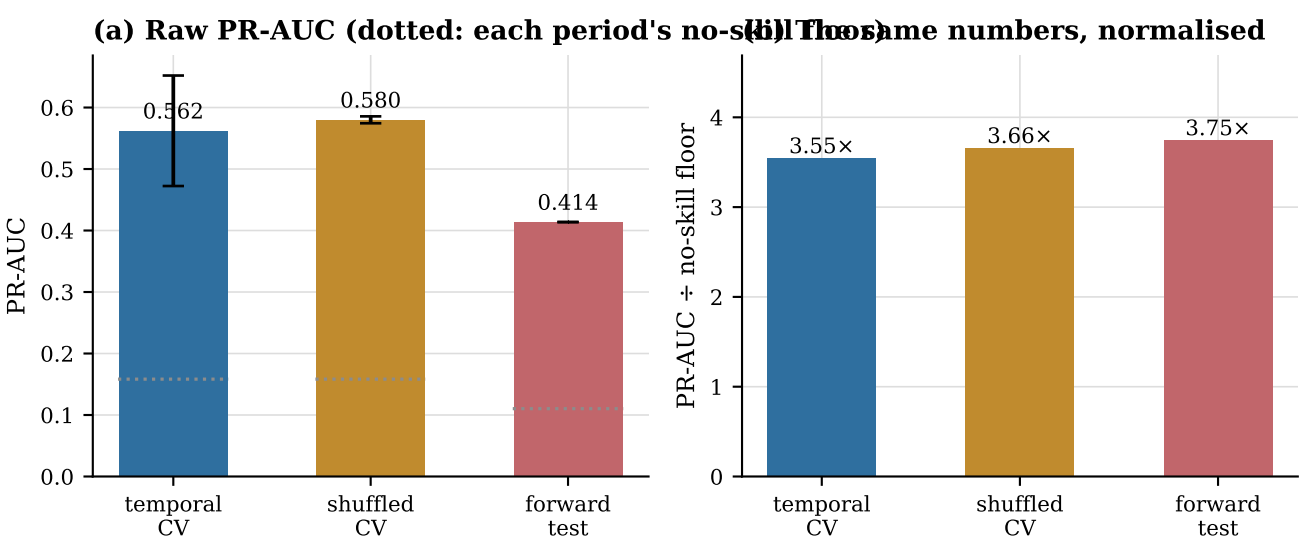
(a) Raw PR-AUC (dotted: each period's no-skill floor)
(b) The same numbers, normalised
PR-AUC
0.0
0.1
0.2
0.3
0.4
0.5
0.6
0.562
0.580
0.414
temporal CV
shuffled CV
forward test
PR-AUC ÷ no-skill floor
0
1
2
3
4
3.55×
3.66×
3.75×
temporal CV
shuffled CV
forward test