
Electron Planck-link audit: phi^-18 -> phi^-108 -> phi^-107 -> (1-5 alpha)

Exponent ladder

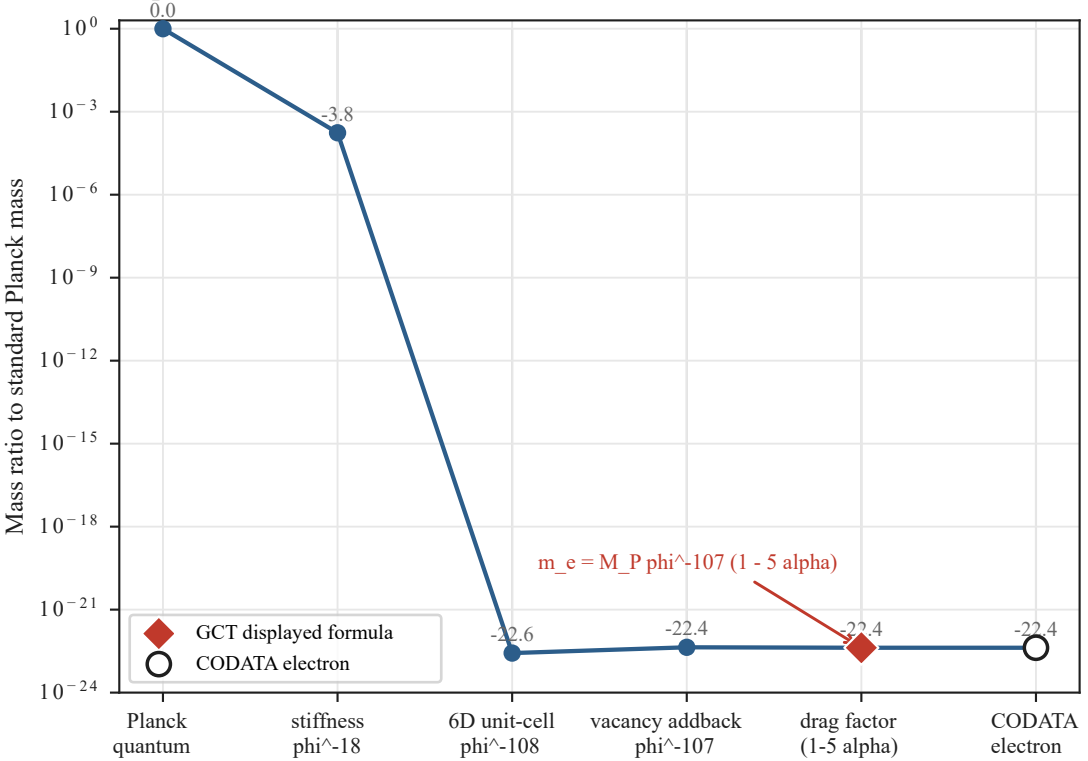

Audit gates

H3 integer	1^2 + 5^2 + 9^2 = 107
Coxeter sweep	unique finite hit for 107
Mass residual	1006 ppm vs CODATA
LOCKED rule	1000 ppm (missed)
Physical link	O.14 remains open

Reading: the ladder misses the LOCKED 1000 ppm threshold (1006 ppm); the 6D AKN K0 / Dixmier-residue physical link is also not closed.

Sources: Ch07 §7.2.2; protocol_exponent_derivation_results.json; protocol_o14_coxeter_exponent_squares_results.json.