
batmonitor 0.78-py - decision flow 1 / 6: D1 - Sofar first, S3 source of the discharge, winter heat pump rule


from bm_decisions.dmn: each table is asked row by row, top to bottom; the first row that matches decides (yes -> its result, no -> the next row)

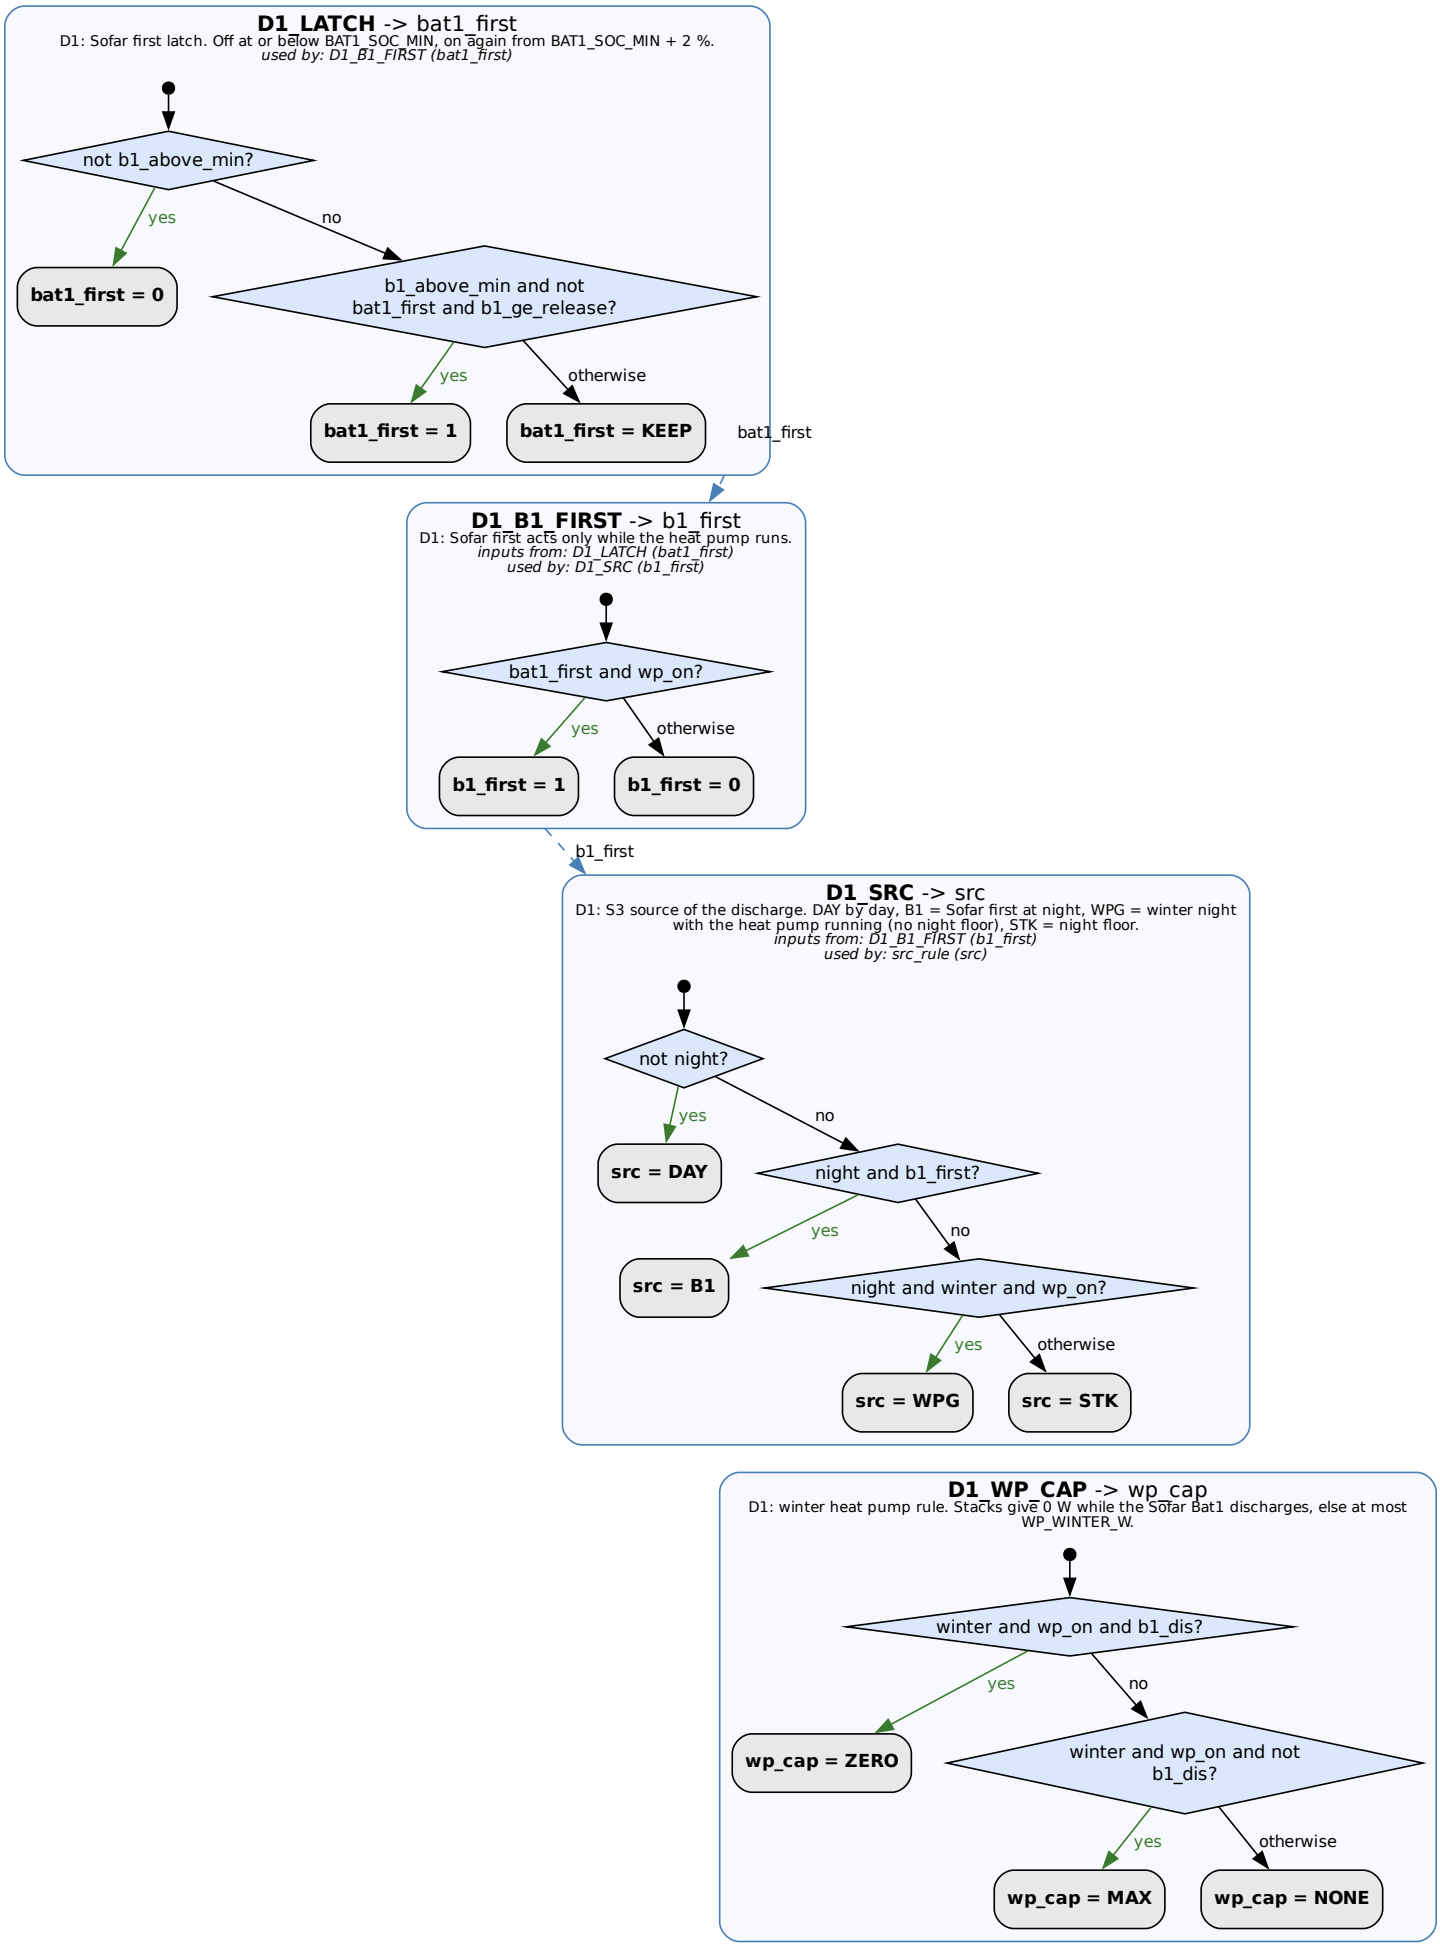

batmonitor 0.78-py - decision flow 2 / 6: D2 - charge mode and the latches protection / force charge / LOW (one bank)
from bm_decisions.dmn: each table is asked row by row, top to bottom; the first row that matches decides (yes -> its result, no -> the next row)


D2_CHARGE_MODE -> charge_mode

D2: charge mode on the surplus (> 200 W), held down to 20 W once charging.
used by: D2_MODE (charge_mode)

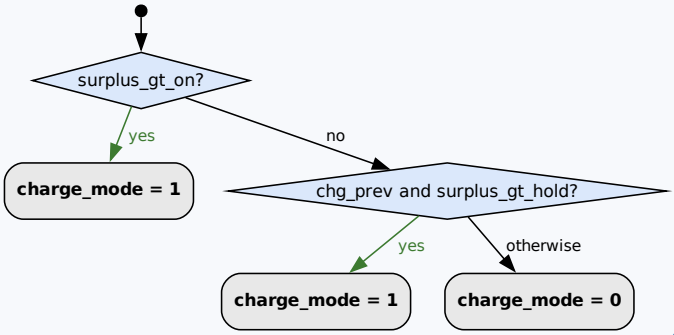


D2_PROT -> prot

D2: SoC protection, SOC_MIN .. SOC_MIN_RELEASE (only while the BMS reports).
used by: D2_MODE (prot)

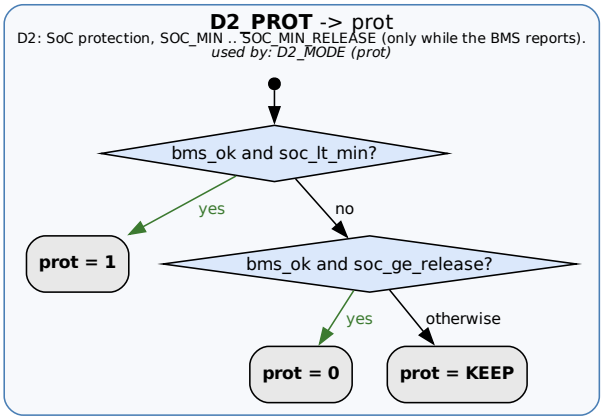


D2_FORCE -> force

D2: grid force charge, SOC_FORCE .. SOC_FORCE_RELEASE.
used by: D2_MODE (force)

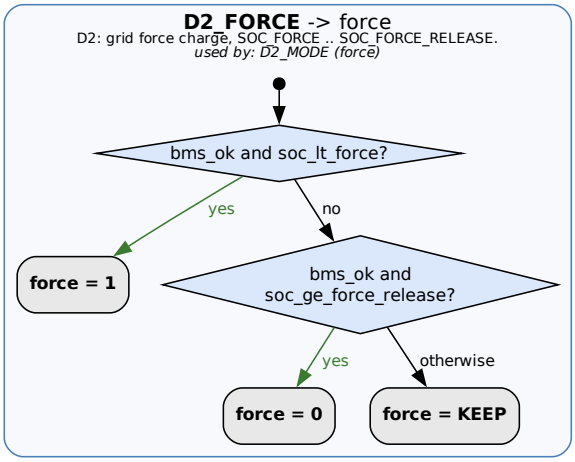

D2_LOW -> low

D2: LOW force charge: DCL 0 or lowest cell < CELL_FORCE_V; ends once DCL is back, the cell >= CELL_FORCE_RELEASE_V and the SoC >= SOC_MIN_RELEASE.
used by: D2_MODE (low)

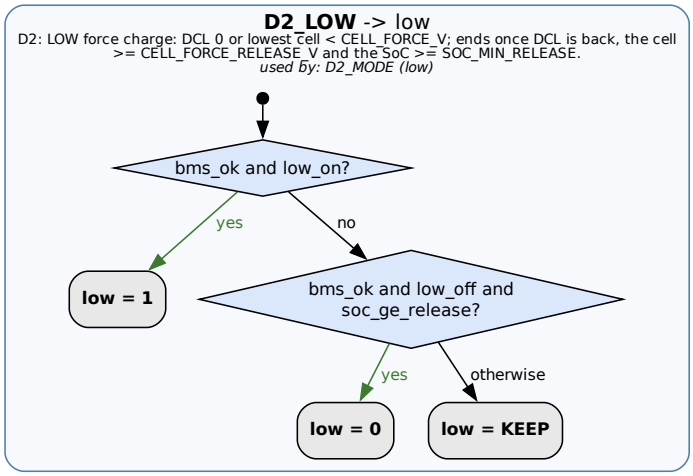

batmonitor 0.78-py - decision flow 3 / 6: D2 - mode of the bank (priority top to bottom)


from bm_decisions.dmn: each table is asked row by row, top to bottom; the first row that matches decides (yes -> its result, no -> the next row)

D2_MODE -> mode

D2: mode of the battery, priority from top to bottom (force / low / prot = the latches above, ff = force_full_from_pv is on). 0.77-py: one bank (both stacks parallel), charged only up to the Pytes limit: no top hold window any more, SoC 100 % of the Pytes BMS = FULL.


inputs from: D2_CHARGE_MODE (charge_mode), D2_PROT (prot), D2_FORCE (force), D2_LOW (low), D4 (block)

used by: mode_rule (mode)

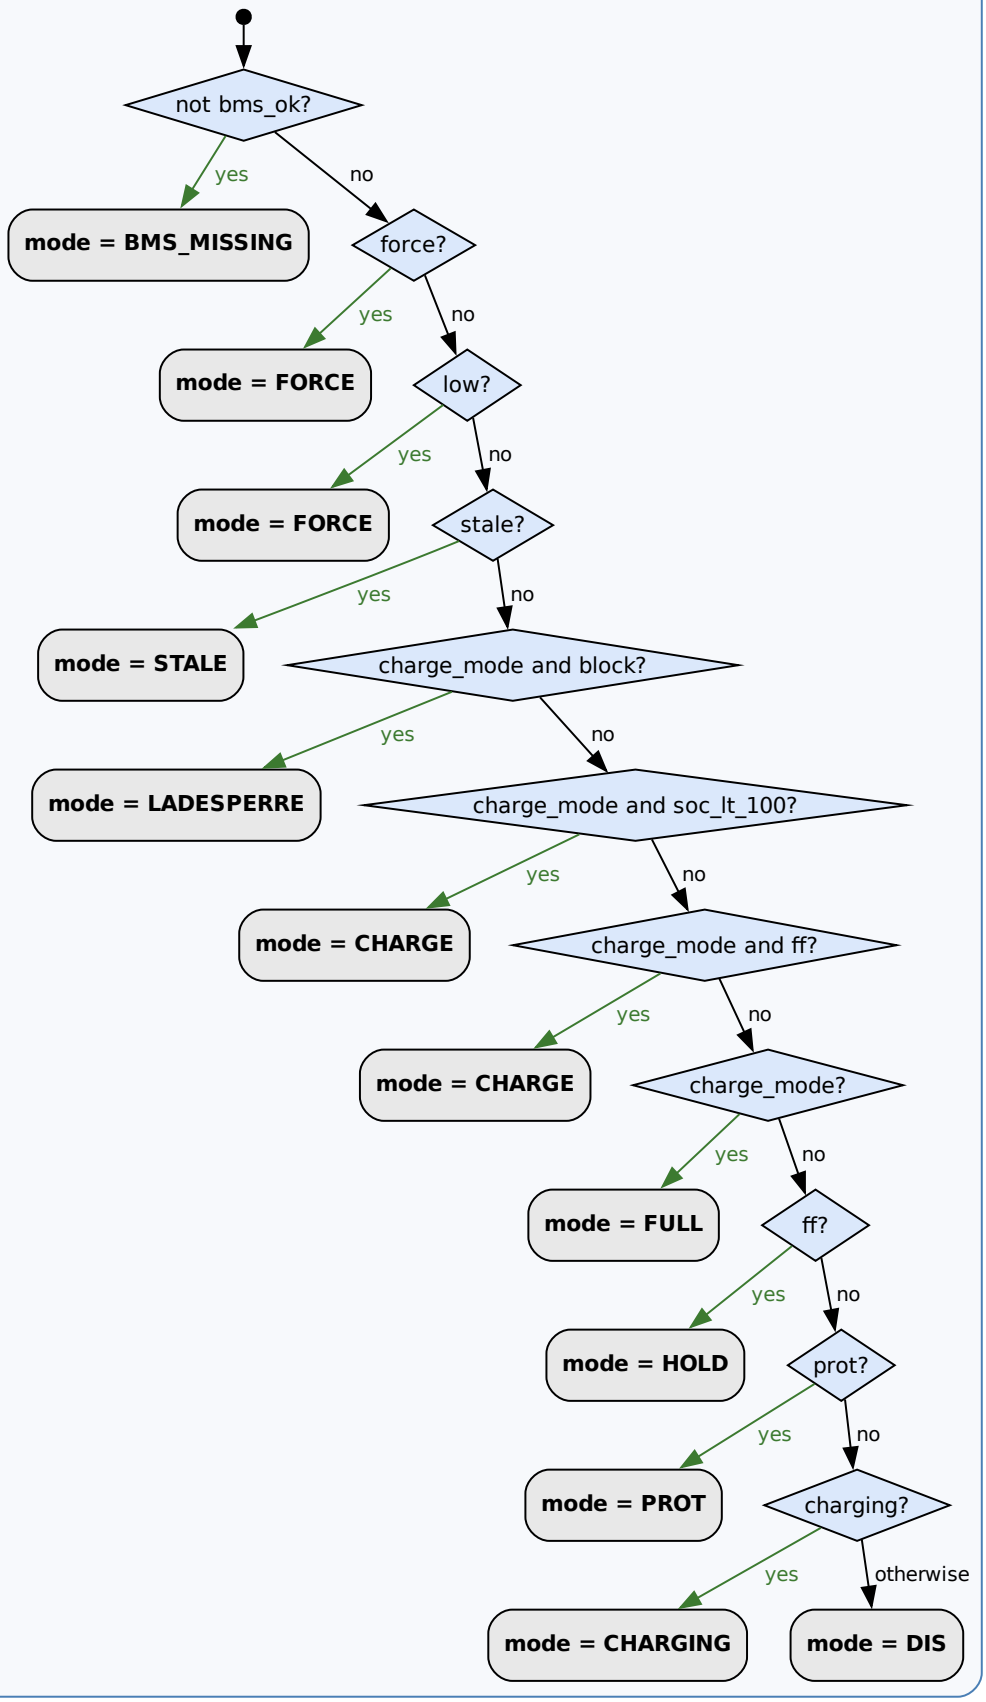


batmonitor 0.78-py - decision flow 4 / 6: D3 - discharge PROP / IDLE


from bm_decisions.dmn: each table is asked row by row, top to bottom; the first row that matches decides (yes -> its result, no -> the next row)

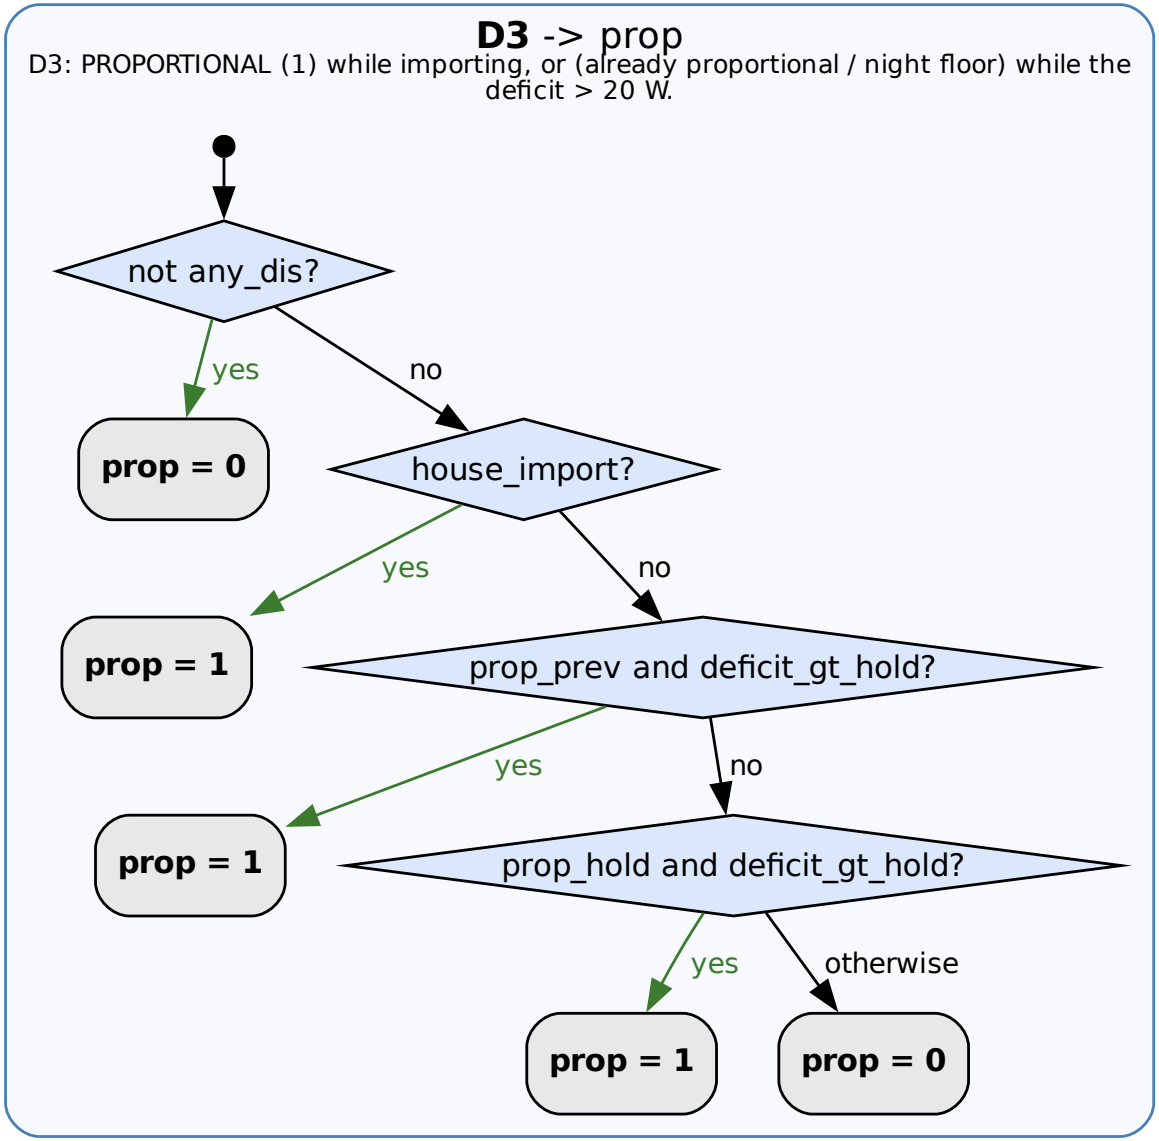

batmonitor 0.78-py - decision flow 5 / 6: D4 - summer peak window

from bm_decisions.dmn: each table is asked row by row, top to bottom; the first row that matches decides (yes -> its result, no -> the next row)

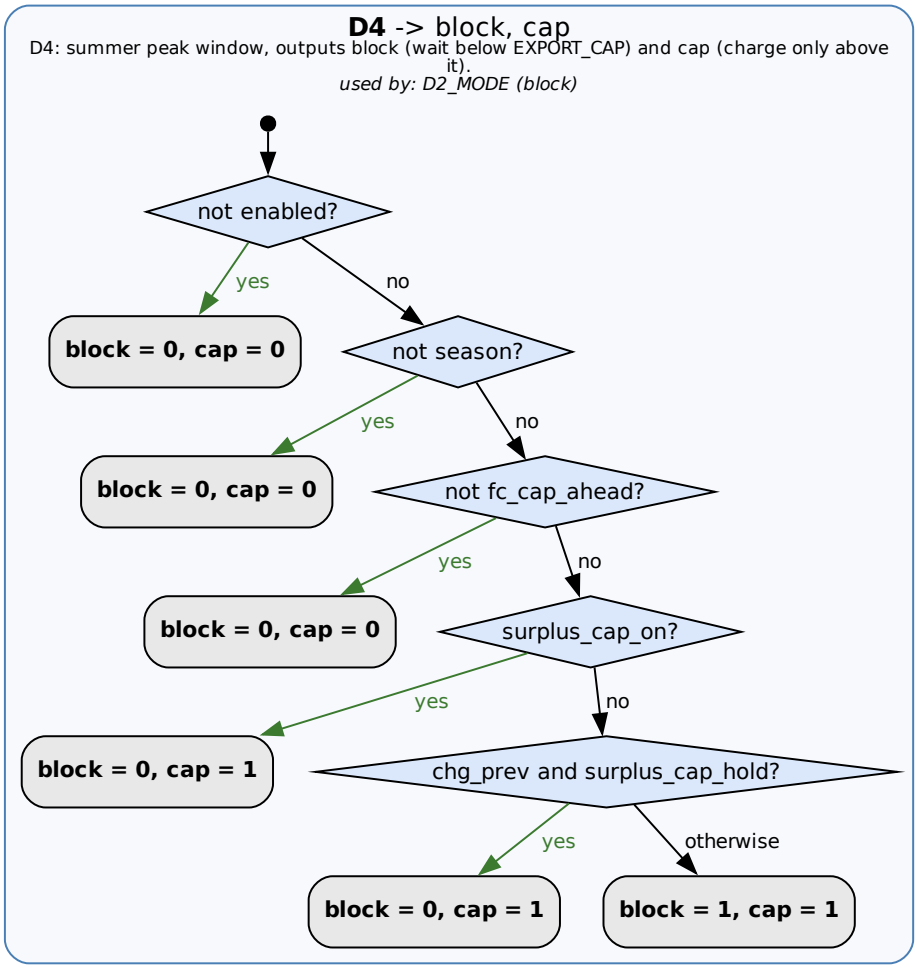

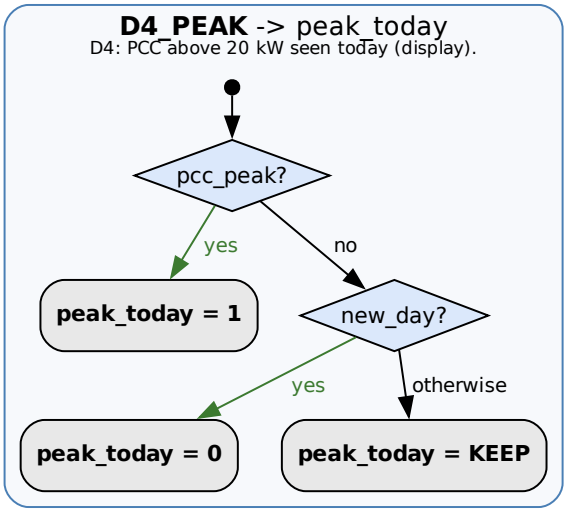


batmonitor 0.78-py - decision flow 6 / 6: D5 - DO4 pulse, D7 - house on AC-out1

from bm_decisions.dmn: each table is asked row by row, top to bottom; the first row that matches decides (yes -> its result, no -> the next row)

D5 -> do4

D5: DO4 pulse (FoxESS shedding): PCC > 20 kW for the grace time or > DO4_HARD_W, or grid offline and PV overfeeds one AC-out; never twice within the lockout.

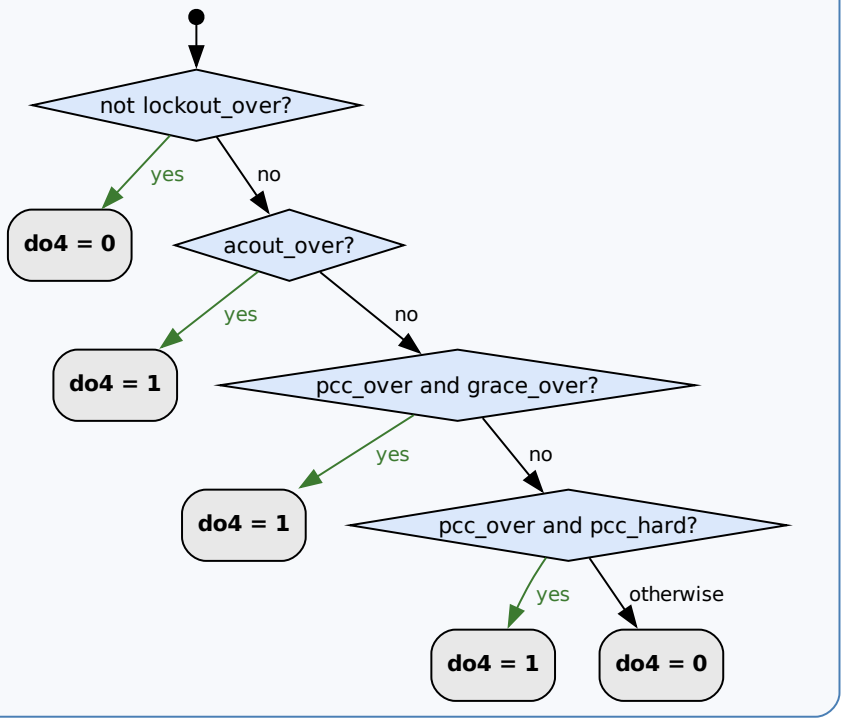

D7 -> on, under

D7: house on AC-out1. HOUSE_ACOUT 0 = off, 1 = on, auto: on above 99 W, off after 60 s below 30 W.

