batmonitor 0.74: D1 source (BM_SRC_RULE row) and the winter heat pump rule - charge and discharge on the real PCC, target 0 W
make check: 128 cells (6 bits x bat1_first), DAY 64 · B1 12 · STK 42 · WPG 10; wp_cap none 96 · zero 16 · max 16; all rows reachable

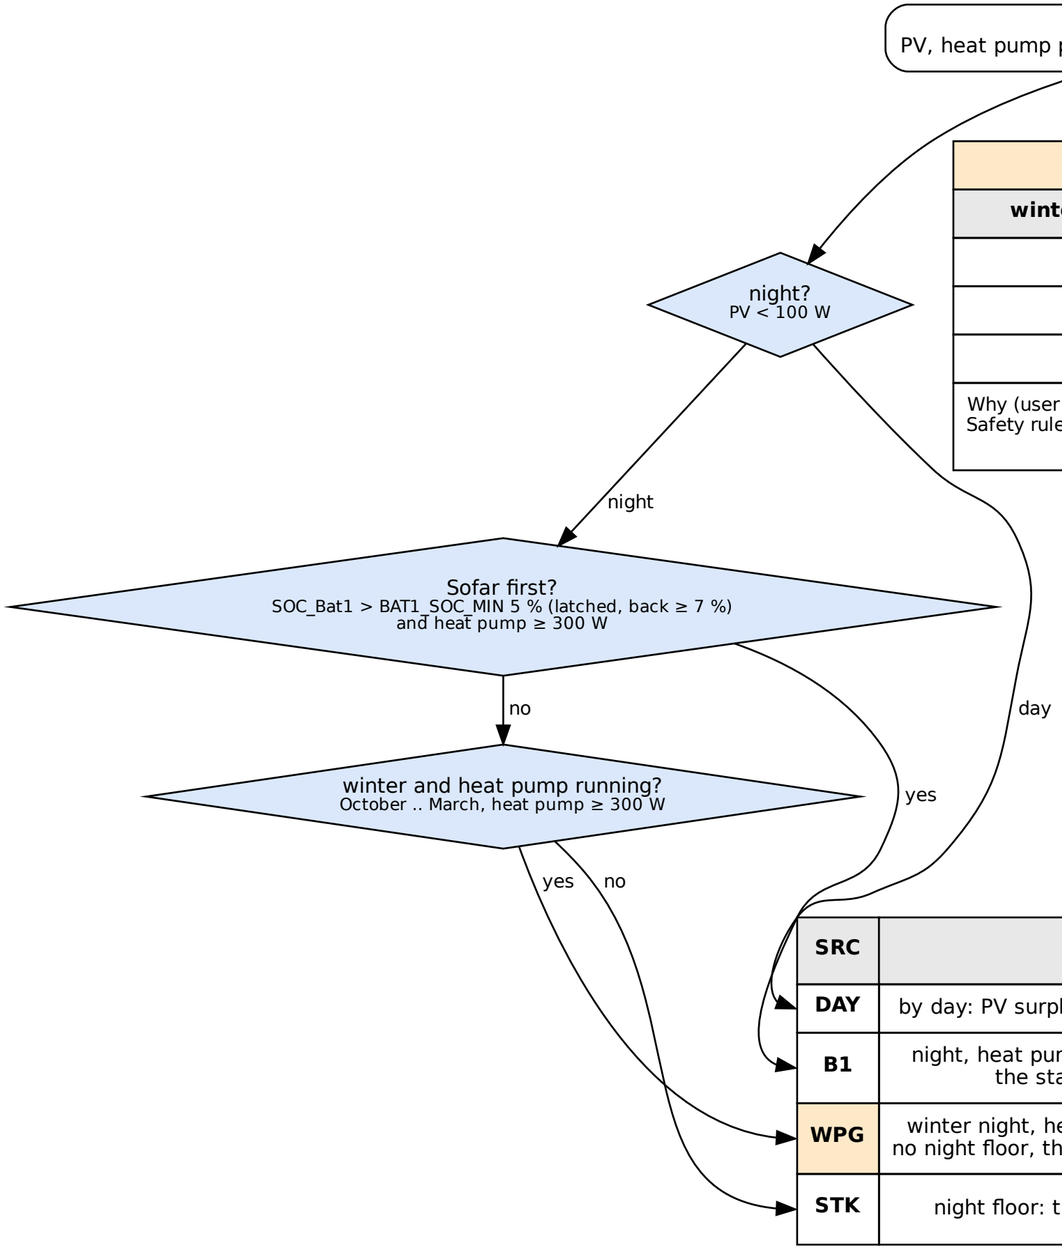

winter heat pump rule (D1_WP_CAP, 0.61-c, any time of day): discharge ceiling of the stacks		
winter + heat pump running	**Sofar Bat1**	**stacks give at most**
yes	discharges (< -100 W)	**0 W** rule text WPMAX(0)
yes	does not discharge	**WP_WINTER_W** (default 1000, Lenggries env 100) WPMAX(100)
no	-	W_MAX (no rule)

Why (user 2026-10-25): the heat pump tariff is 22 ct/kWh, stack energy is recharged at 30 ct/kWh - the stacks do not support the heat pump while the Sofar can.
Safety rules unchanged: SOC_MIN / release, LOW force charge (DCL 0 or cell < CELL_FORCE_V), BMS CCL / DCL, 3800 W per phase; D4 export cap, DO4 > 20 kW.
Removed: WP_SOC_MIN / WPLOW (0.61-c), the Z2 winter rule, transition cap, forecast rule, WPPV, WP_CAP (0.59-c).

SRC	meaning	Sofar Bat1 discharge counts	target	idle W	PROP hold	make check
DAY	by day: PV surplus charges, import is discharged	no	PCC 0	20	no	64
B1	night, heat pump running: the Sofar Bat1 first, the stacks only what it leaves	no	PCC 0	20	no	12
WPG	winter night, heat pump running, no Sofar first: no night floor, the heat pump rule caps the stacks	no	PCC 0	20	no	10
STK	night floor: the stacks take the Sofar over	yes (signed)	PCC + Bat1 = +30 W (SOFAR_TRICKLE)	0	yes	42