batmonitor 0.59-c: decision matrix BM_SRC_RULE (bm_logic.c) - charge and discharge on the real PCC, target 0 W
D1 picks one row per cycle (first match top-down) - make check: 192 combinations (6 bits x 2 states), all rows reachable

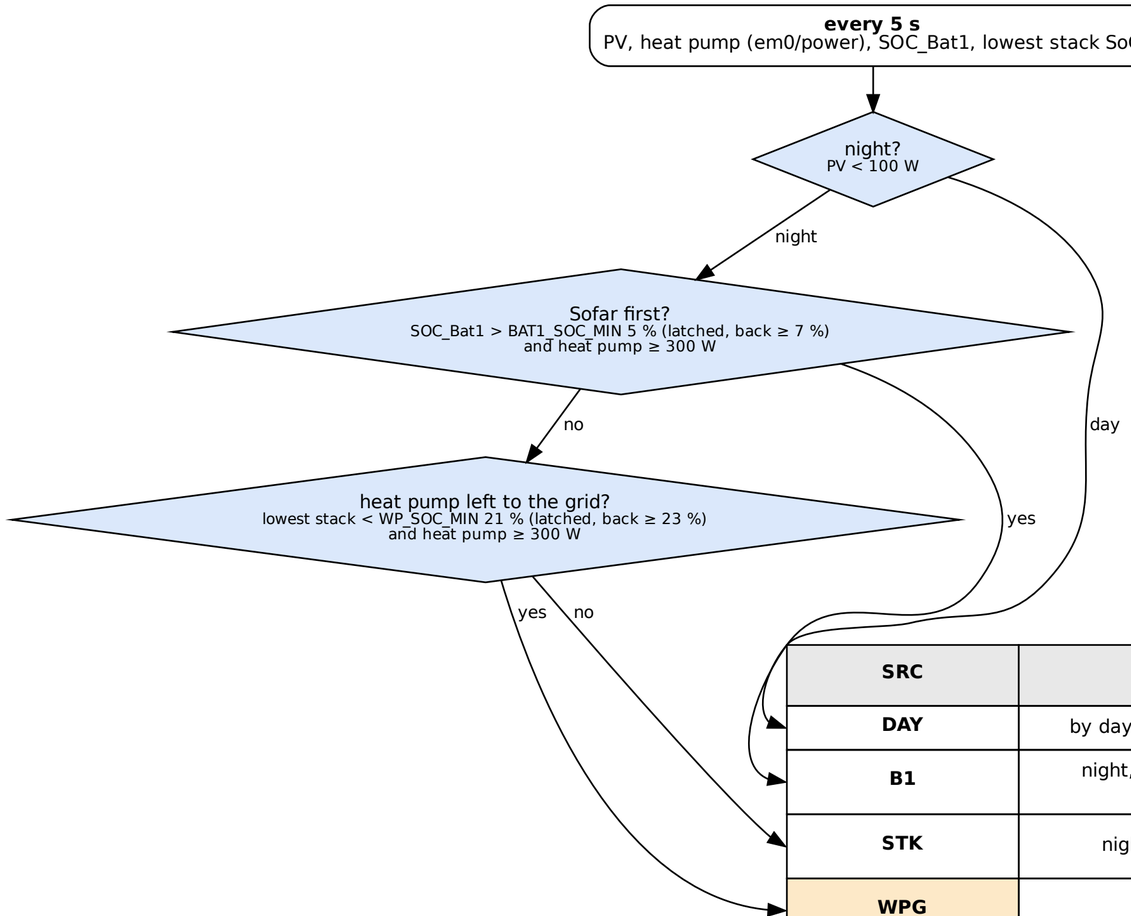

SRC	meaning	Sofar Bat1 discharge counts	target	idle W	PROP hold	make check
DAY	by day: PV surplus charges, import is discharged	no	PCC 0	20	no	96
B1	night, heat pump running: the Sofar Bat1 first, the stacks only what it leaves	no	PCC 0	20	no	18
STK	night floor: the stacks take the Sofar over	yes (signed)	PCC + Bat1 = +30 W (SOFAR_TRICKLE)	0	yes	63
WPG	night, low SoC, heat pump running: the grid pays the heat pump	no	PCC + WP = 0	20	no	15

WPLOW (orange; also by day): while the lowest stack is below WP_SOC_MIN the discharge regulates on PCC + heat pump, so the stacks serve only the house; charging always on the real PCC.
Safety rules unchanged: SOC_MIN 8 % / release 10 %, LOW force charge (DCL 0 or cell < 3.05 V), BMS CCL / DCL, W_MAX 10 kW, 3800 W per phase; summer D4 export cap (18 kW) and DO4 > 20 kW.
Removed in 0.59-c (PCC was moved away from 0 on purpose): Z2 winter rule, 1900 W transition cap, forecast rule + bad-forecast cap, WPPV, WP_CAP, B1W.