

GENERAL NOTES :

1. OWNER / DEVELOPER

MOTTA FLOOR LLC.
2. ENGINEER

ADVANCED ENGINEERING,LLC
P.O. BOX 72692
RICHMOND, VA 23235
G7830-98-8094
3. TAX PARCEL(G PIN) -

SOUTH ANNA
A-1
4. DISTRICT



PRIVATE - WELL
5. ZONING

PRIVATE - SEPTIC SYSTEM
6. WATER

8 ACRES
7. LAND AREA
8. SUBDIVISION

GOOD HOPE LANDING
9. SITE LOCATION

LAT 37.77768
LONG -77.61040

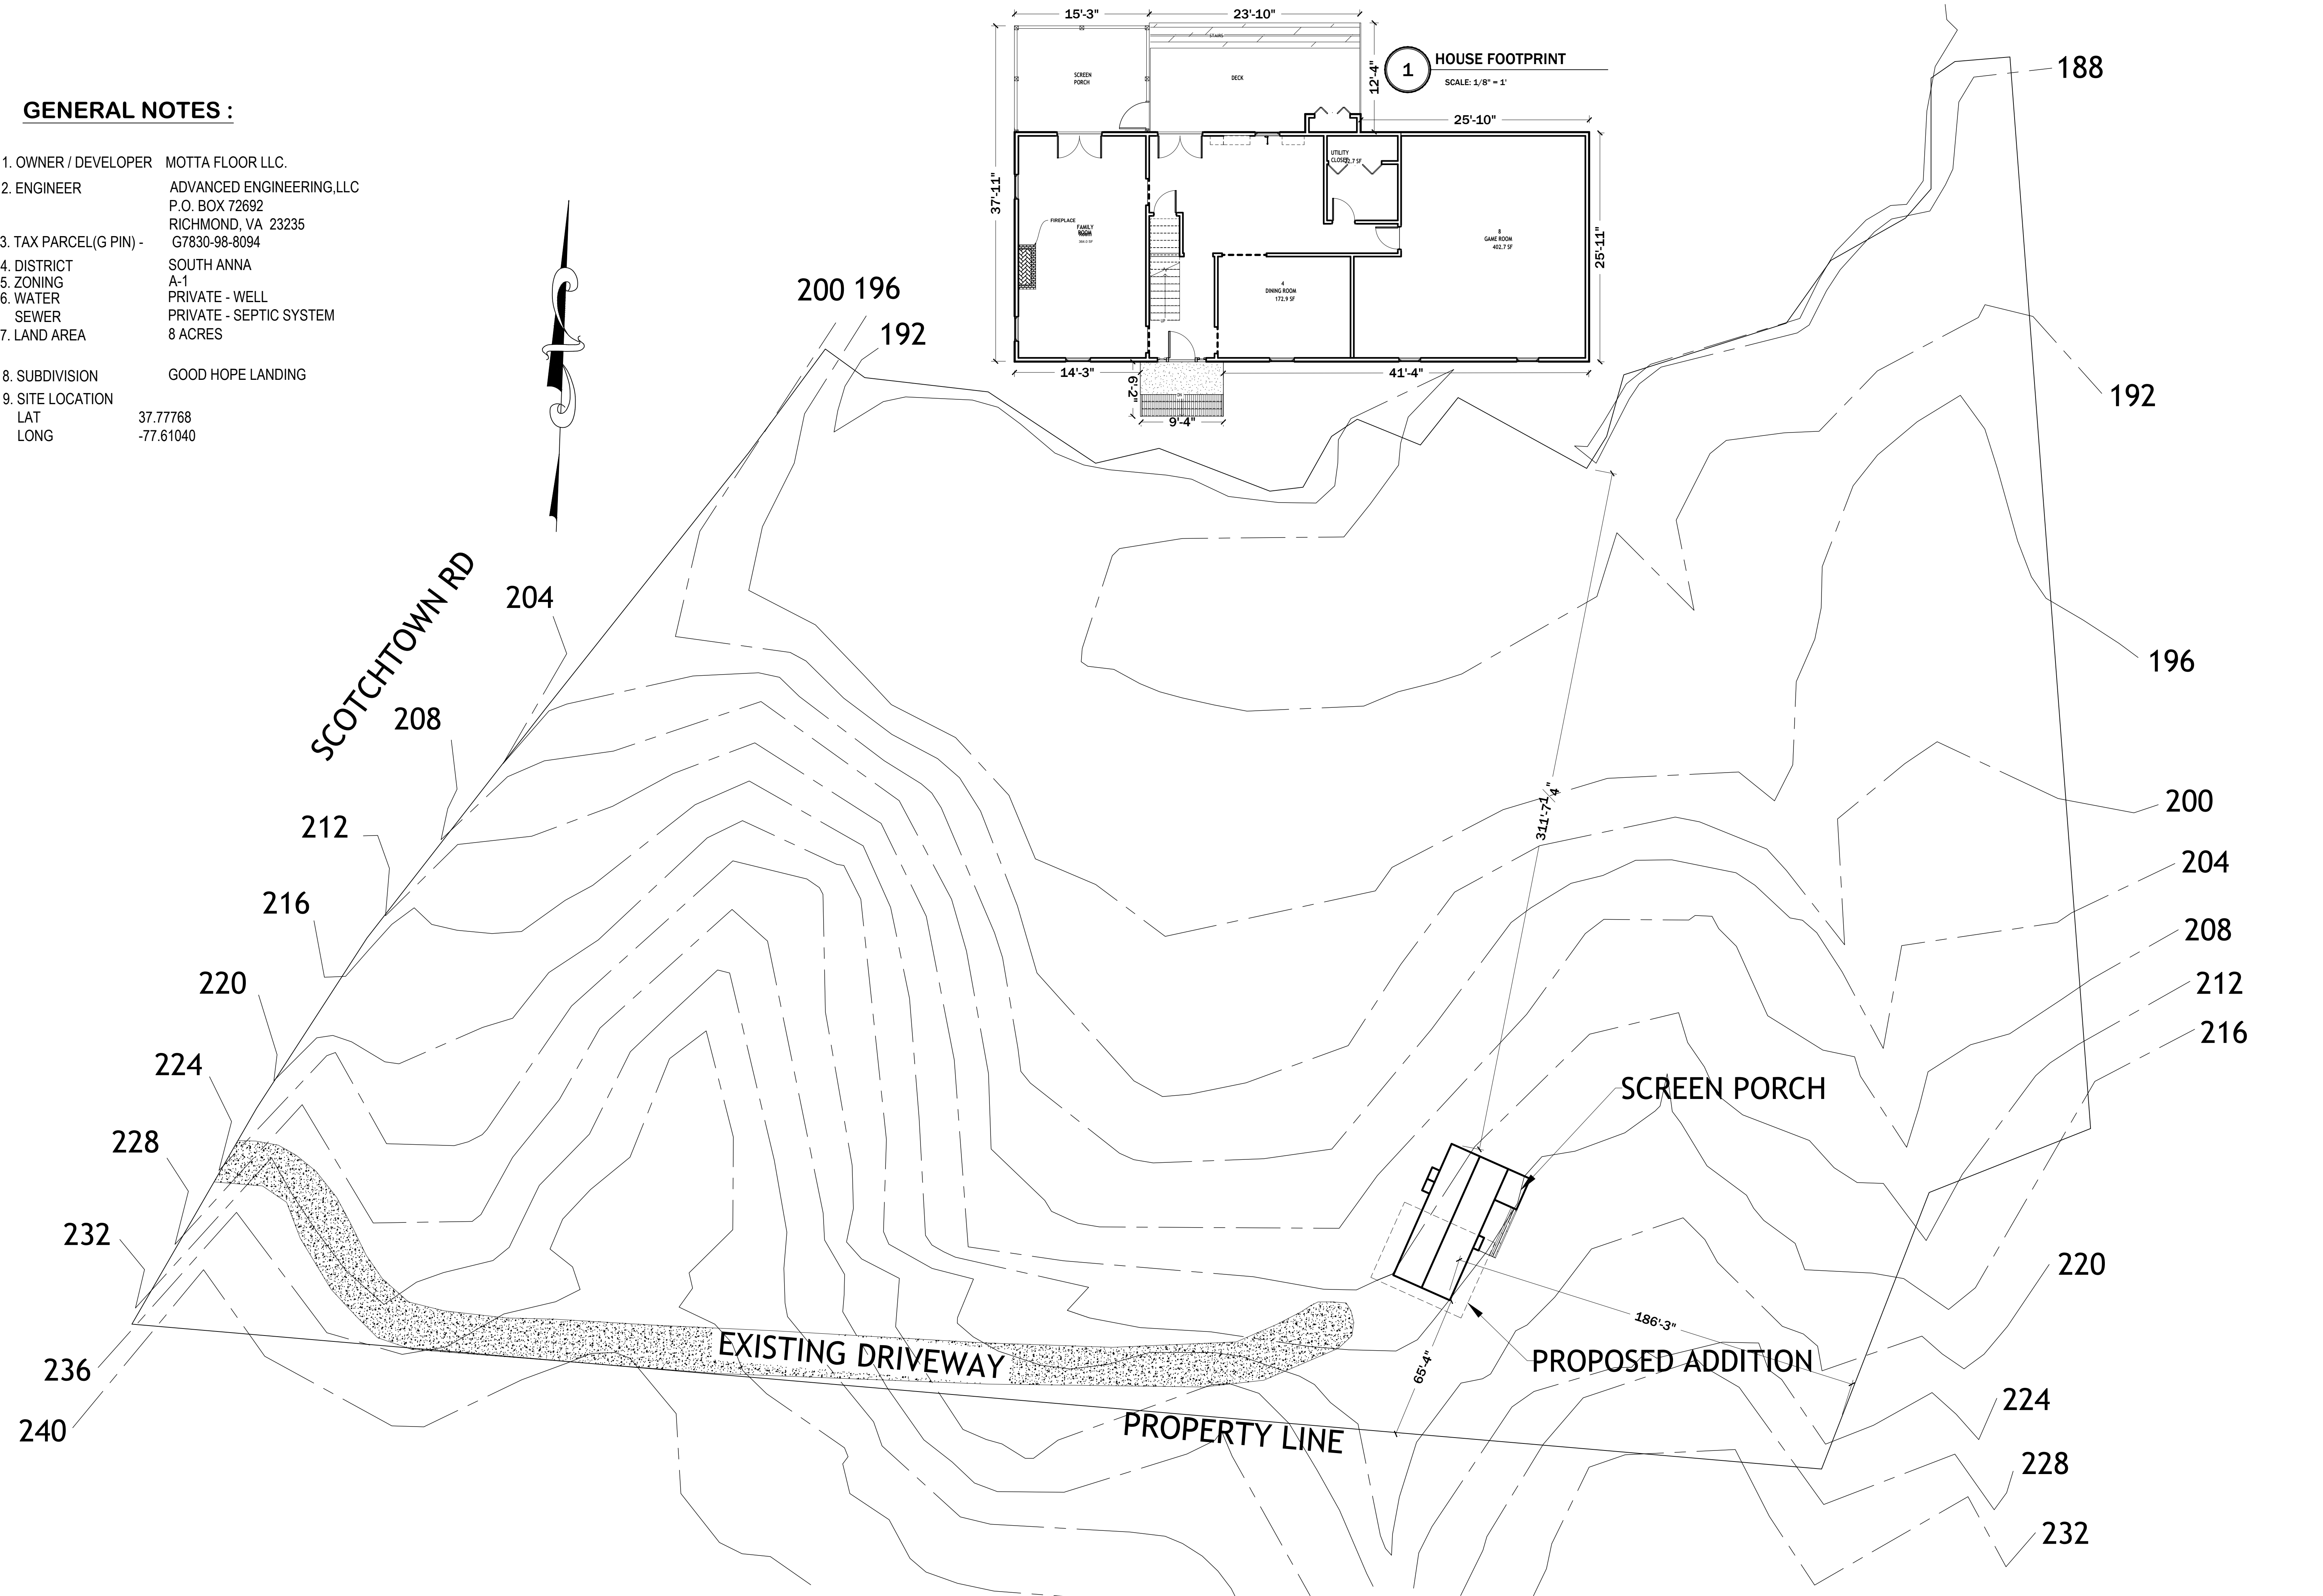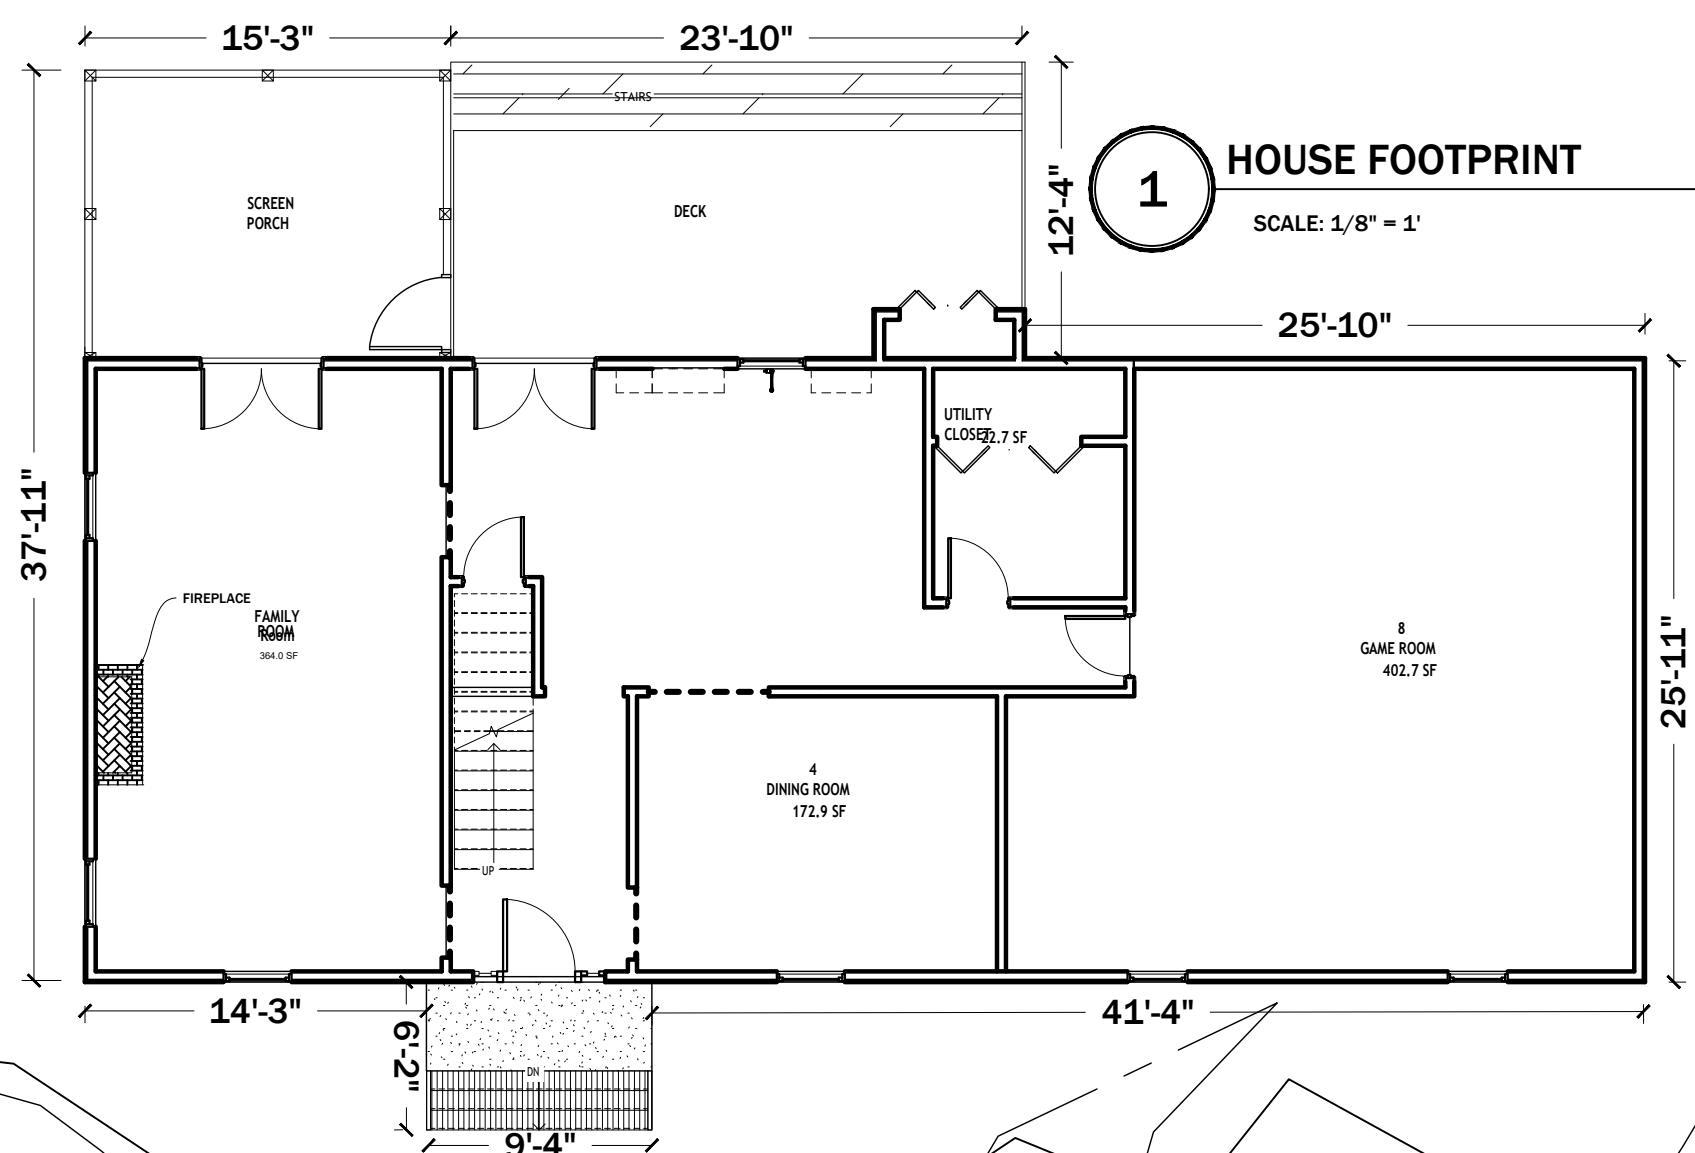



1 FRONT ELEVATION

SCALE: 3/16" = 1'

2ND FLOOR
CEILING
16' - 11 1/2"


2ND FLOOR
8' - 11 1/2"
8' - 0"

1" TO FOUNDATION
WALL
0' - 0"
-0' - 11 1/2"
GROUND LEVEL
-2' - 11 1/2"
T.O. FOOTING
-4' - 11 1/2"



2 REAR ELEVATION

SCALE: 3/16" = 1'

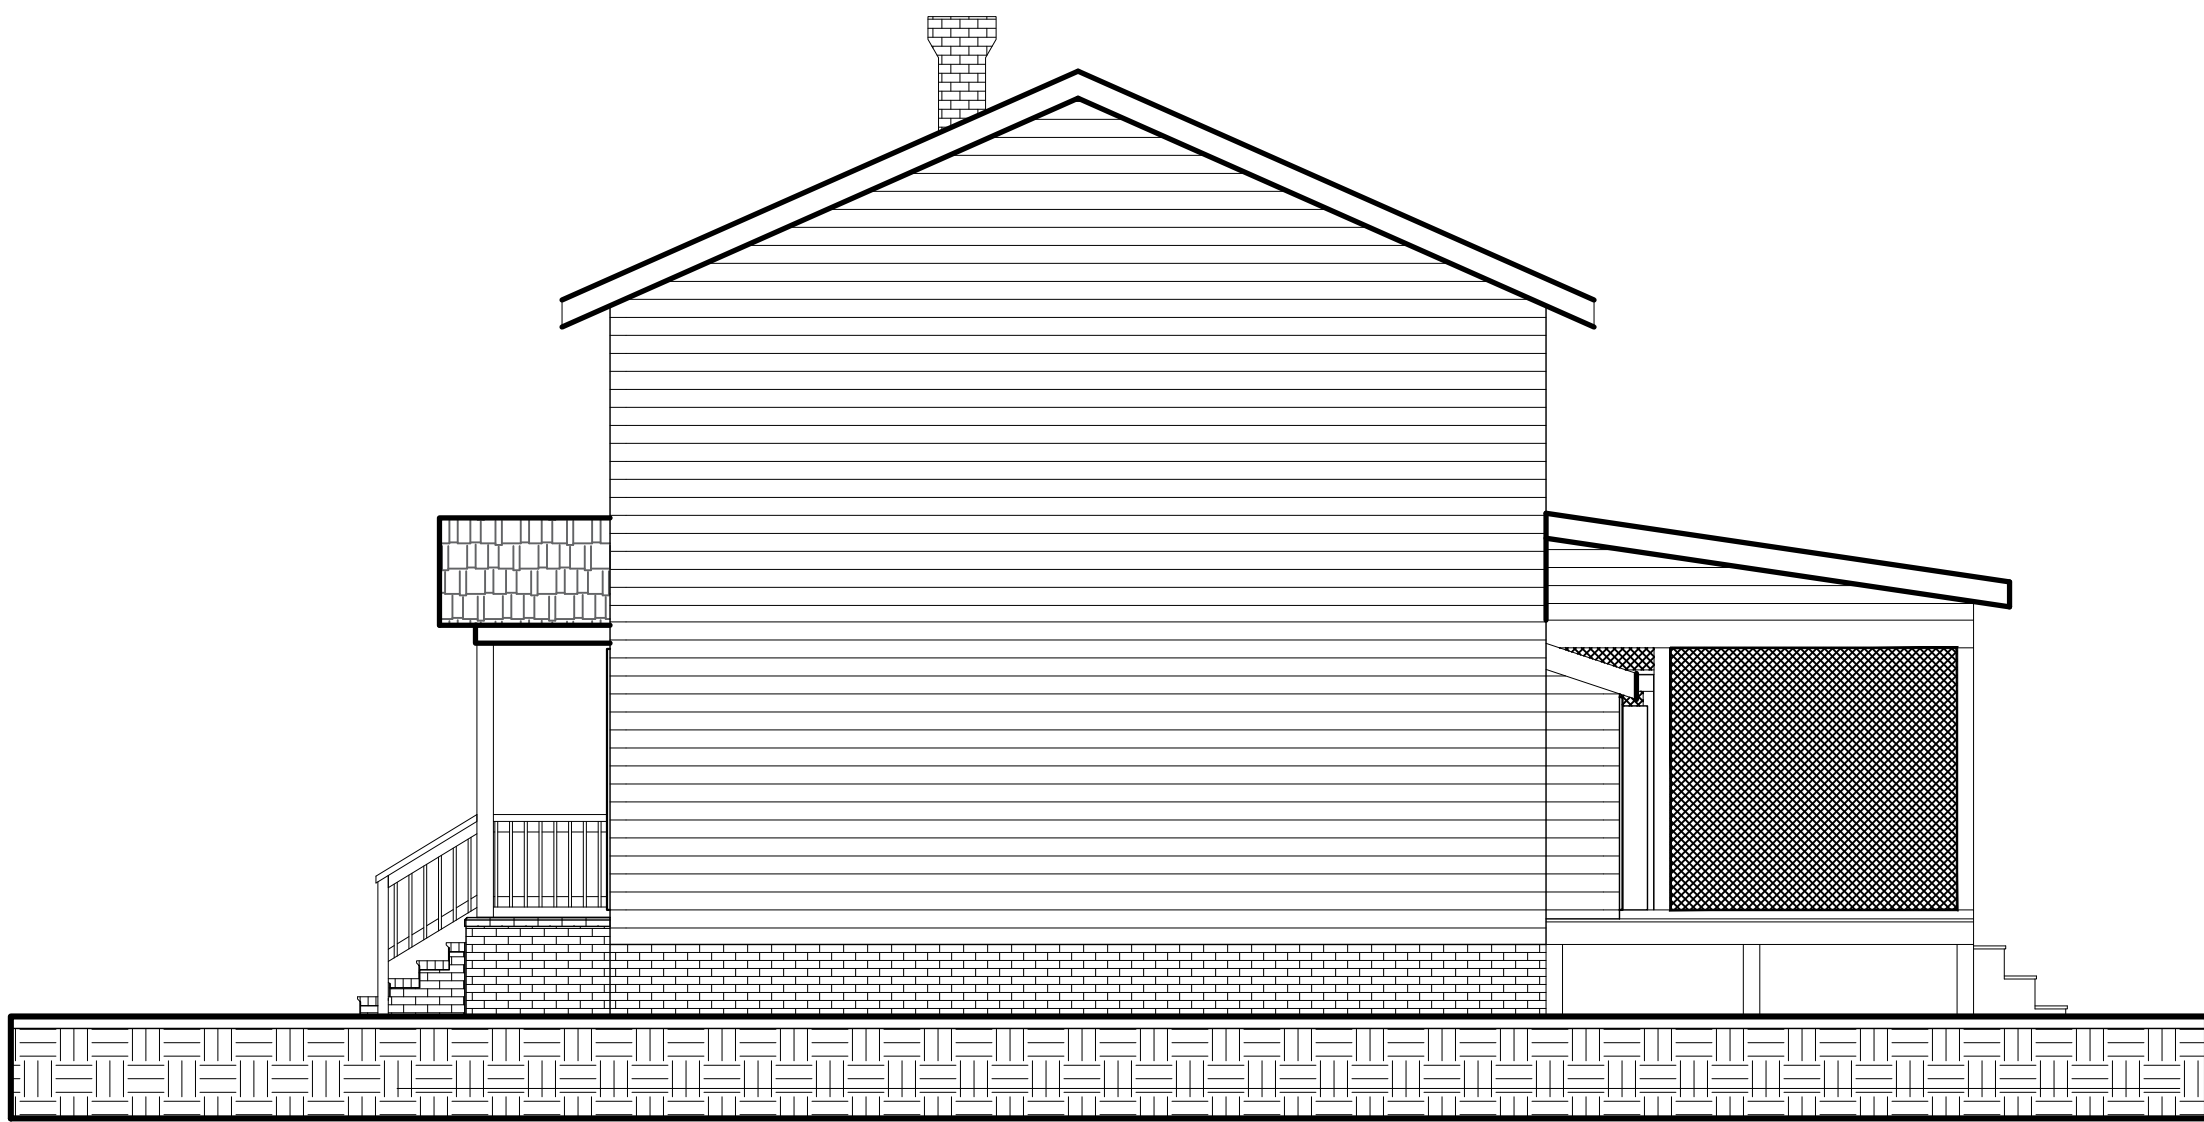

3 RIGHT ELEVATION

SCALE: 3/16" = 1'



4 LEFT ELEVATION

SCALE: 3/16" = 1'

16-32 DRAFTING, LLC

2430 WESTWOOD AVE, SUITE 202

RICHMOND, VA 23230

HOME ADDITION

ELEVATIONS

15497 SCOTCHTOWN RD

DRAWN BY:

GAH


#

REV.DATE


A2

WOOD FRAMING

- A. STRUCTURAL FRAMING ANDBLOCKING SHALL BE NO. 2 OR BETTER SOUTHERN YELLOW PINE (19% MAX MOISTURE CONTENT, f = 1200, E = 1,600,000), UNLESS NOTED OTHERWISE.
- B. STUDS SHALL BE GRADE-MARKED "STANDARD" OR BETTER.
- C. ALL FRAMING WHICH CONTACTS THE GROUND, MASONRY, OR CONCRETE SHALL BE PRESERVATIVE PRESSURE TREATED.
- D. LAMINATED VENEER LUMBER (LVL'S) SHALL BE TRUSJOIST'S 1.9E MICROLAM OR APPROVED EQUAL.
- E. LAMINATED STRAND LUMBER (LSL'S) SHALL BE TRUSJOIST'S 1.3E OR 1.5E TIMBERSTRAND OR APPROVED EQUAL.
- F. PARALLEL STRAND LUMBER (PSL'S) SHALL BE TRUSJOIST'S 2.0E PARALLAM OR APPROVED EQUAL.
- G. PRE-FAB. WOOD I-JOISTS SHALL BE TRUSJOIST'S TJI JOISTS OR APPROVED EQUAL.
- H. CONTRACTOR TO PROVIDE FRAME BLOCKING AND BRIDGING AS REQUIRED.
- I. JOIST AND BEAM DESIGN MAX. ALLOWABLE DEFLECTIONS SHALL BE AS FOLLOWED:
1. JOISTS = L/480 (LL)
2. BEAMS = L/360 (LL)
- J. FRAMING ACCESSORIES SHALL BE SIMPSON STRONG-TIE OR APPROVED EQUAL.
- K. SUBFLOORING SHALL BE APA RATED 3/4" STURD-I-FLOOR, T&G EXTERIOR EXPOSURE UNLESS NOTED OTHERWISE.
- L. SUBFLOORING SHALL BE ADHESIVE APPLIED AND NAILED IN PLACE PER MANUFACTURER'S RECOMMENDATIONS.
- M. SUBFLOOR/UNDERLAYMENT UNDER THINSET TIE SHALL BE A MIN. OF 1 1/4" TOTAL THICKNESS PER TCA RECOMMENDATIONS.
- N. ROOF SHEATHING SHALL BE APA SPAN-RATED 7/16" CDX UNLESS OTHERWISE NOTED.
- O. WALL SHEATHING SHALL BE APA SPAN-RATED 7/16" OSB UNLESS OTHERWISE NOTED.
- P. DOUBLE STUDS AT ALL DOOR, WINDOWS, AND CASED OPENING JAMBS.
- Q. FRAMER TO VERIFY DIMENSIONAL LAYOUT WITH CONSTRUCTION MANAGER PRIOR TO SETTING WALLS.

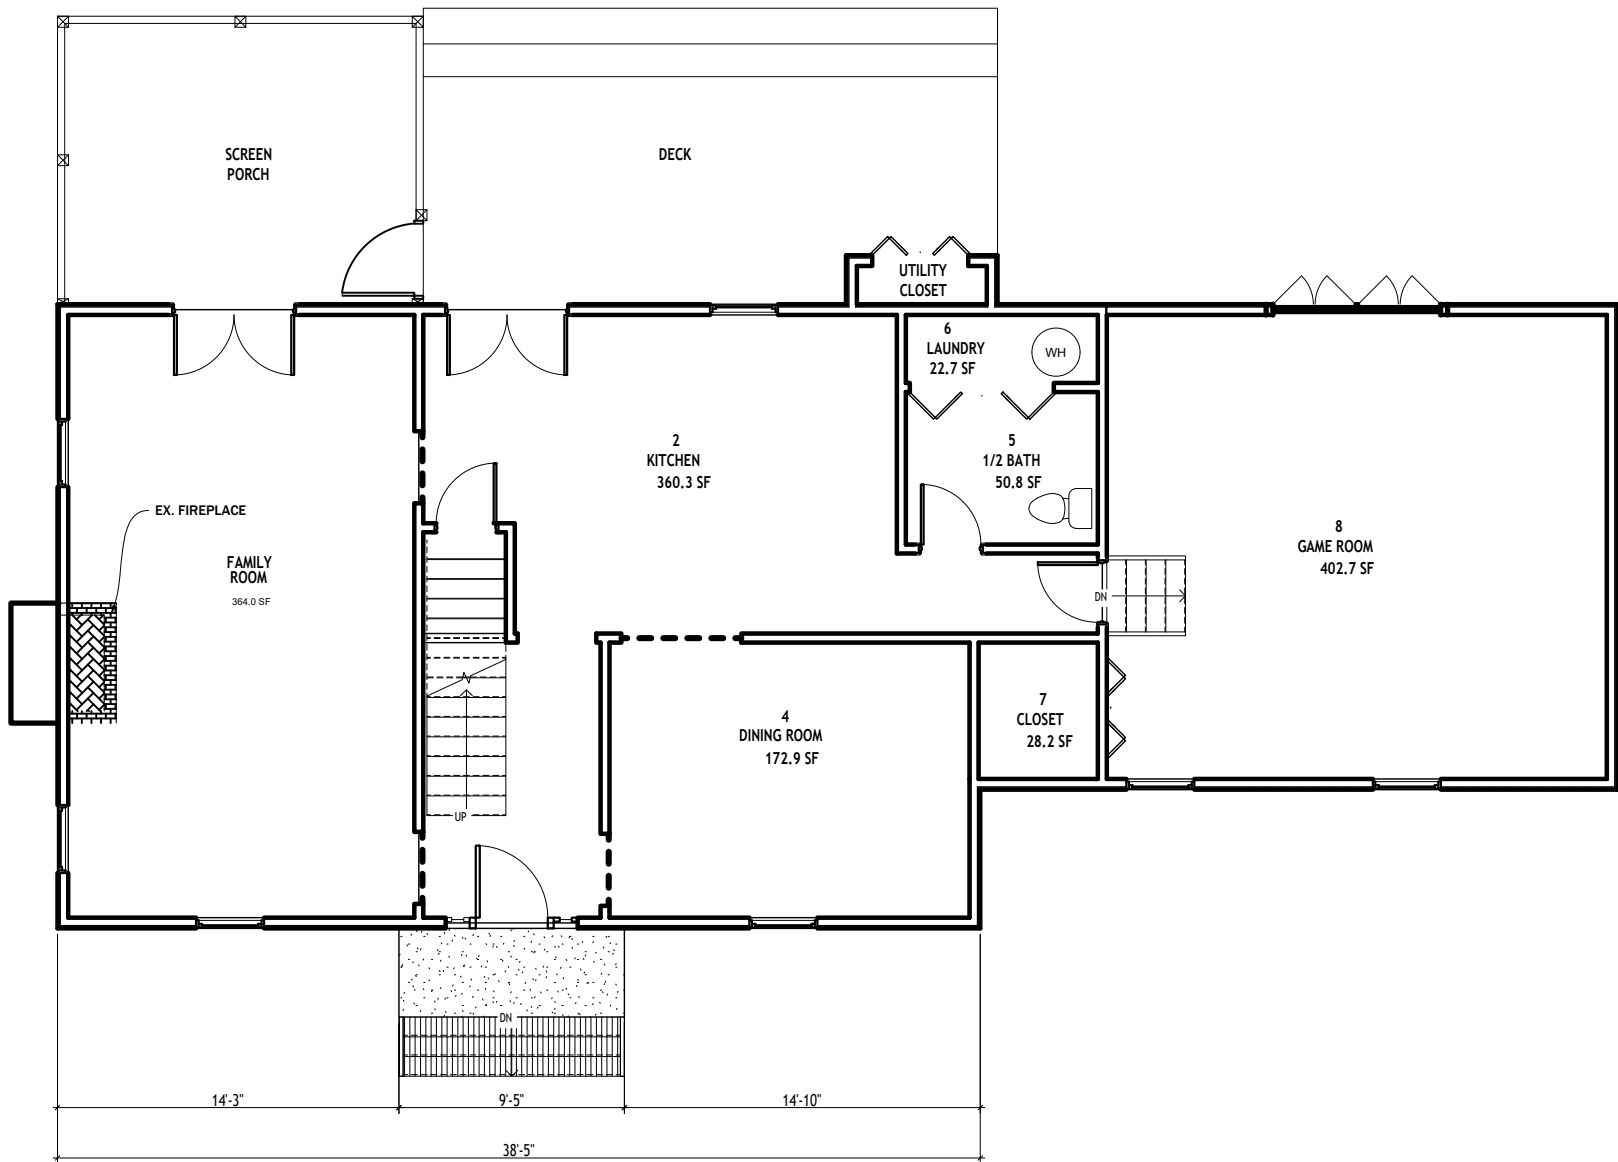

1ST LEVEL PROPOSED FLOOR PLAN

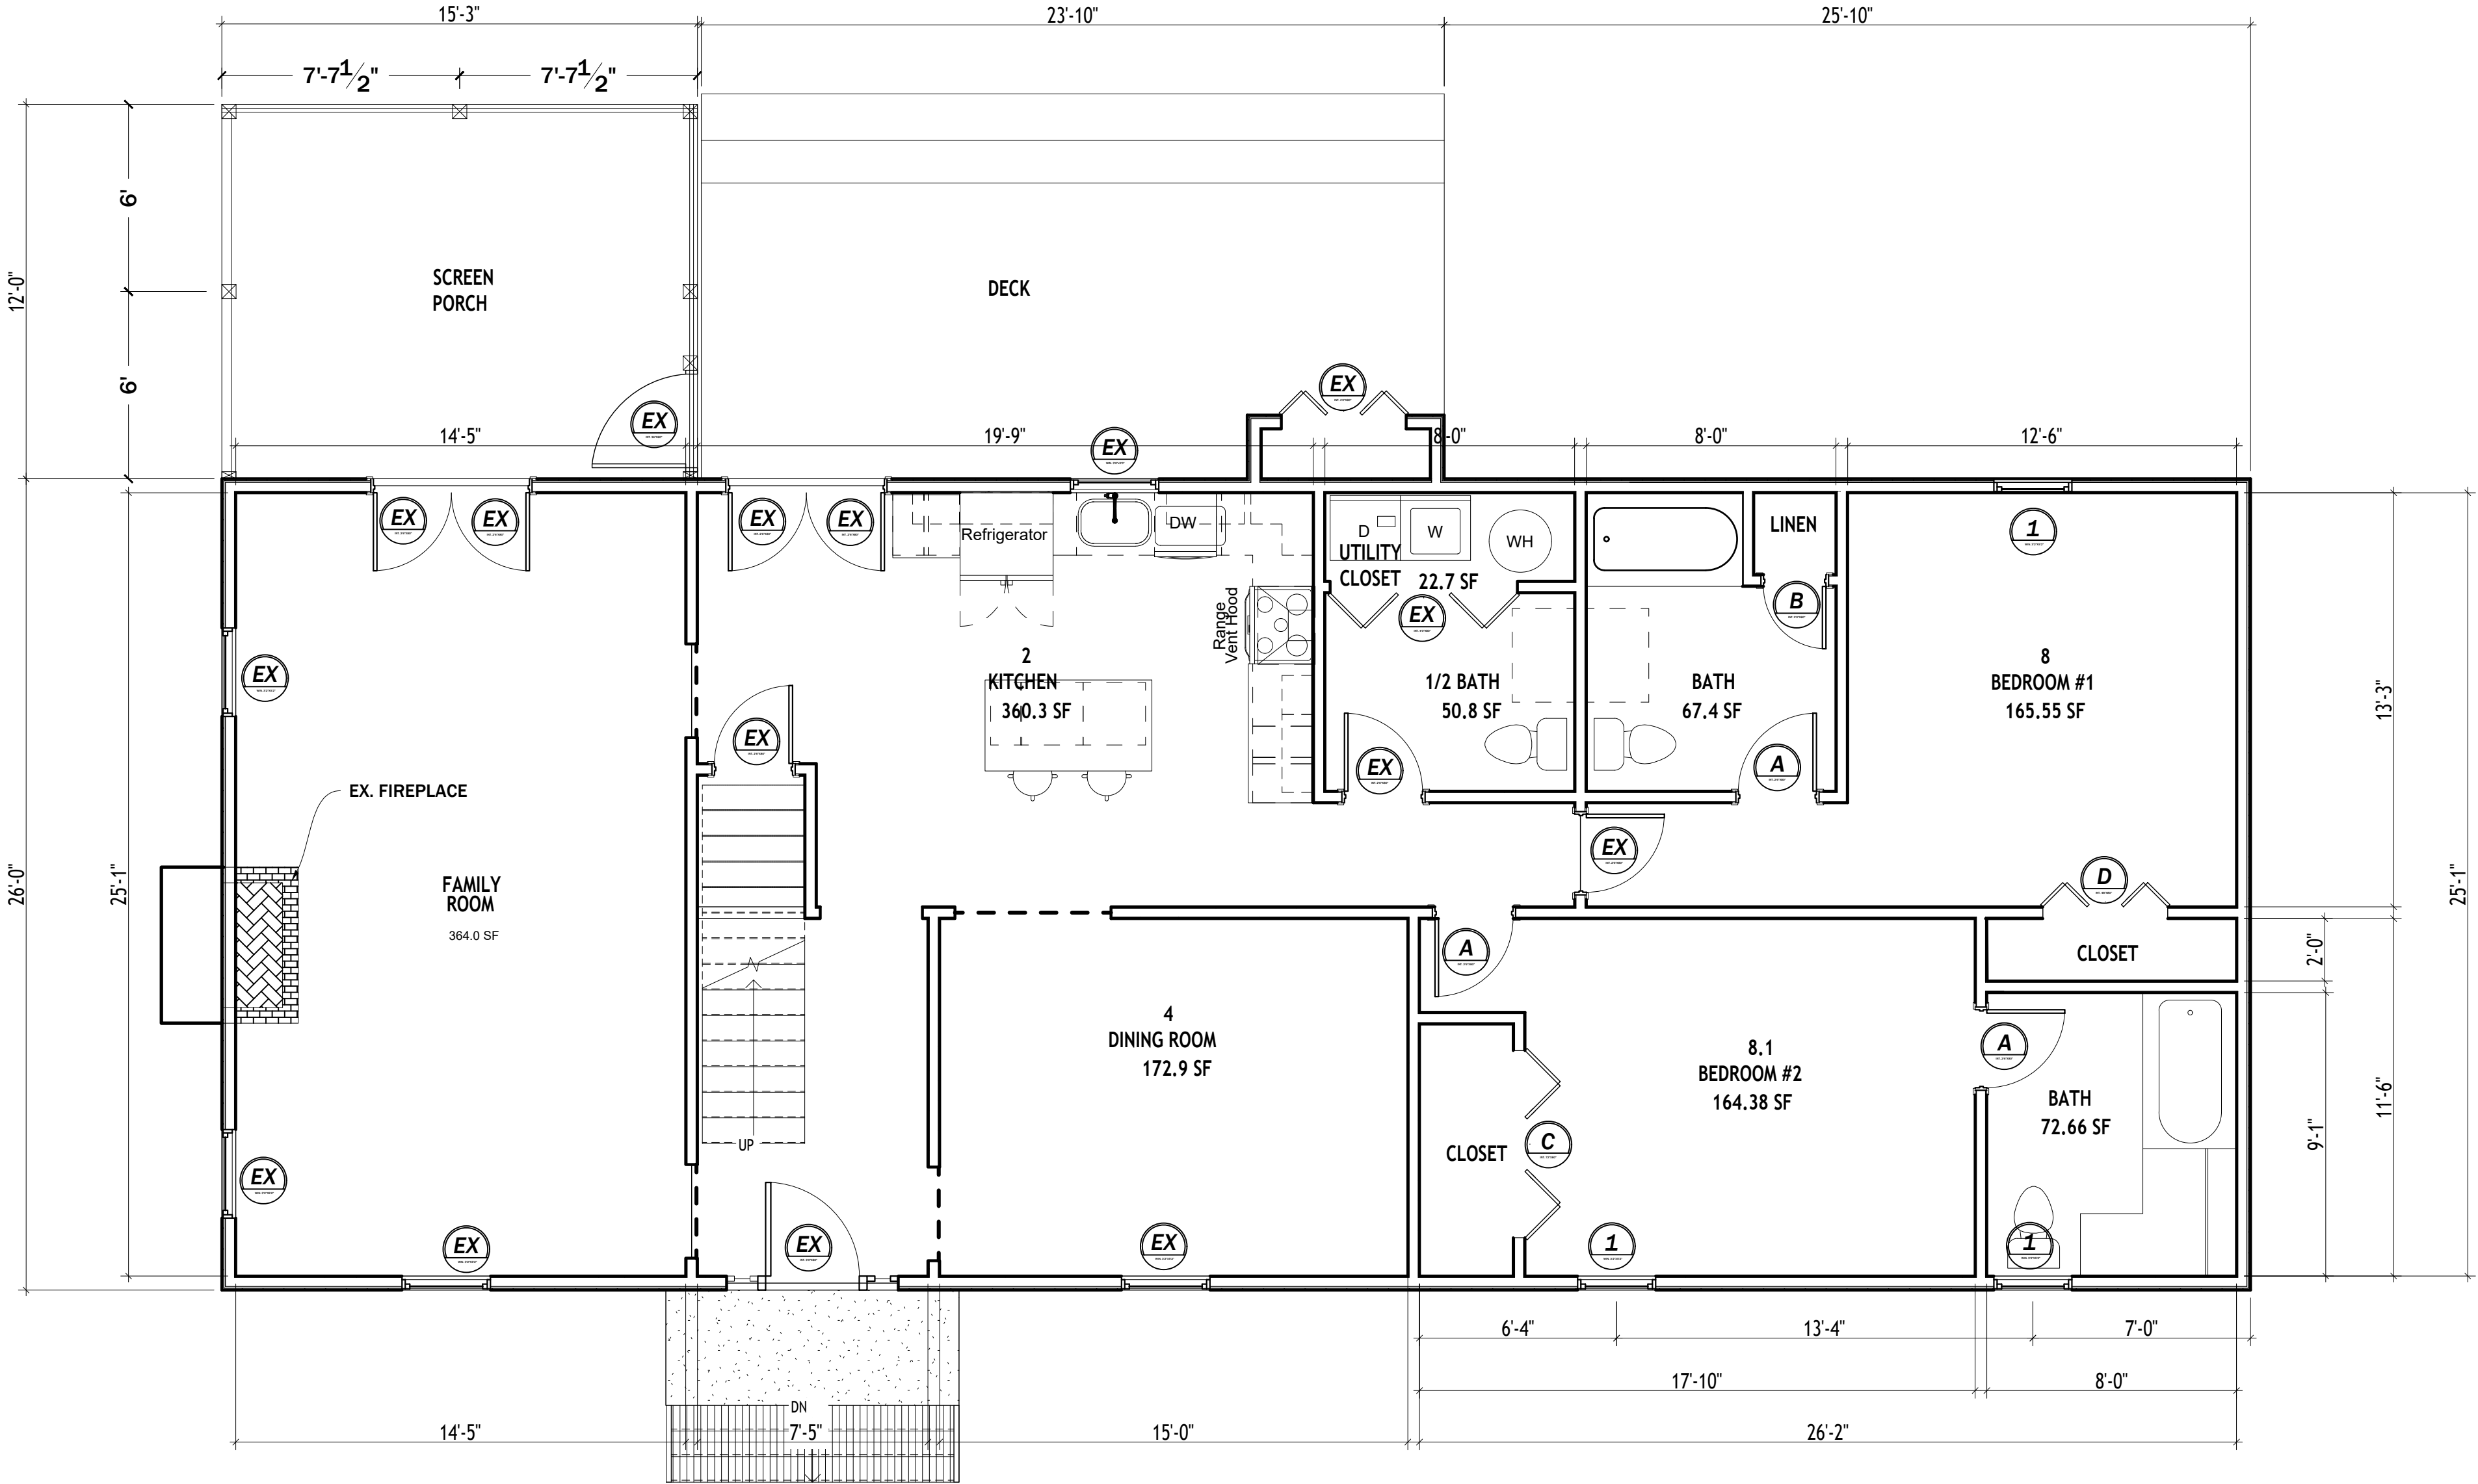

5 1ST LEVEL PROPOSED FLOOR PLAN

SCALE: 1/4"= 1'

DOOR SCHEDULE		
MARK	DESCRIPTION	QUAN
A	2'6" X 80" HC WOOD INTERIOR DOOR	3
B	2'0" X 80" HC WOOD INTERIOR DOOR	1
C	72" X 80" BIFOLD DOOR	1
D	48" X 80" BIFOLD DOOR	1
WINDOW SCHEDULE		
MARK	DESCRIPTION	QUAN
1	3'2"x5'2" DBL HUNG VINYL CLAD WINDOW	3

NOTES:
DOORS AND WINDOWS ARE TO HAVE A U-FACTOR
ALL WINDOWS WITHIN 2 ft (HORIZONTALLY) OF A DOOR IS TO BE TEMPERED SAFETY GLASS.

16-32 DRAFTING, LLC
2430 WESTWOOD AVE, SUITE 202
RICHMOND, VA 23230

HOME ADDITION

1ST LEVEL FLOOR PLAN
1904 HUNGARY OAK CT HENRICO, VA 23228

DRAWN BY:

GAH

REV.DATE


A3

WOOD FRAMING


- A. STRUCTURAL FRAMING ANDBLOCKING SHALL BE NO. 2 OR BETTER SOUTHERN YELLOW PINE (19% MAX MOISTURE CONTENT, f = 1200, E = 1,600,000), UNLESS NOTED OTHERWISE.
- B. STUDS SHALL BE GRADE-MARKED "STANDARD" OR BETTER.
- C. ALL FRAMING WHICH CONTACTS THE GROUND, MASONRY, OR CONCRETE SHALL BE PRESERVATIVE PRESSURE TREATED.
- D. LAMINATED VENEER LUMBER (LVL'S) SHALL BE TRUSJOIST'S 1.9E MICROLAM OR APPROVED EQUAL.
- E. LAMINATED STRAND LUMBER (LSL'S) SHALL BE TRUSJOIST'S 1.3E OR 1.5E TIMBERSTRAND OR APPROVED EQUAL.
- F. PARALLEL STRAND LUMBER (PSL'S) SHALL BE TRUSJOIST'S 2.0E PARALLAM OR APPROVED EQUAL.
- G. PRE-FAB. WOOD I-JOISTS SHALL BE TRUSJOIST'S TJI JOISTS OR APPROVED EQUAL.
- H. CONTRACTOR TO PROVIDE FRAME BLOCKING AND BRIDGING AS REQUIRED.
- I. JOIST AND BEAM DESIGN MAX. ALLOWABLE DEFLECTIONS SHALL BE AS FOLLOWED:
1. JOISTS = L/480 (LL)

2. BEAMS = L/360 (LL)
- J. FRAMING ACCESSORIES SHALL BE SIMPSON STRONG-TIE OR APPROVED EQUAL.
- K. SUBFLOORING SHALL BE APA RATED 3/4" STURD-I-FLOOR, T&G EXTERIOR EXPOSURE UNLESS NOTED OTHERWISE.
- L. SUBFLOORING SHALL BE ADHESIVE APPLIED AND NAILED IN PLACE PER MANUFACTURER'S RECOMMENDATIONS.
- M. SUBFLOOR/UNDERLAYMENT UNDER THINSET TIE SHALL BE A MIN. OF 1 1/4" TOTAL THICKNESS PER TCA RECOMMENDATIONS.
- N. ROOF SHEATHING SHALL BE APA SPAN-RATED 7/16" CDX UNLESS OTHERWISE NOTED.
- O. WALL SHEATHING SHALL BE APA SPAN-RATED 7/16" OSB UNLESS OTHERWISE NOTED.
- P. DOUBLE STUDS AT ALL DOOR, WINDOWS, AND CASED OPENING JAMBS.
- Q. FRAMER TO VERIFY DIMENSIONAL LAYOUT WITH CONSTRUCTION MANAGER PRIOR TO SETTING WALLS.

DOOR SCHEDULE		
MARK	DESCRIPTION	QUAN
A	2'6" X 80" HC WOOD INTERIOR DOOR	6
B	2'0" X 80" HC WOOD INTERIOR DOOR	1
WINDOW SCHEDULE		
MARK	DESCRIPTION	QUAN
1	3'0"x5'2" DBL HUNG VINYL CLAD WINDOW	4
2	3'0"x3'0" DBL HUNG VINYL CLAD WINDOW	1

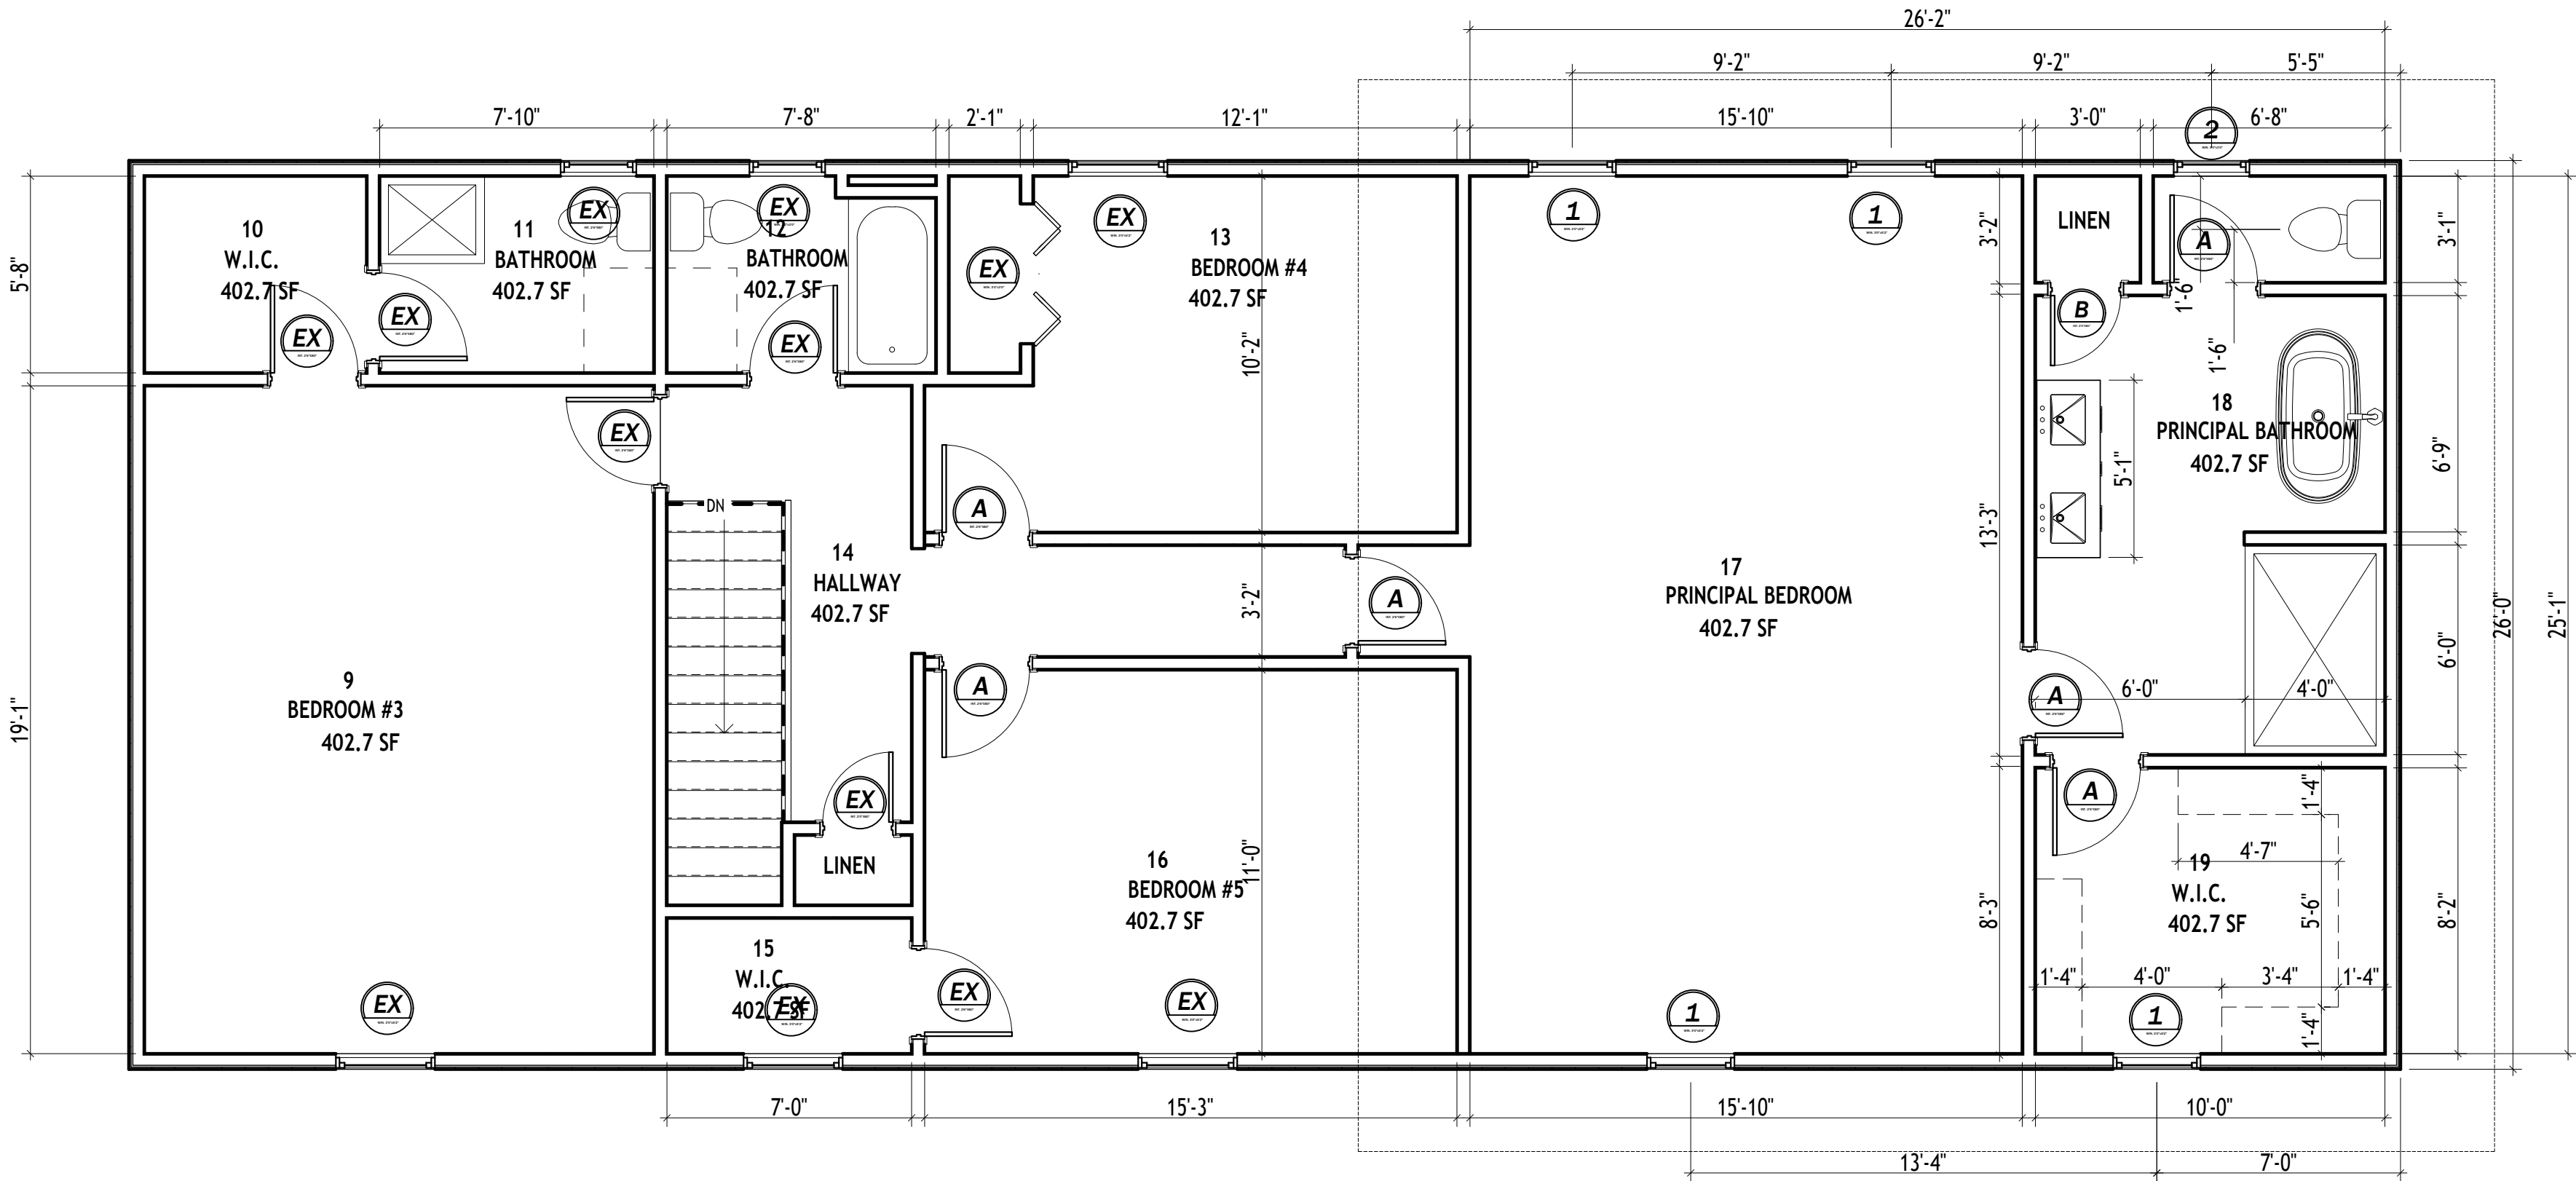

6 2ND LEVEL FLOOR PLAN
SCALE: 1/4" = 1'

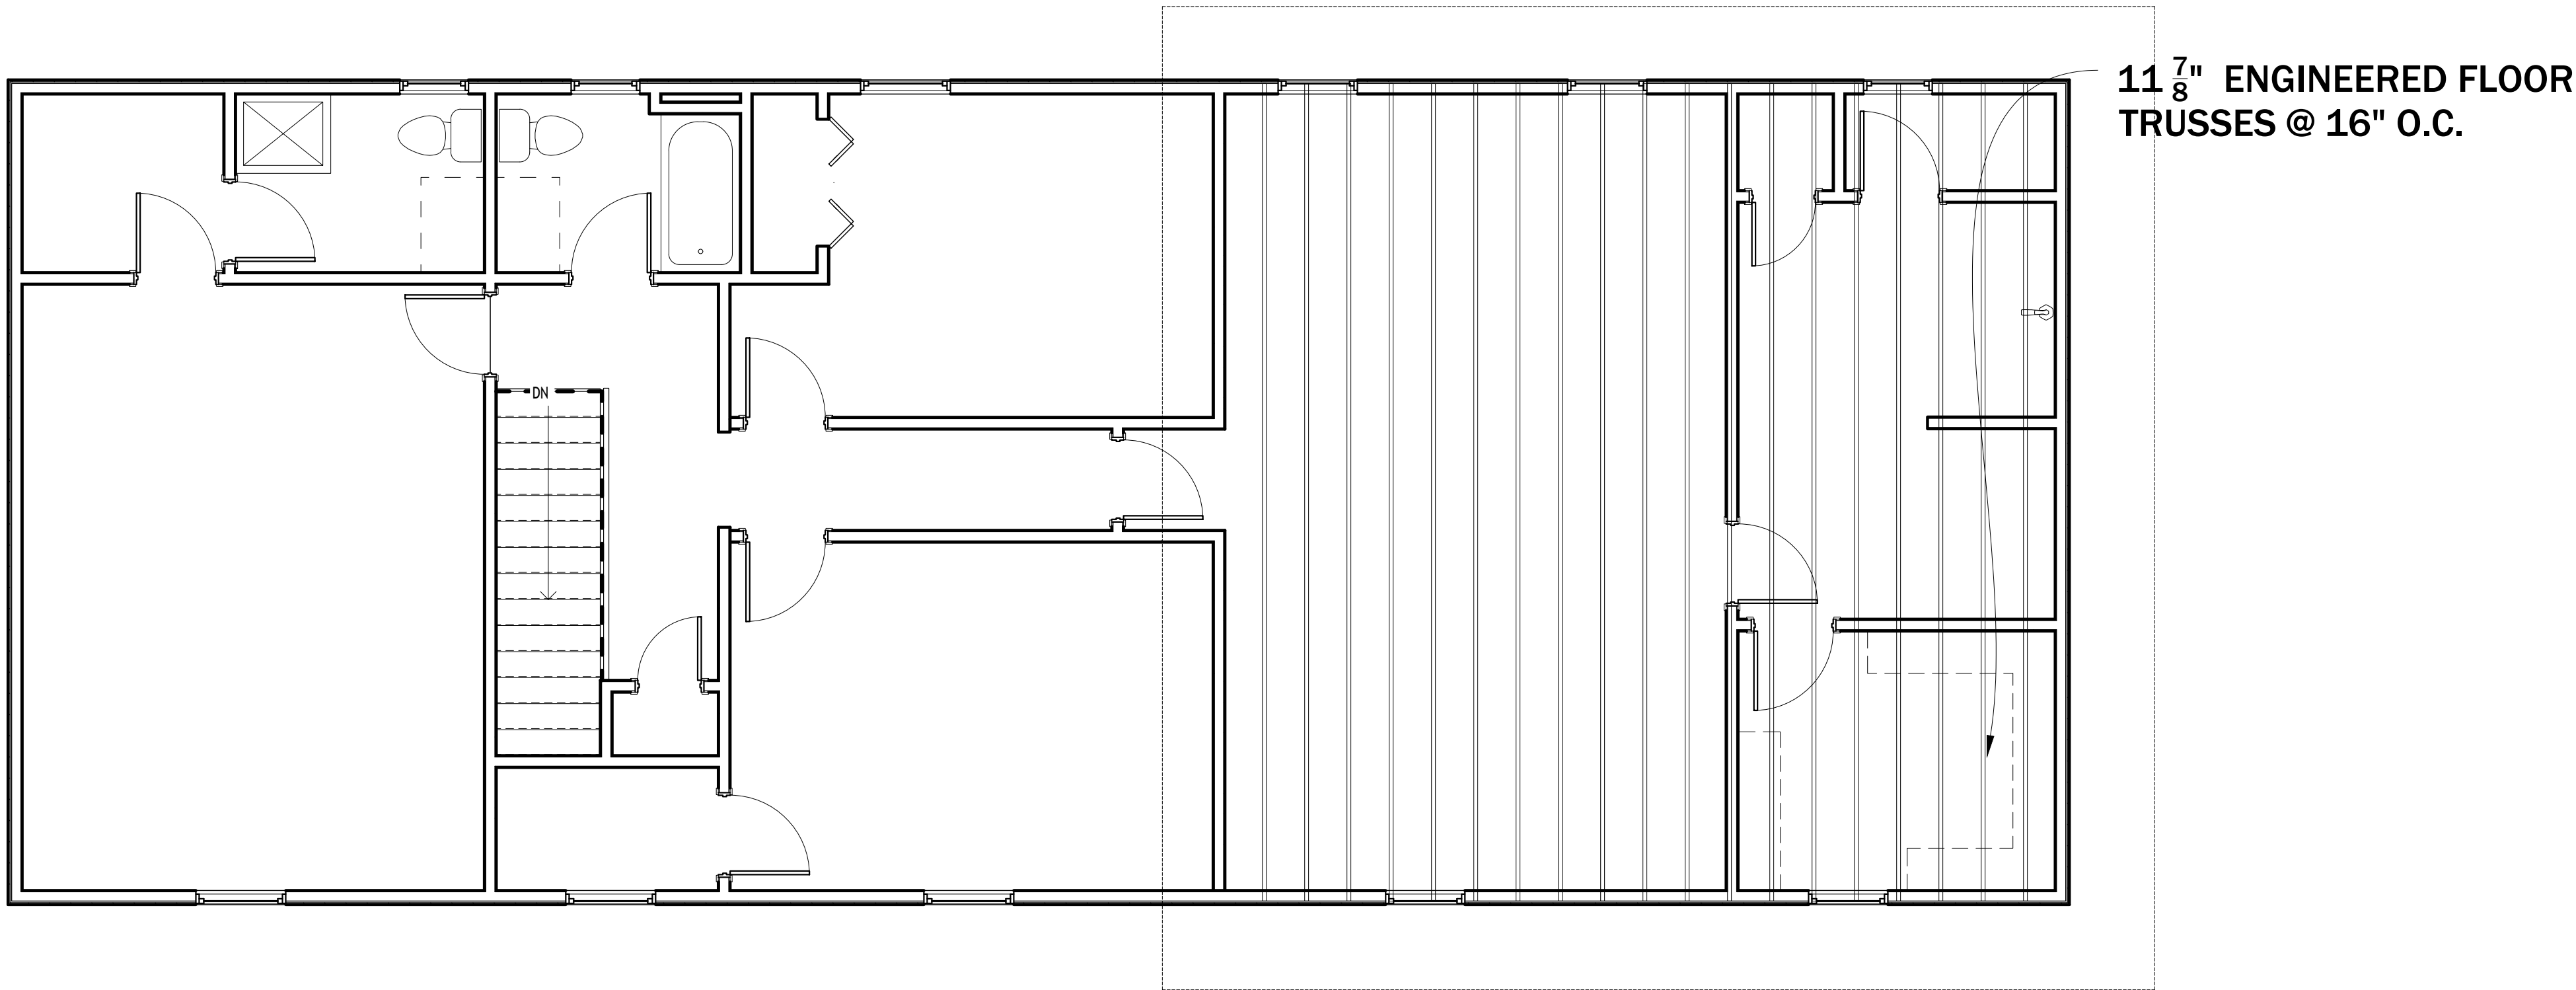

7 2ND LEVEL FLOOR FRAMING PLAN
SCALE: 1/4" = 1'

16-32 DRAFTING, LLC

2430 WESTWOOD AVE, SUITE 202
RICHMOND, VA 23230

HOME ADDITION

2ND LEVEL FLOOR PLAN
15497 SCOTCHTOWN RD

DRAWN BY:

GAH

REV.DATE

A4



SCALE: 1/4" = 1'

1. HOLLOW LOAD BEARING: ASTM C-90
2. SOLID LOAD BEARING: ASTM C-145
3. HOLLOW NON-LOAD BEARING: ASTM C-129

B. BRICK: TYPE, SIZE, AND BOND TO BE CHOSEN BY OWNER.

C. MORTAR SHALL BE ASTM C-270 TYPE S, AND NO ADMIXTURE WILL BE ALLOWED. COLOR AN JOINT TYPE TO BE CHOSEN BY OWNER.

D. CONTRACTOR SHALL SUBMIT SAMPLES OF BRICK AND MORTAR TO THE CONSTRUCTION MANAGER FOR REVIEW AND APPROVAL PRIOR TO COMMENCEMENT OF CONSTRUCTION.

E. CMU SHALL BE LAID IN RUNNING BOND WITH FLUSH JOINTS.

F. CMU WALL REINFORCING SHALL BE HOT-DIPPED GALVANIZED TRUSS TYPE REINFORCING, 1" LESS THAN WALL THICKNESS, 16" OC VERTICALLY, LAPPED 6" AND WIRE TIED.

G. PROVIDE ALL BRICK TIES, HORIZONTAL REINFORCEMENT, FOUNDATION VENTS, LINTELS, AND ACCESSORIES REQUIRED FOR A COMPLETE JOB.


H. MASONRY FIREPLACES SHALL BE DESIGNED FOR PROPER AIR INTAKE, DRAW, AND CODE COMPLIANCE. INCLUDE DAMPER, CAPS, AND ALL OTHER ACCESSORIES REQUIRED FOR COMPLETE INSTALLATION.

A5

14

1ST INT. FLOOR FLOOR FRAMING PLAN

SCALE: 3/8" = 1'

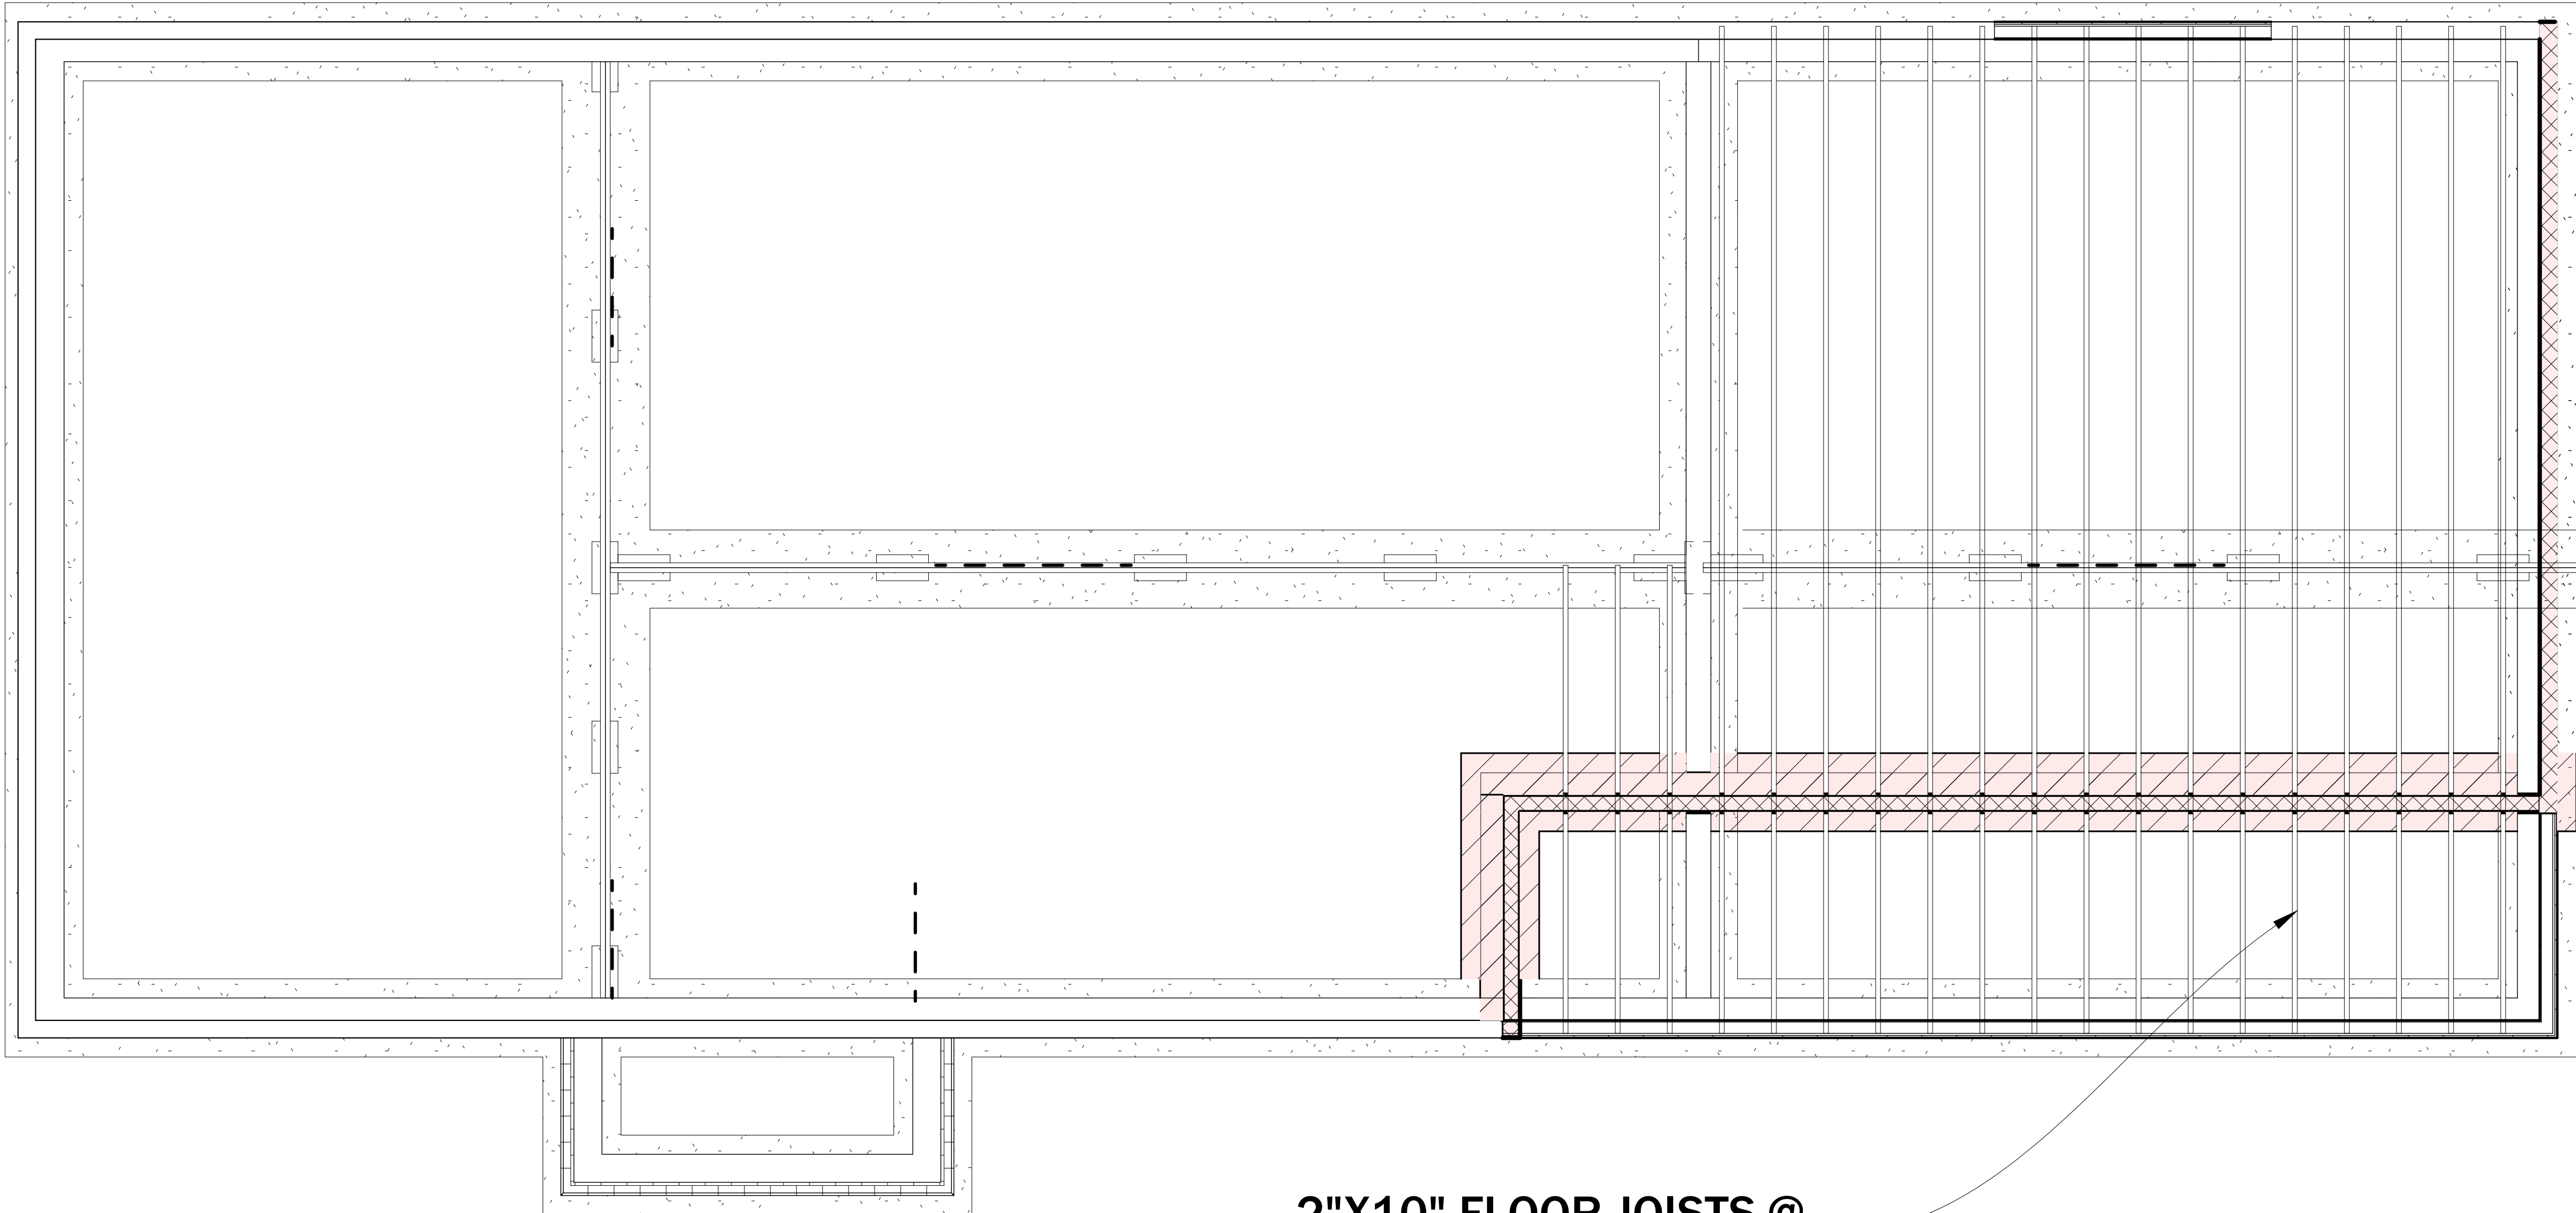

2"X10" FLOOR JOISTS @
16" O.C.

16-32 DRAFTING, LLC
2430 WESTWOOD AVE, SUITE 202
RICHMOND, VA 23230



HOME ADDITION
1ST LEVEL FLOOR FRAMING PLAN
15497 SCOTCHTOWN RD

DRAWN BY:


GAH

#	REV.DATE
---	----------


A6

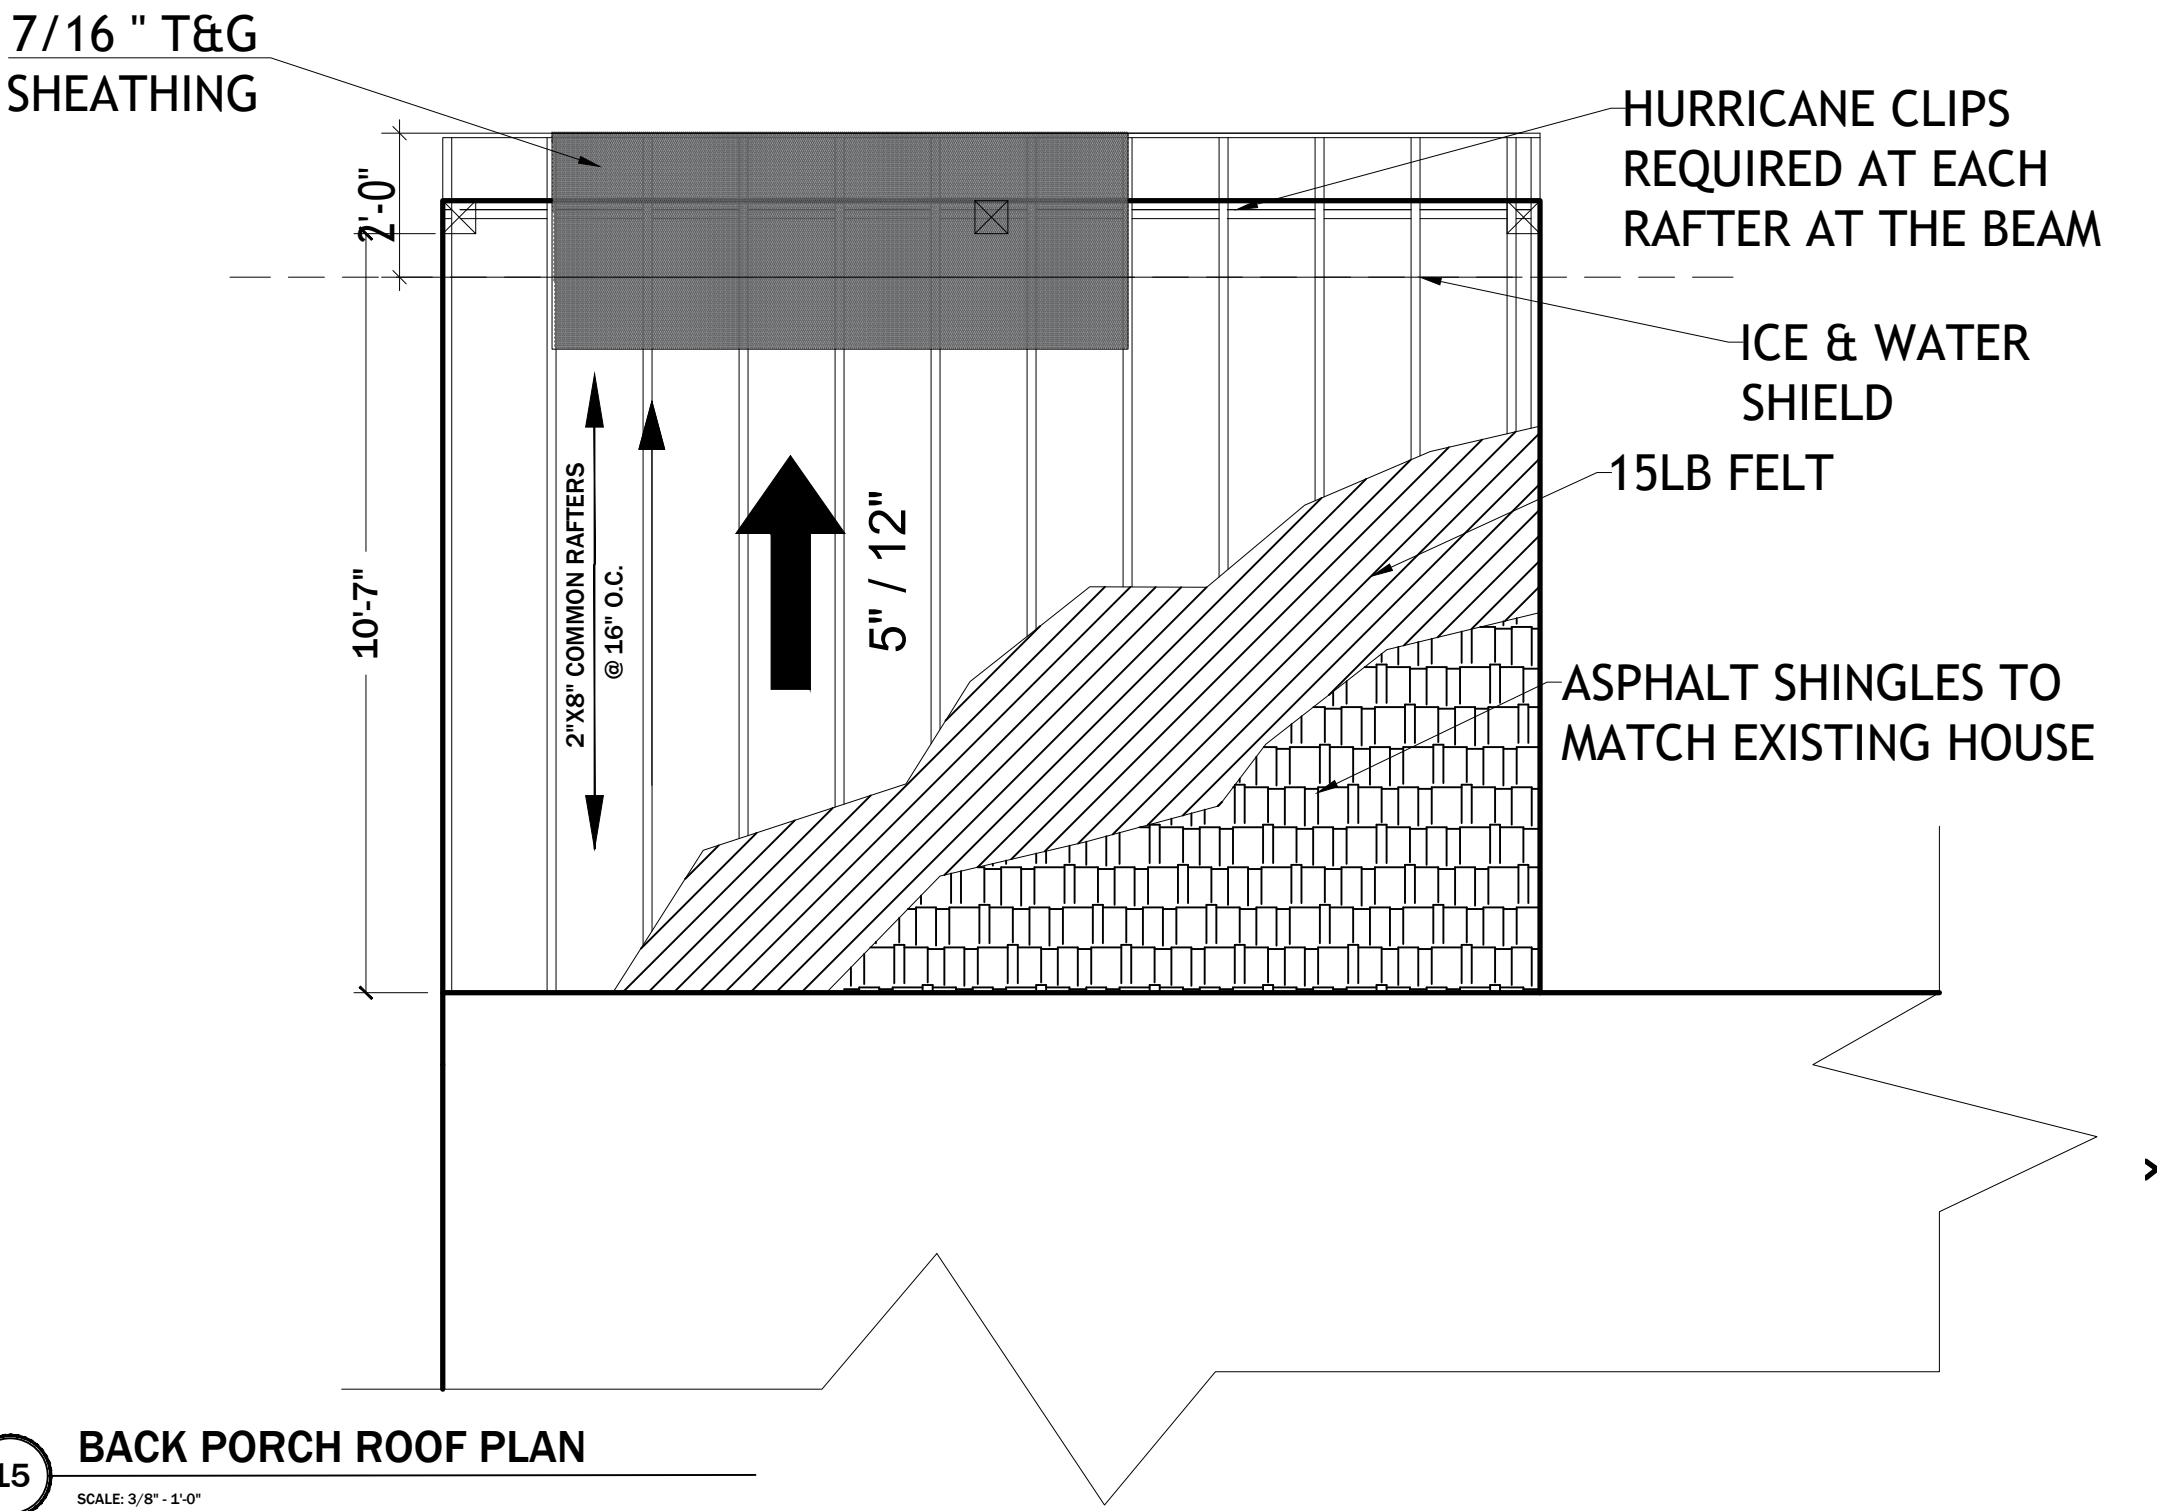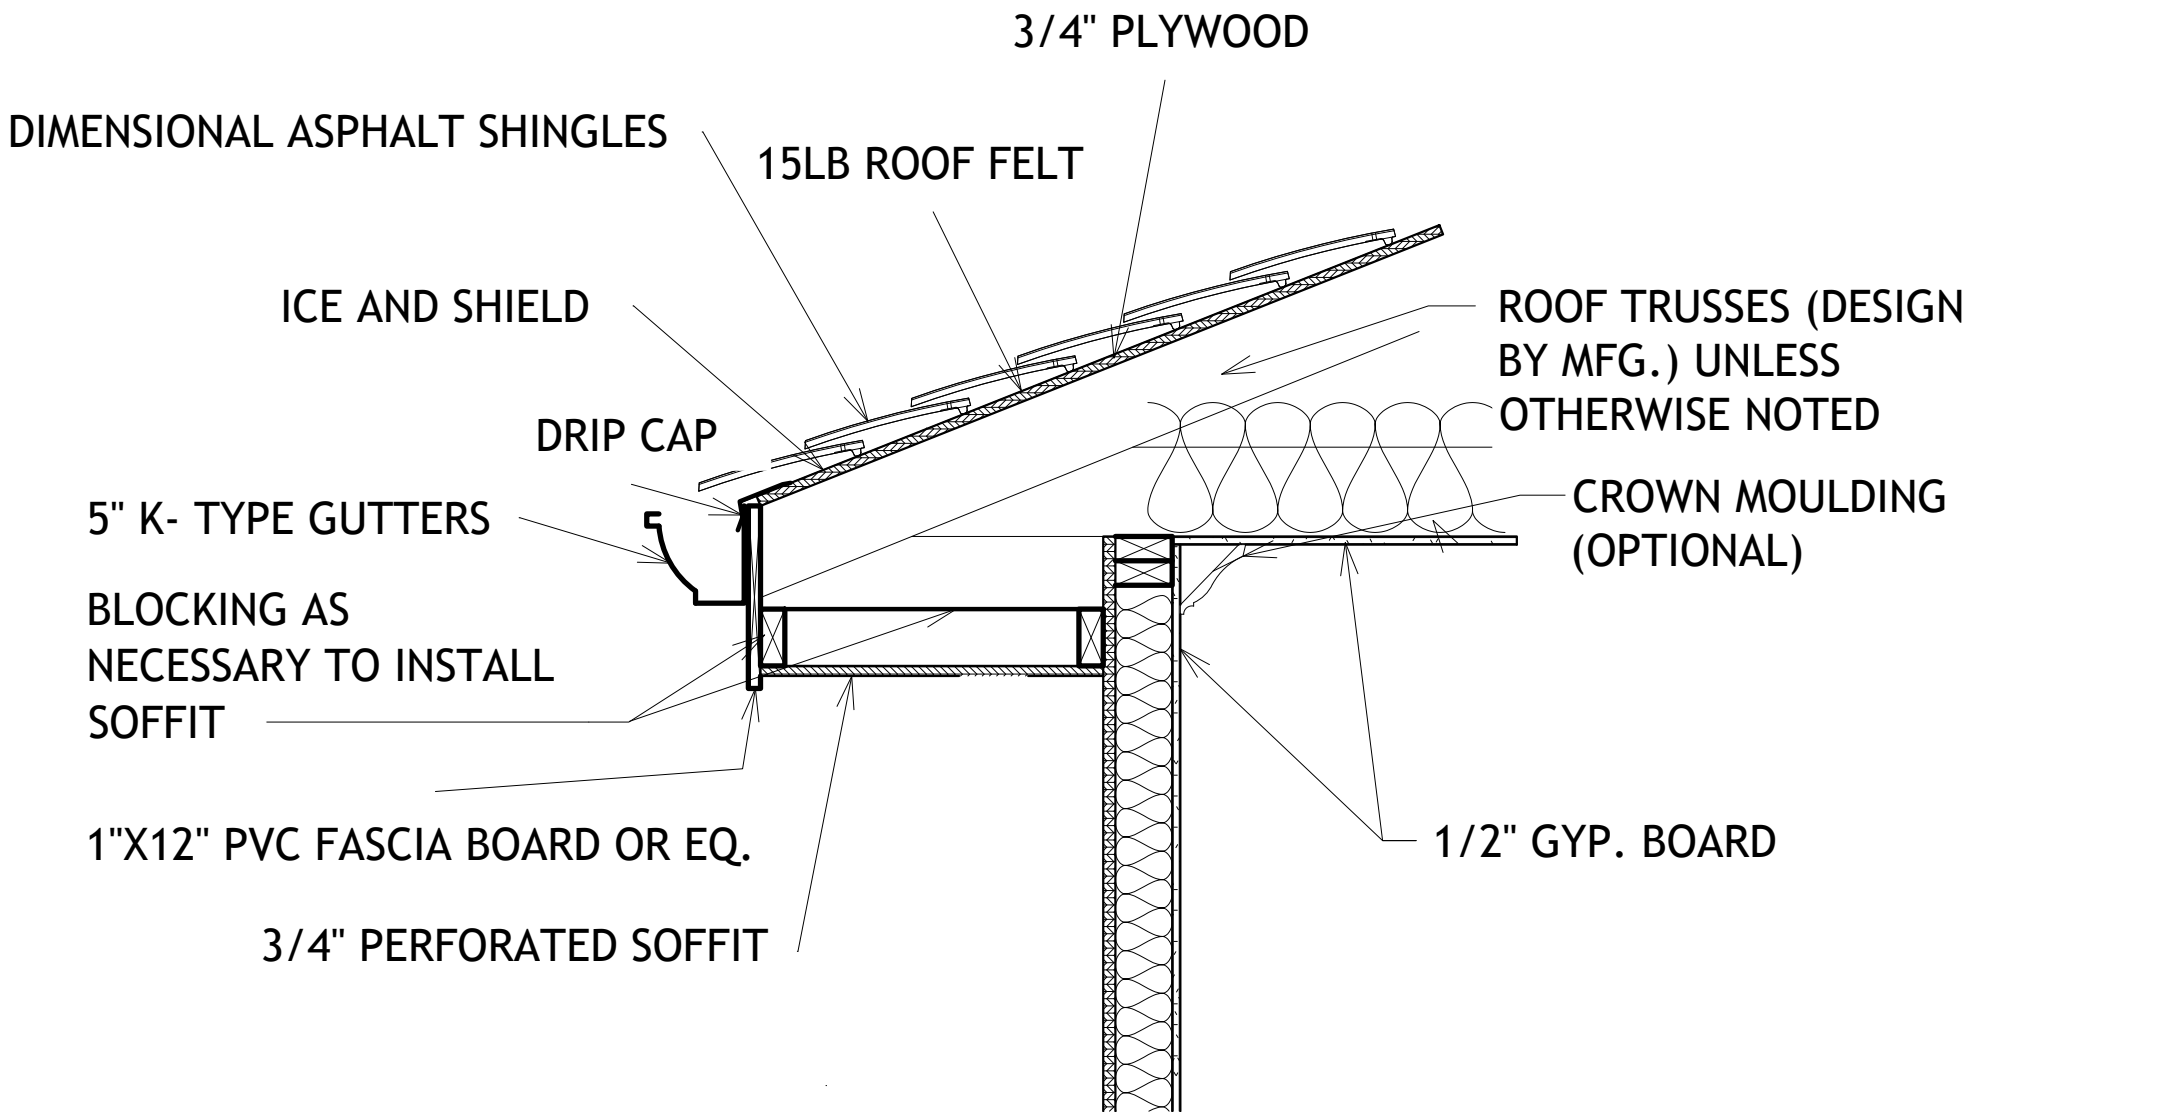

15 BACK PORCH ROOF PLAN
SCALE: 3/8" = 1'-0"

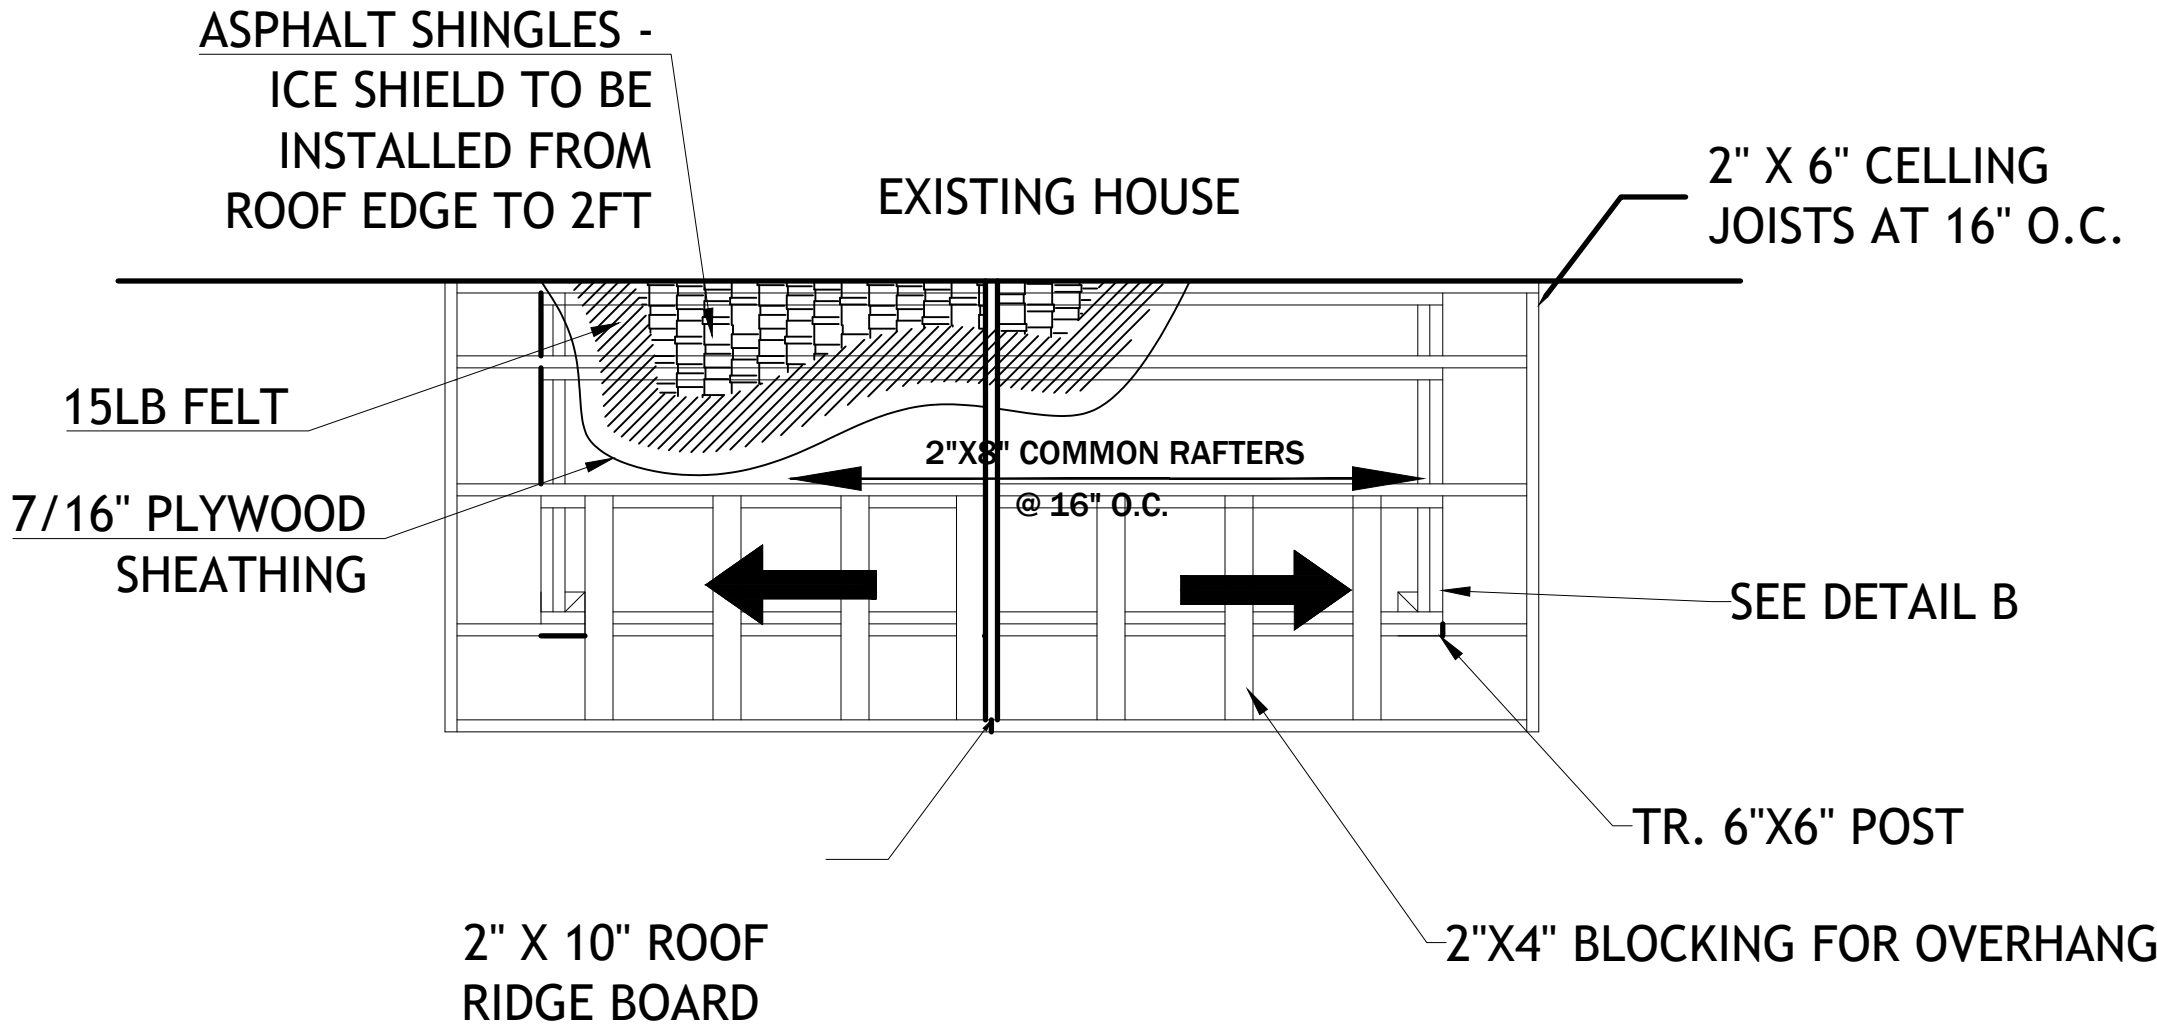

16 FRONT PORCH ROOF PLAN
SCALE: 3/4" = 1'-0"

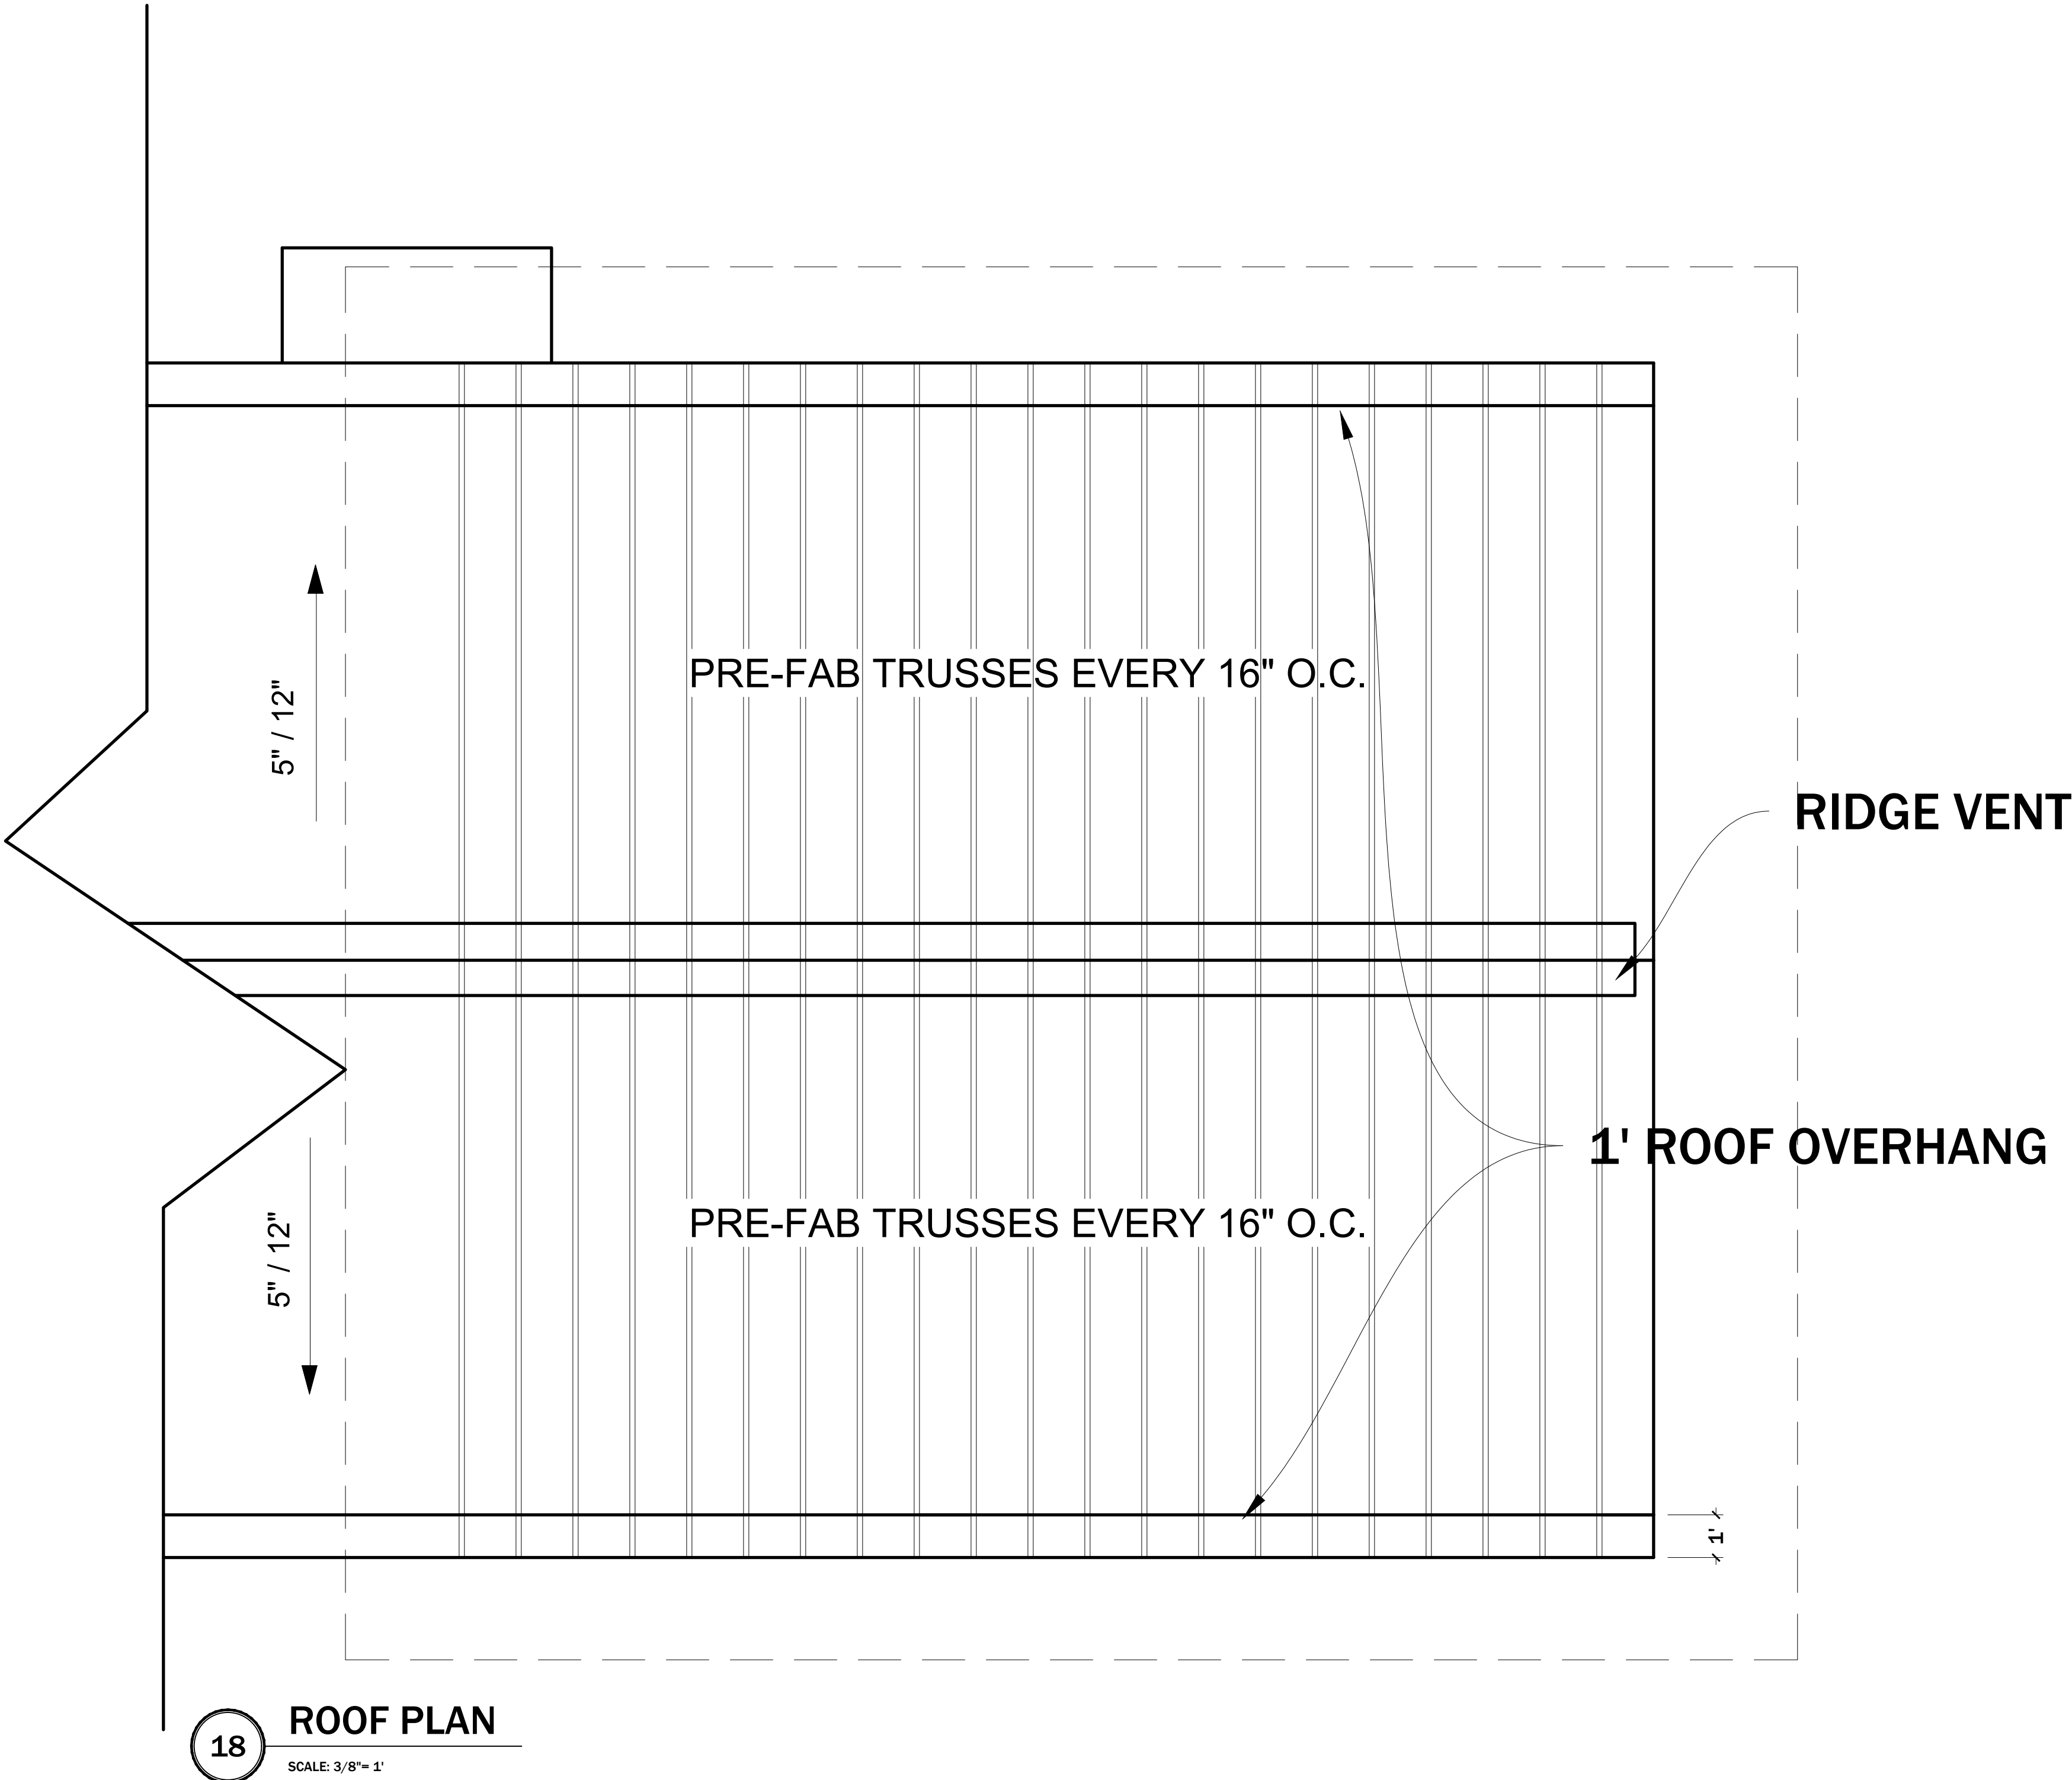

18 ROOF PLAN
SCALE: 3/8" = 1'

16-32 DRAFTING, LLC
2430 WESTWOOD AVE, SUITE 202
RICHMOND, VA 23230

HOME ADDITION


ROOF PLAN
15497 SCOTCHTOWN RD

DRAWN BY:

GAH

#	REV.DATE

A7

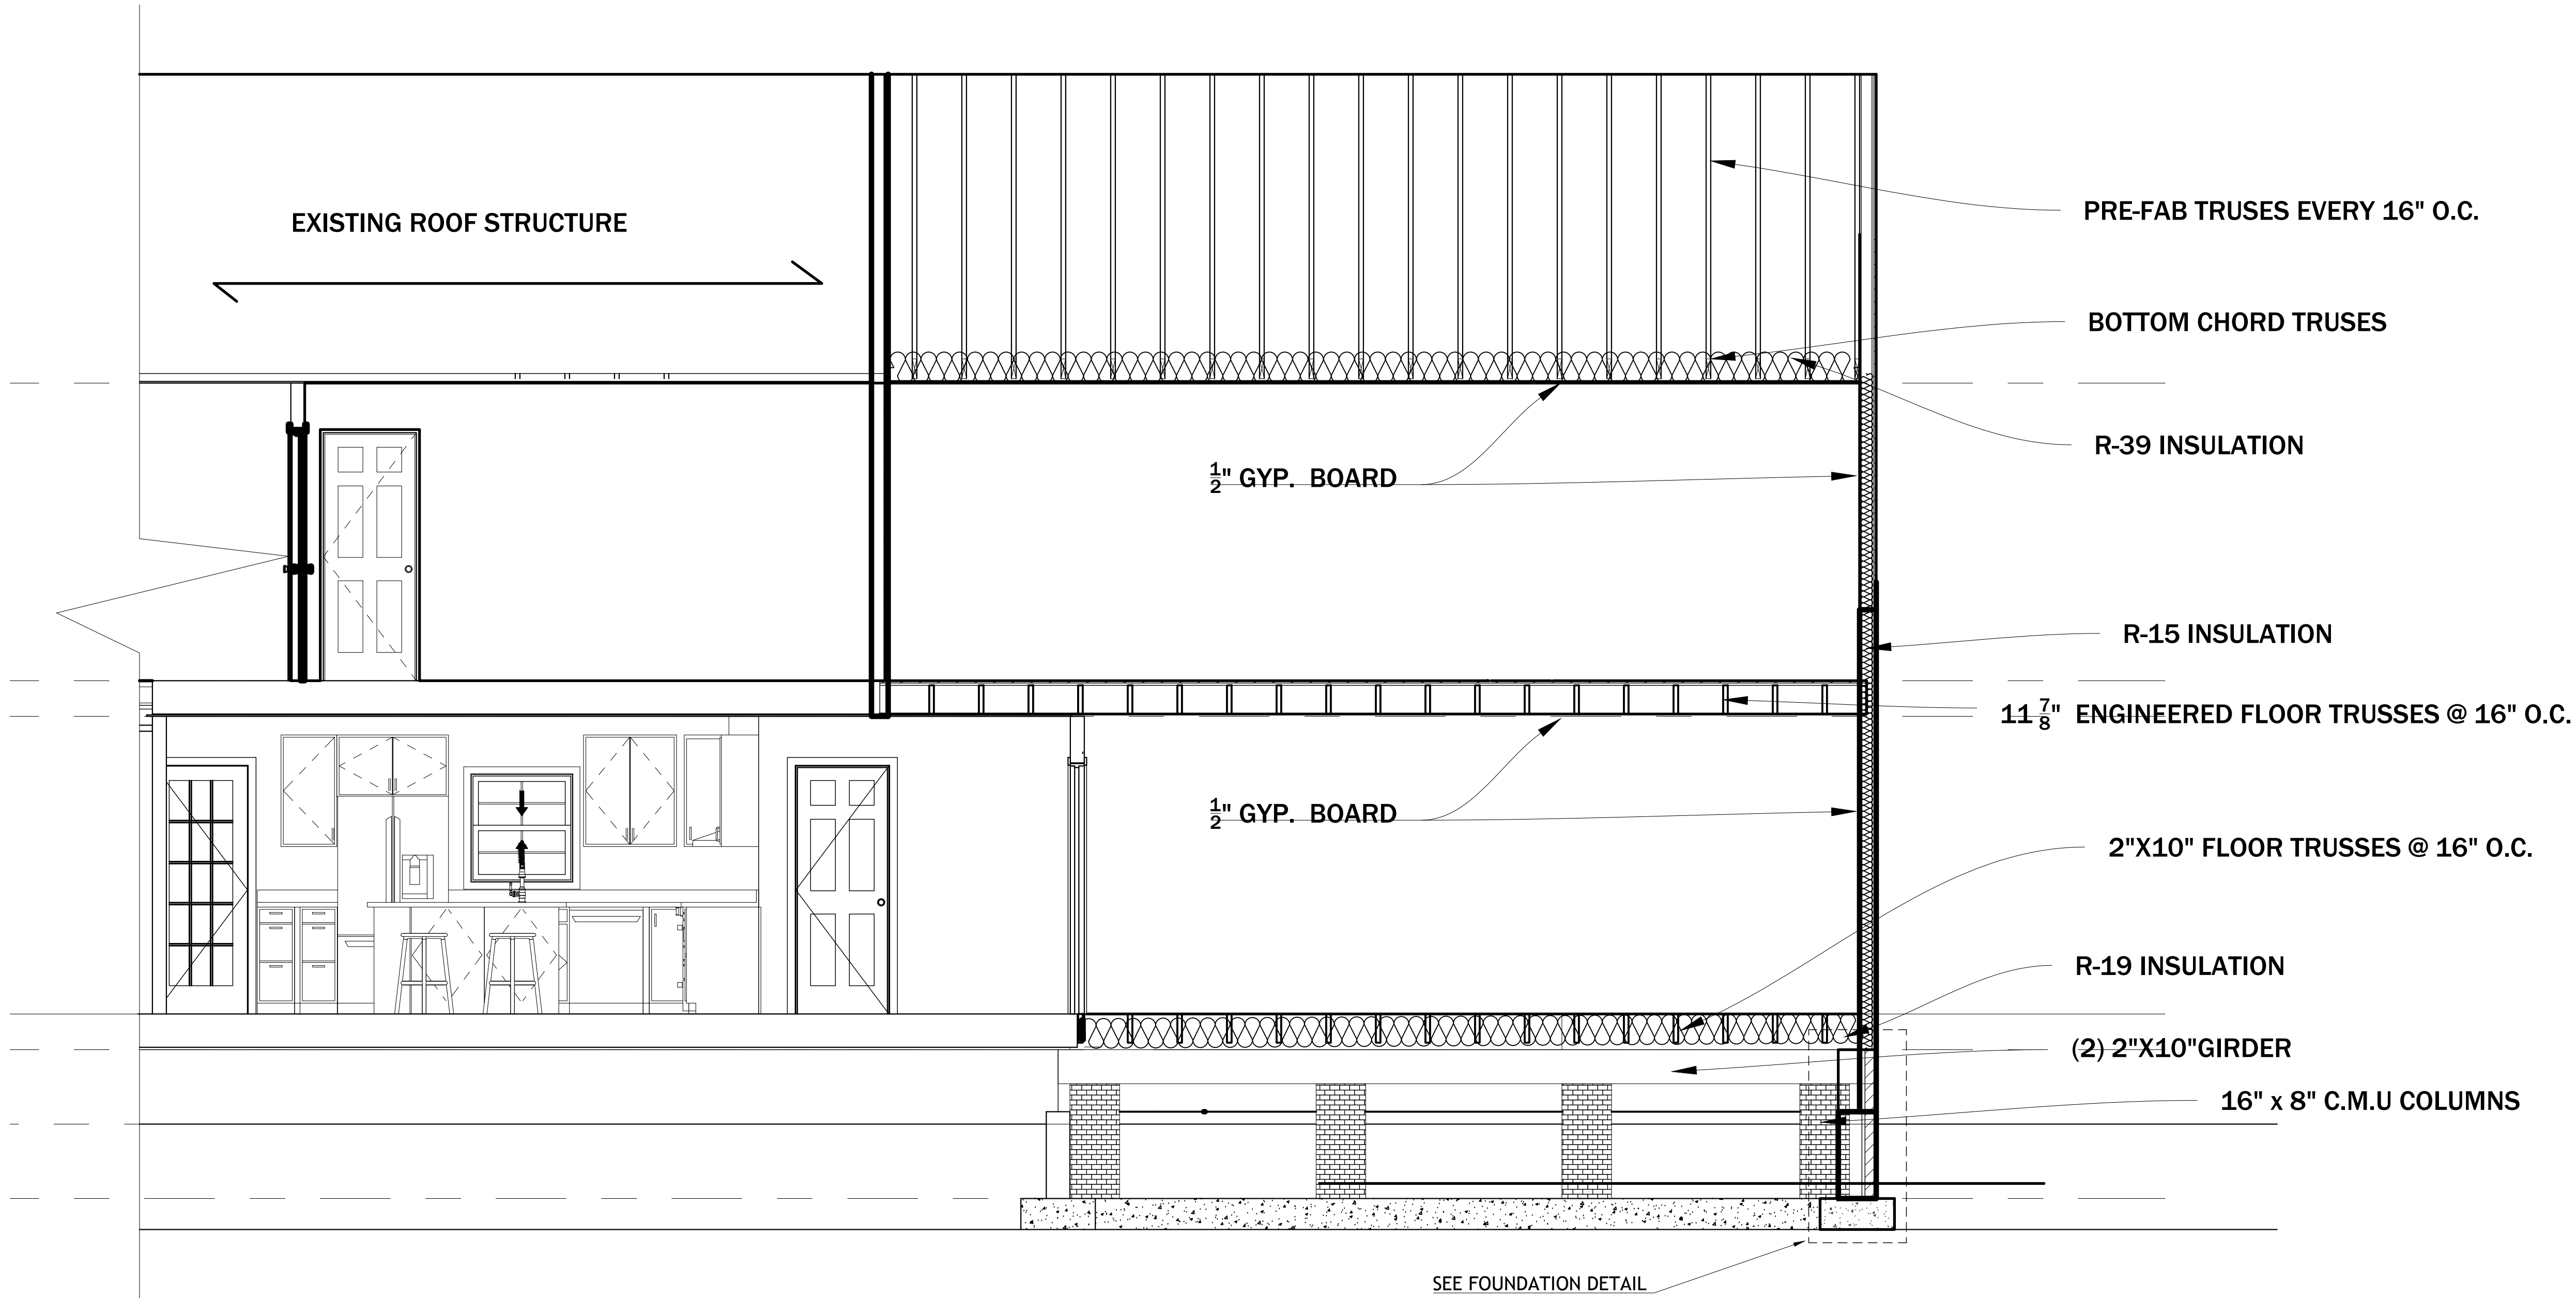

18 WALL SECTION

SCALE: 3/8"= 1'

16-32 DRAFTING, LLC
2430 WESTWOOD AVE, SUITE 202
RICHMOND, VA 23230

HOME ADDITION


SECTION
15497 SCOTCHTOWN RD

DRAWN BY:


GAH

#	REV.DATE

A8

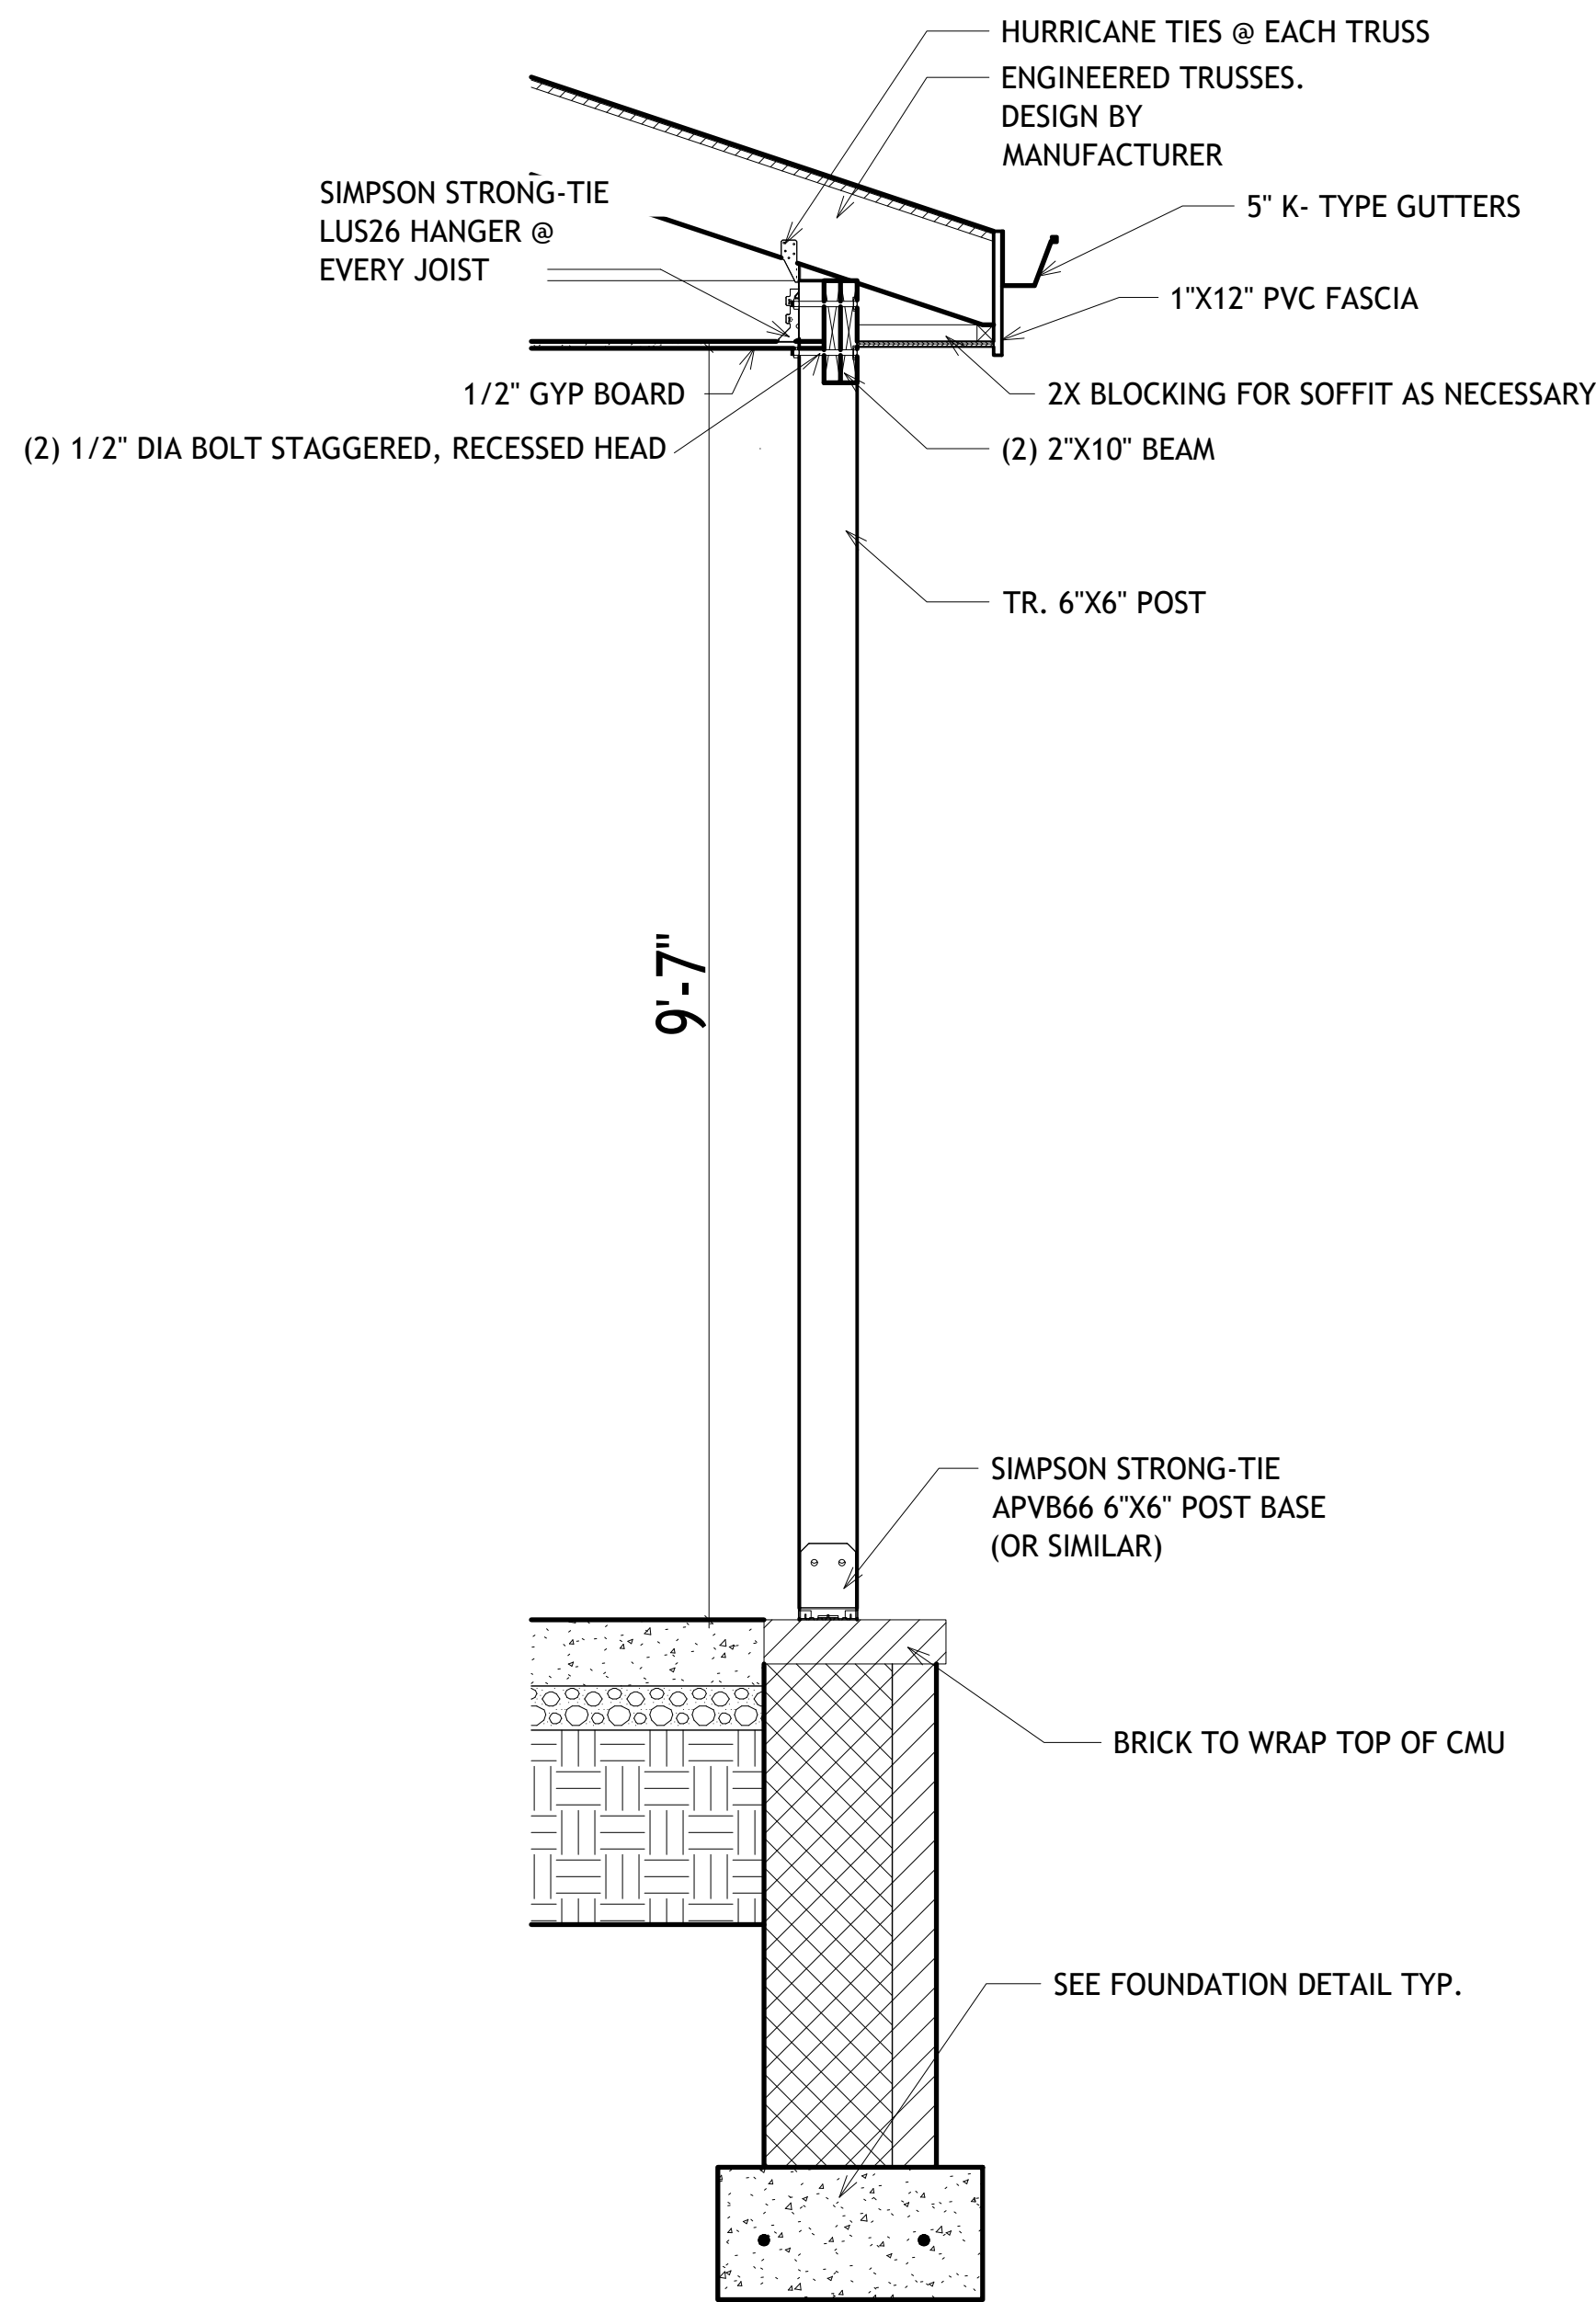

20 BACK PORCH POST ATTACHMENT AND ROOF DETAIL
SCALE: 3/4"= 1'

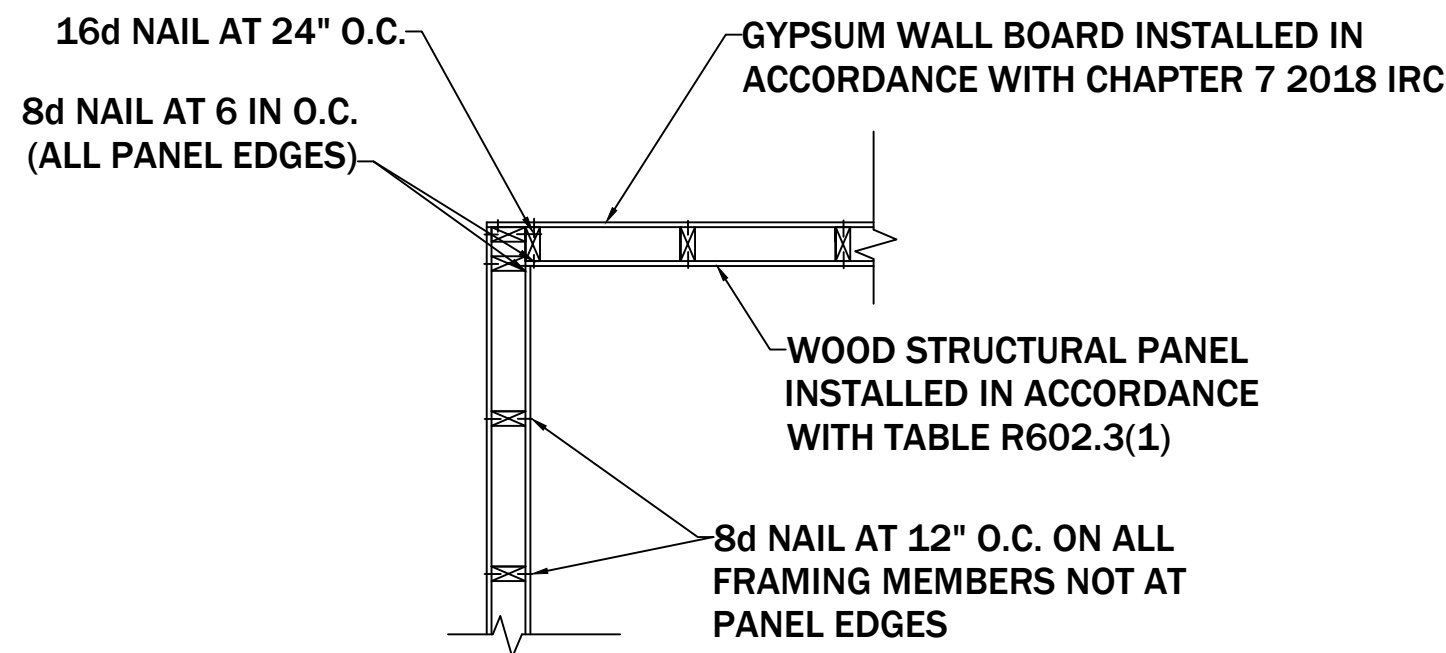

21 INSIDE CORNER DETAIL
SCALE: NTS

16-32 DRAFTING, LLC
2430 WESTWOOD AVE, SUITE 202
RICHMOND, VA 23230

HOME ADDITION

OTHER DETAILS
15497 SCOTCHTOWN RD

DRAWN BY:

GAH

#	REV.DATE

A10