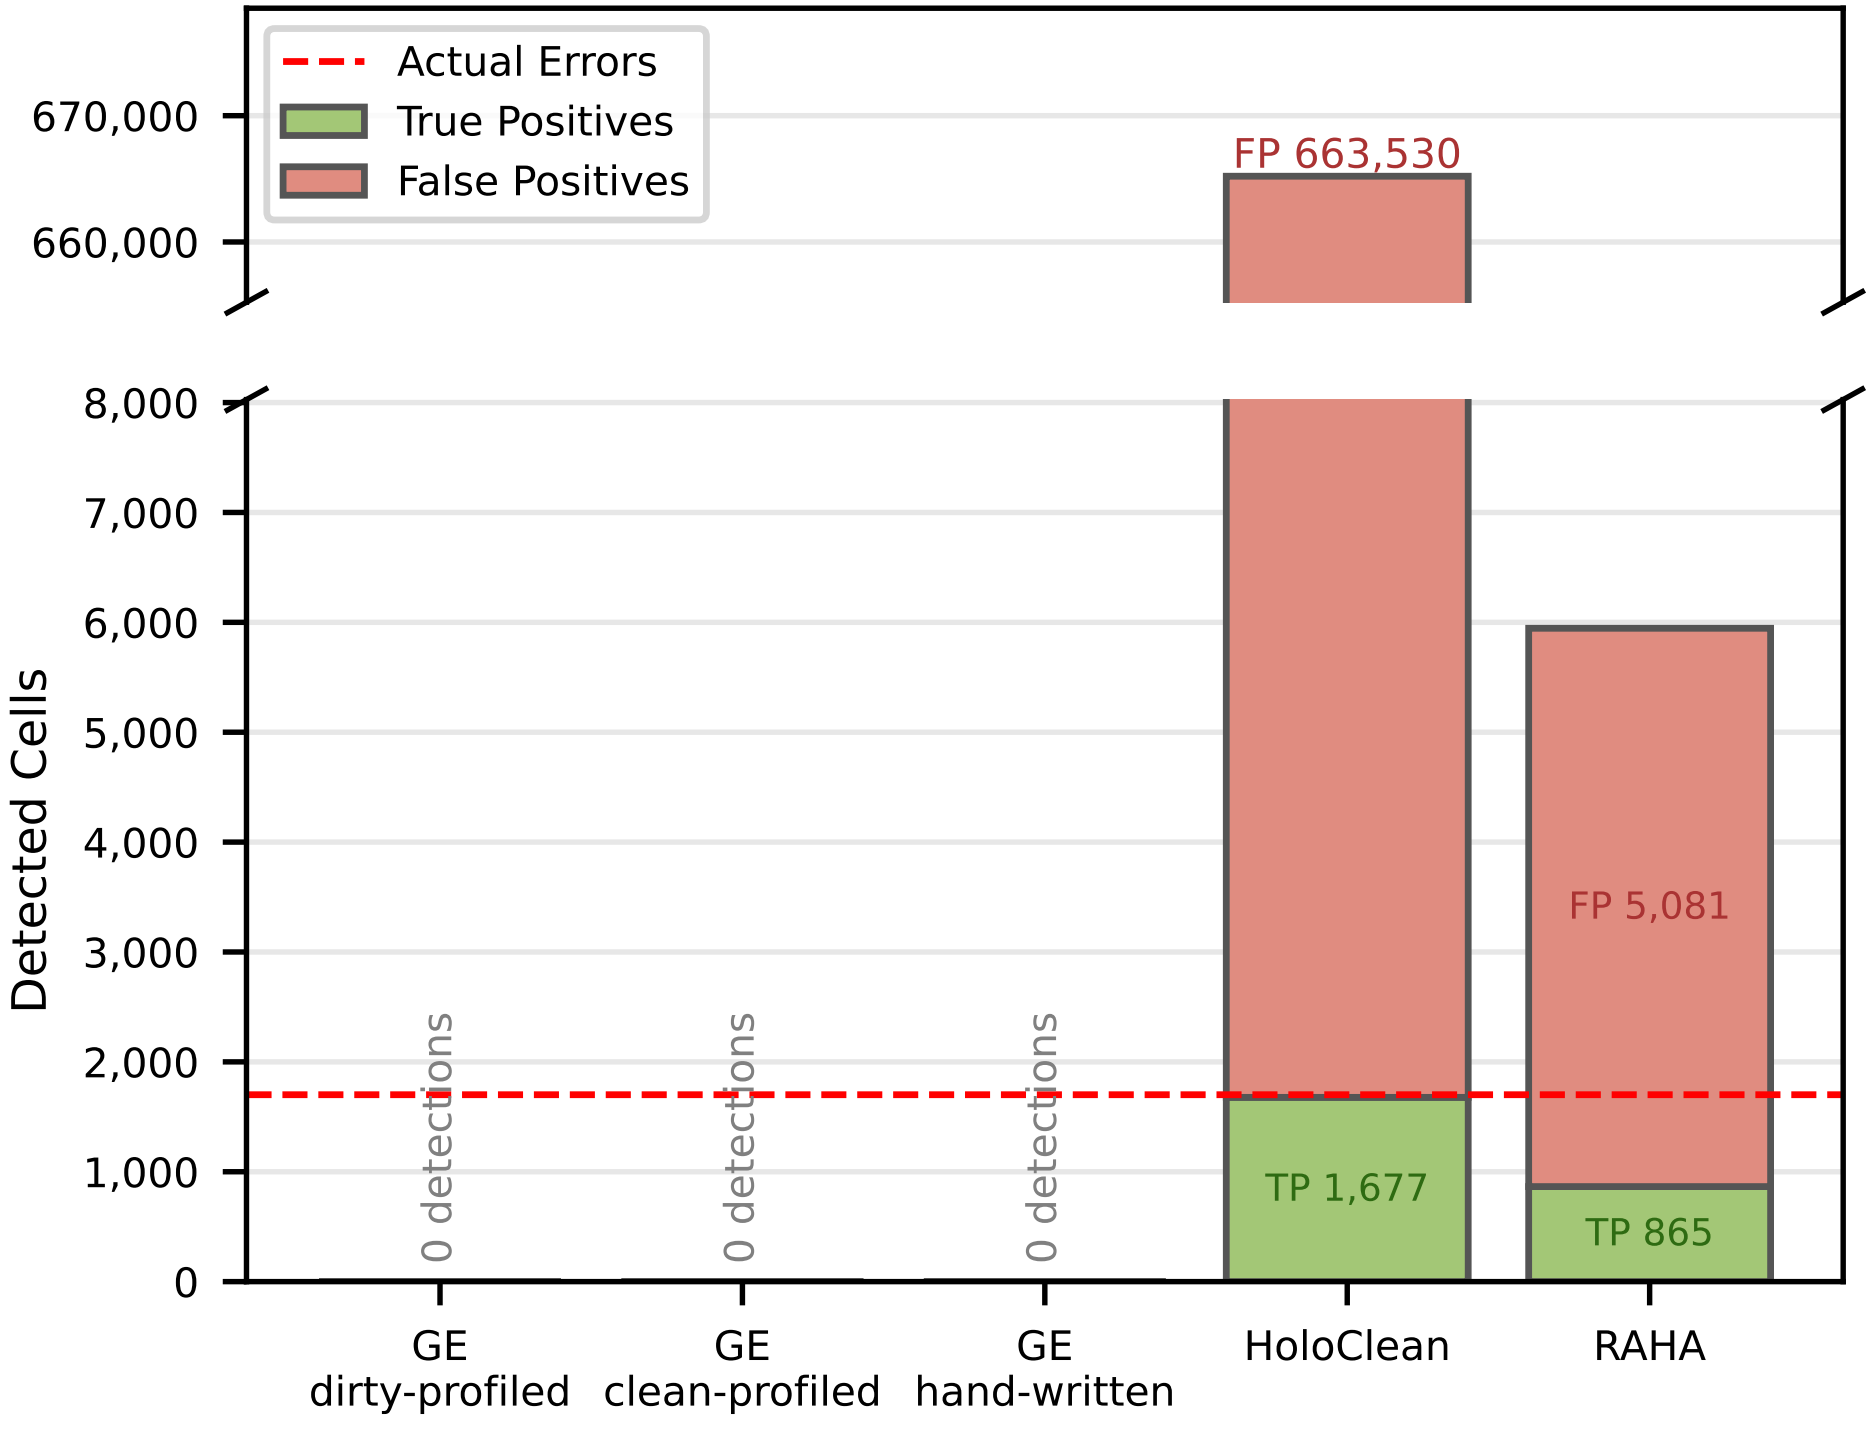
Actual Errors
True Positives
False Positives
670,000
660,000
8,000
7,000
6,000
5,000
4,000
3,000
2,000
1,000
0
Detected Cells
FP 663,530
FP 5,081
TP 1,677
TP 865
0 detections
0 detections
0 detections
GE
dirty-profiled
GE
clean-profiled
GE
hand-written
HoloClean
RAHA