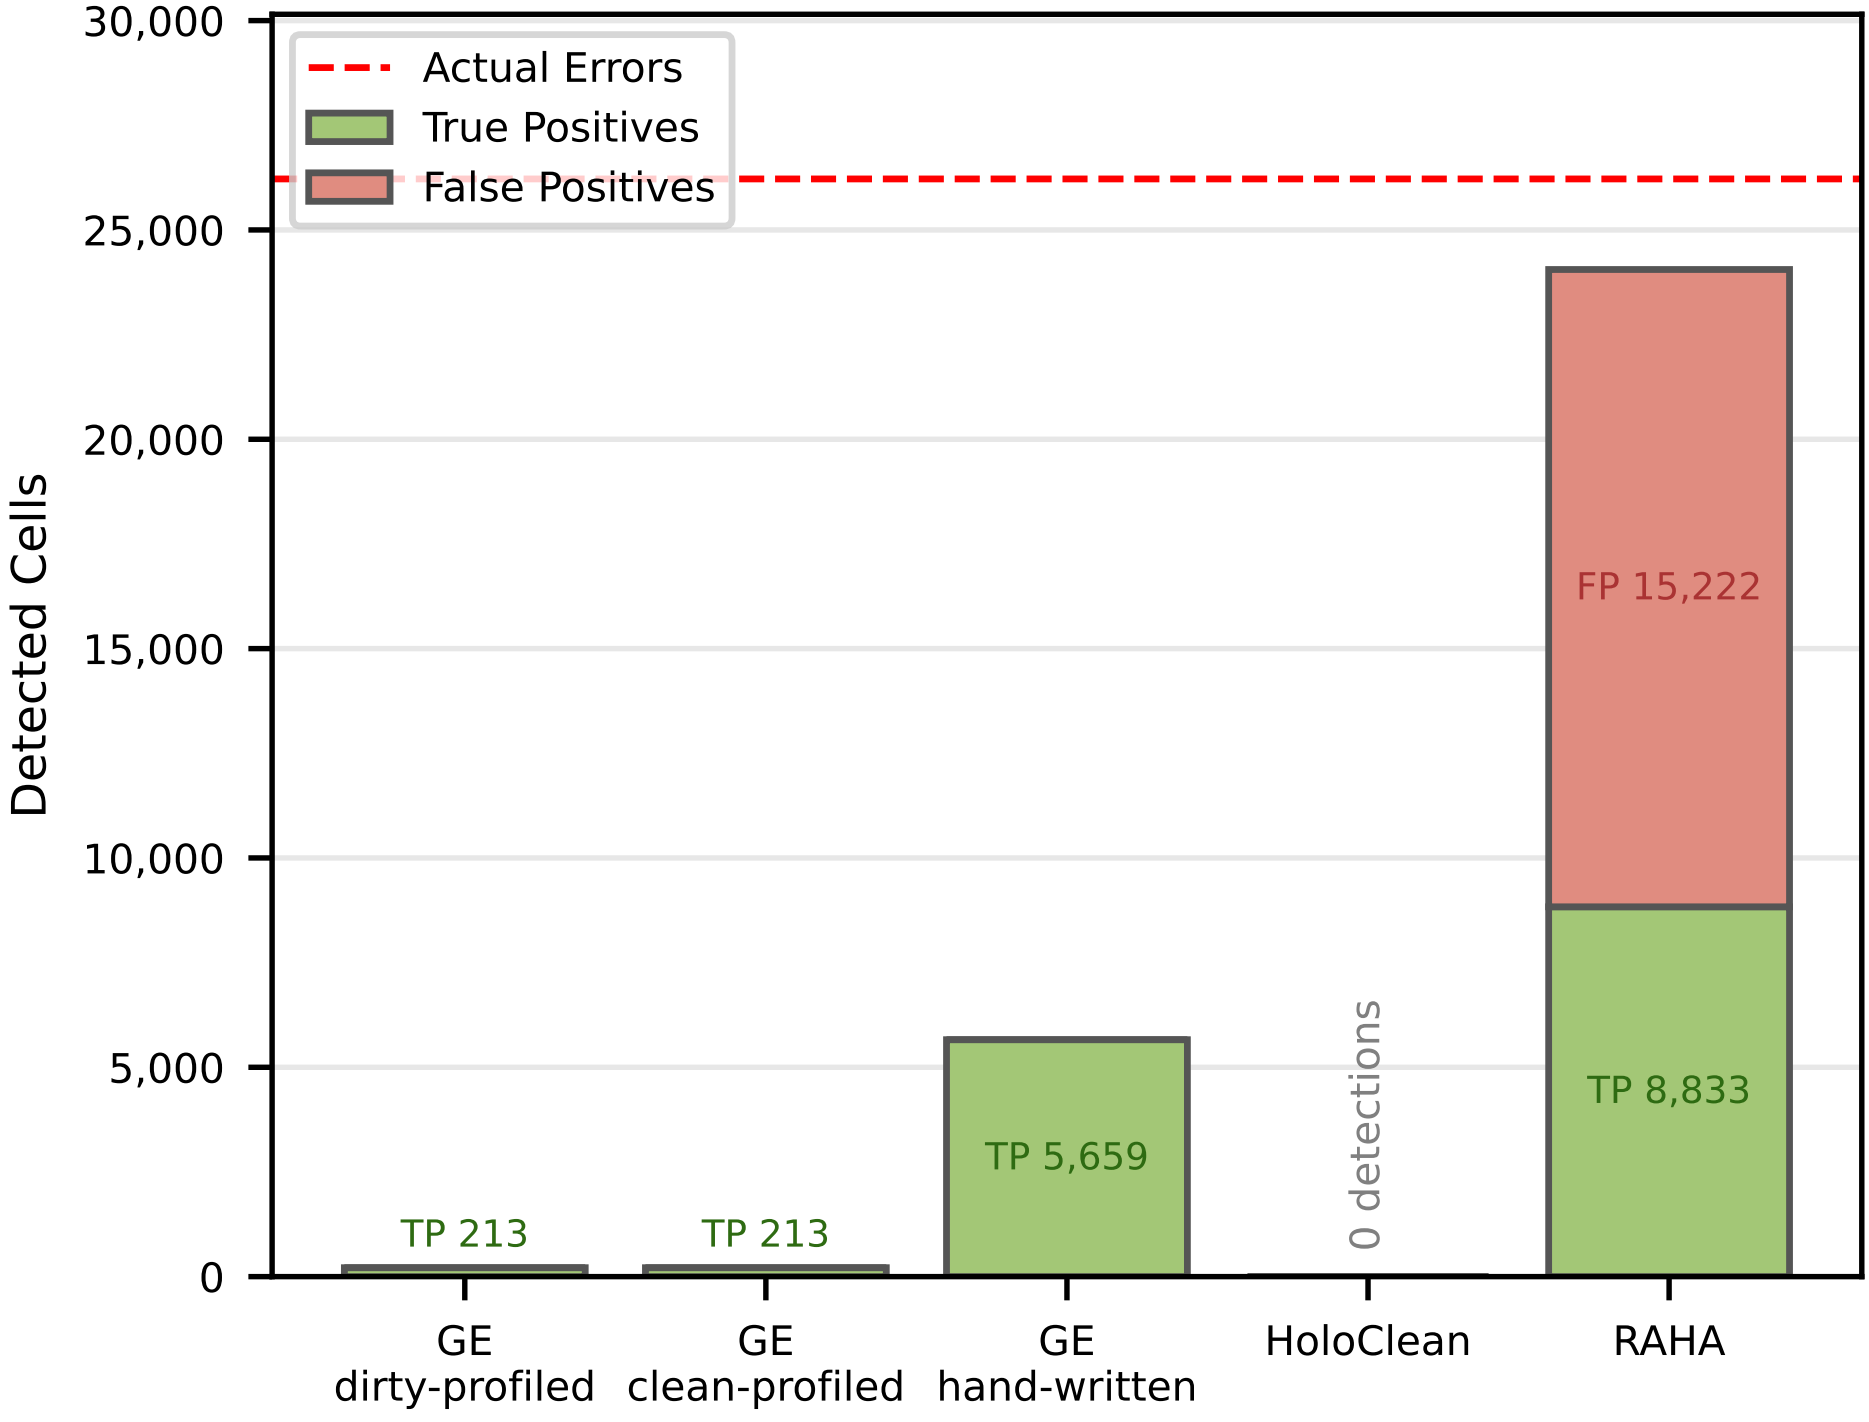
Actual Errors
True Positives
False Positives
Detected Cells
30,000
25,000
20,000
15,000
10,000
5,000
0
TP 213
TP 213
TP 5,659
0 detections
FP 15,222
TP 8,833
GE
dirty-profiled
GE
clean-profiled
GE
hand-written
HoloClean
RAHA