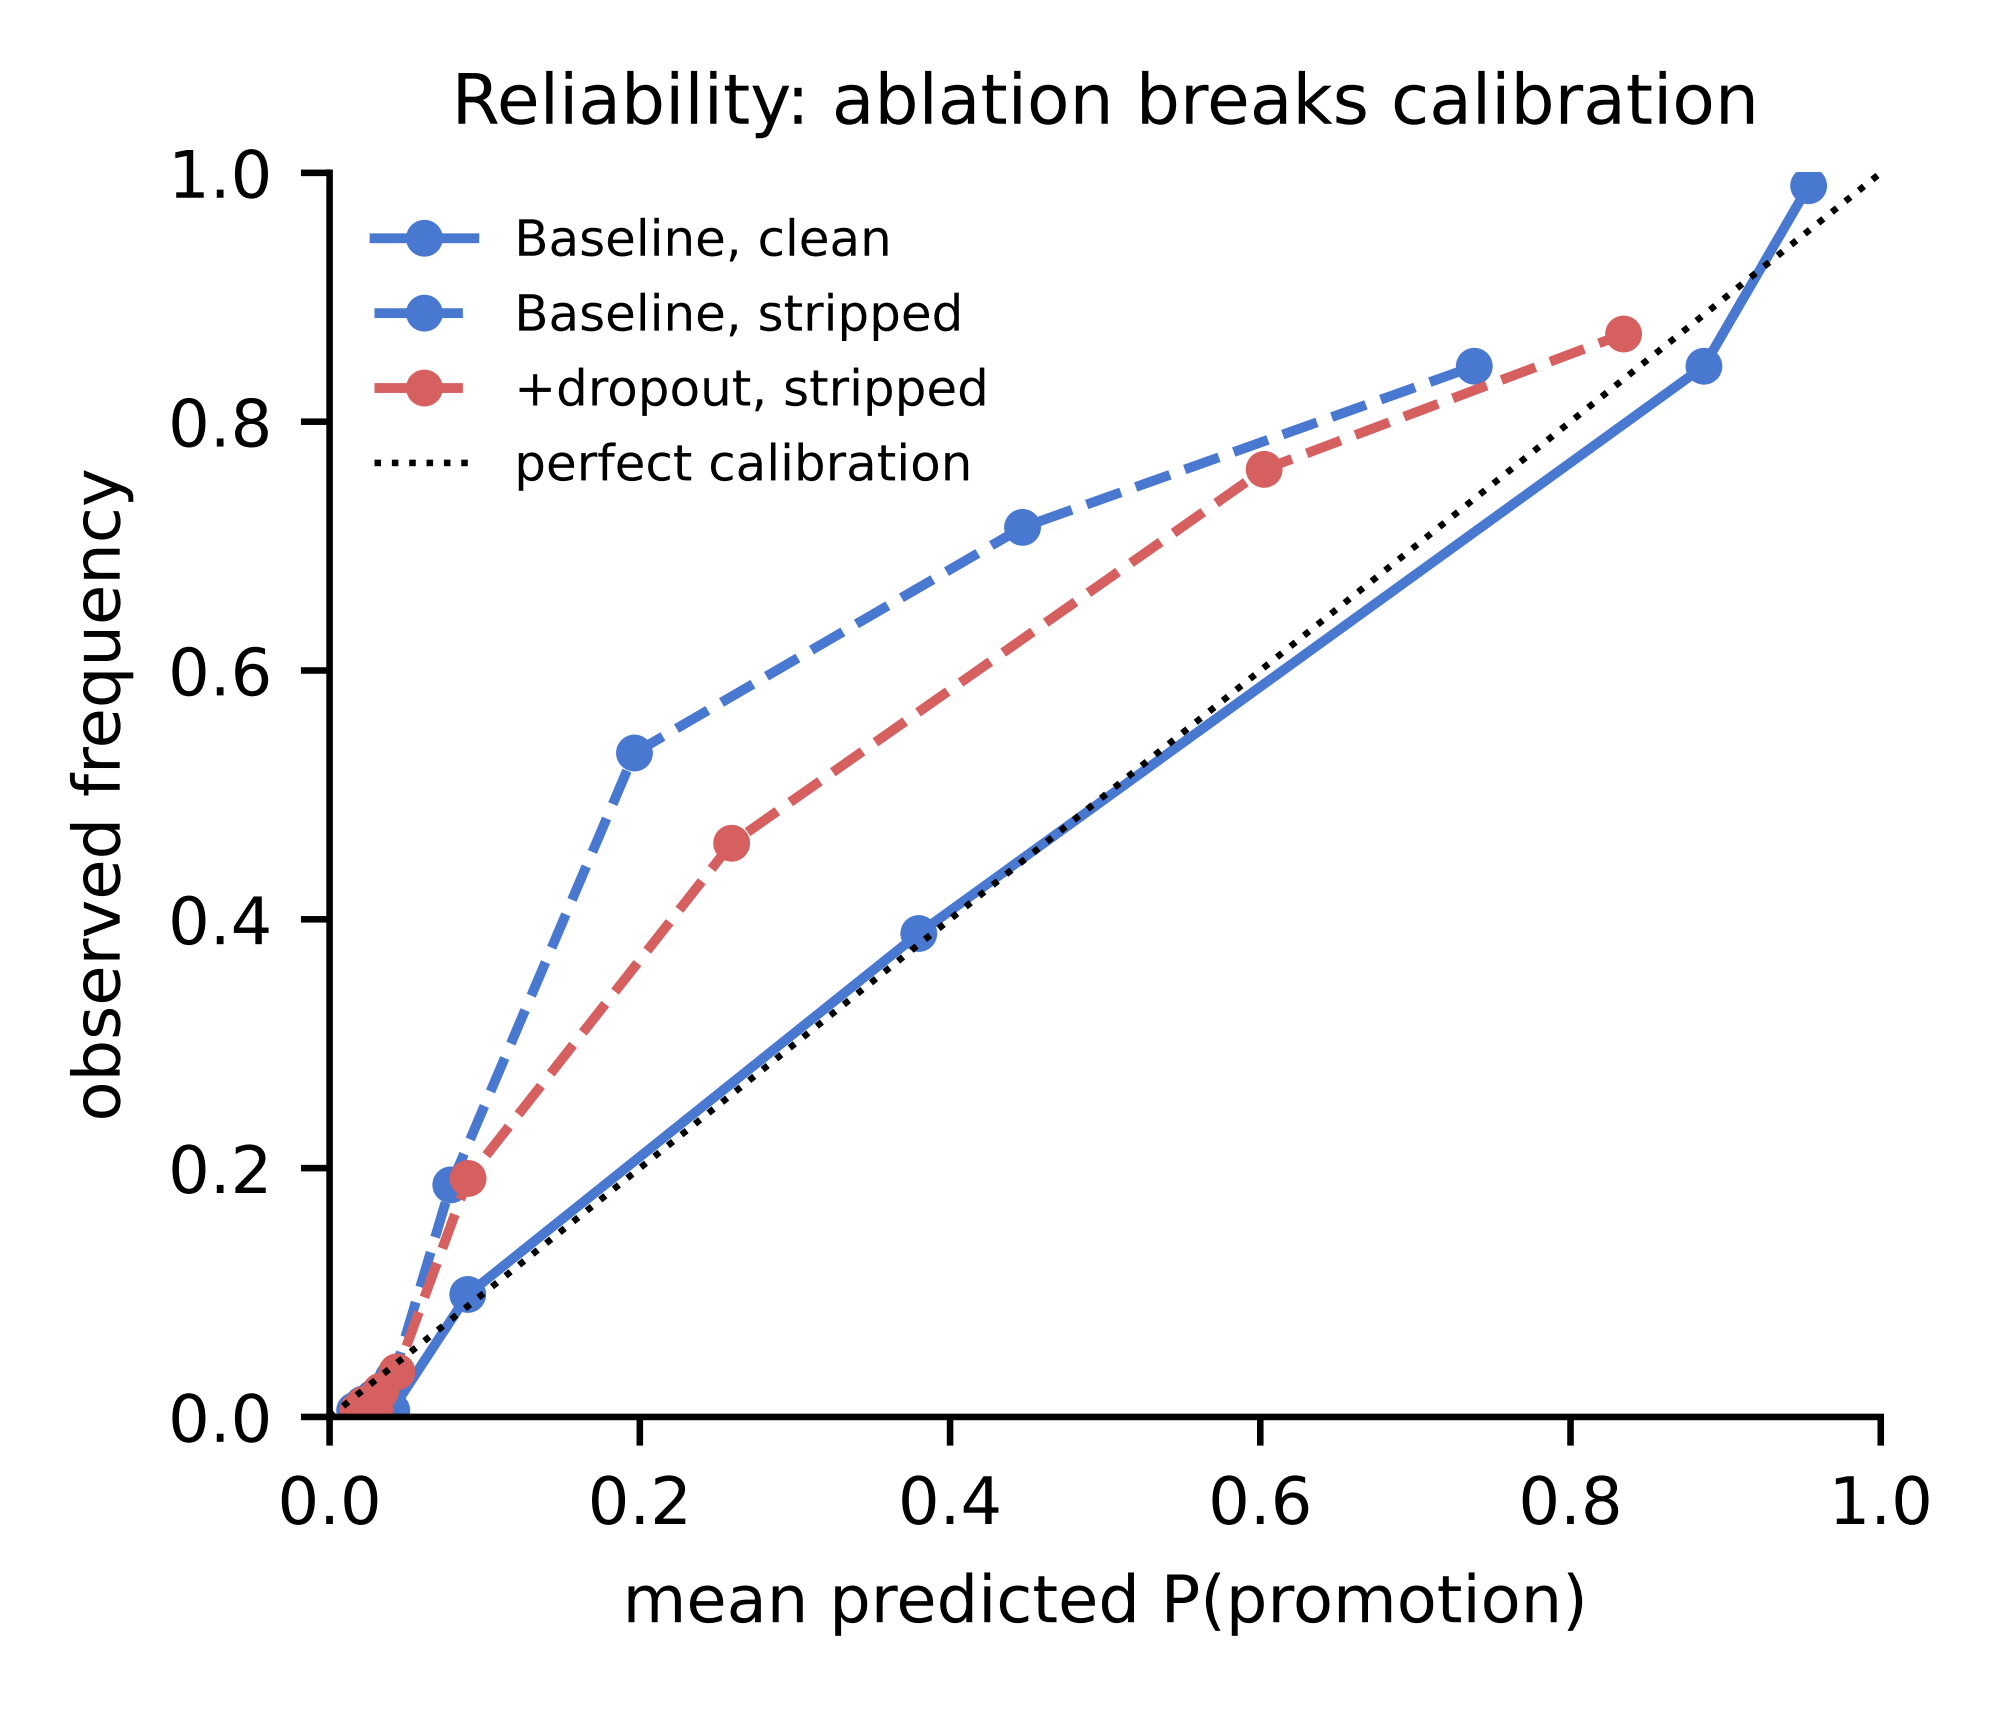
Reliability: ablation breaks calibration
Baseline, clean
Baseline, stripped
+dropout, stripped
perfect calibration
observed frequency
mean predicted P(promotion)
0.0
0.2
0.4
0.6
0.8
1.0