
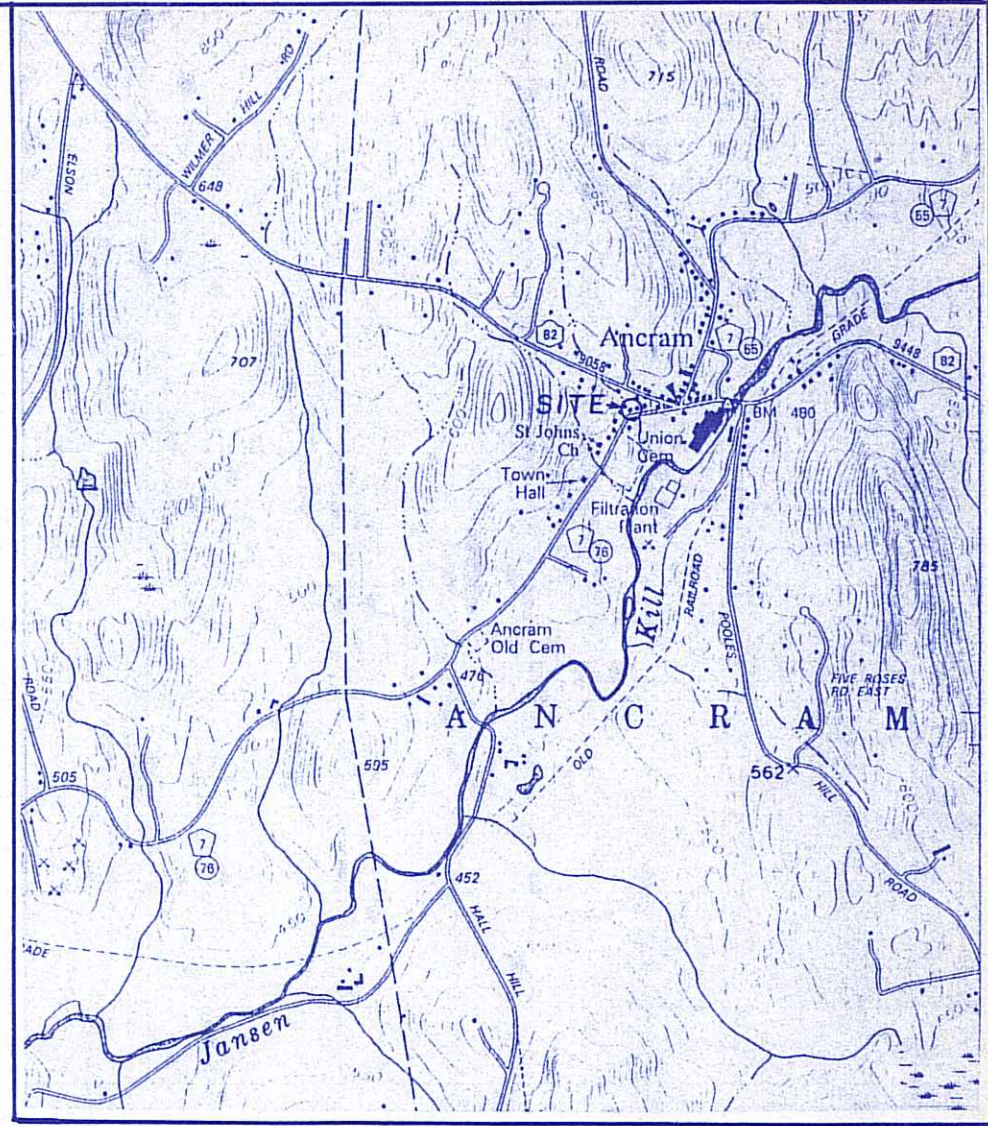
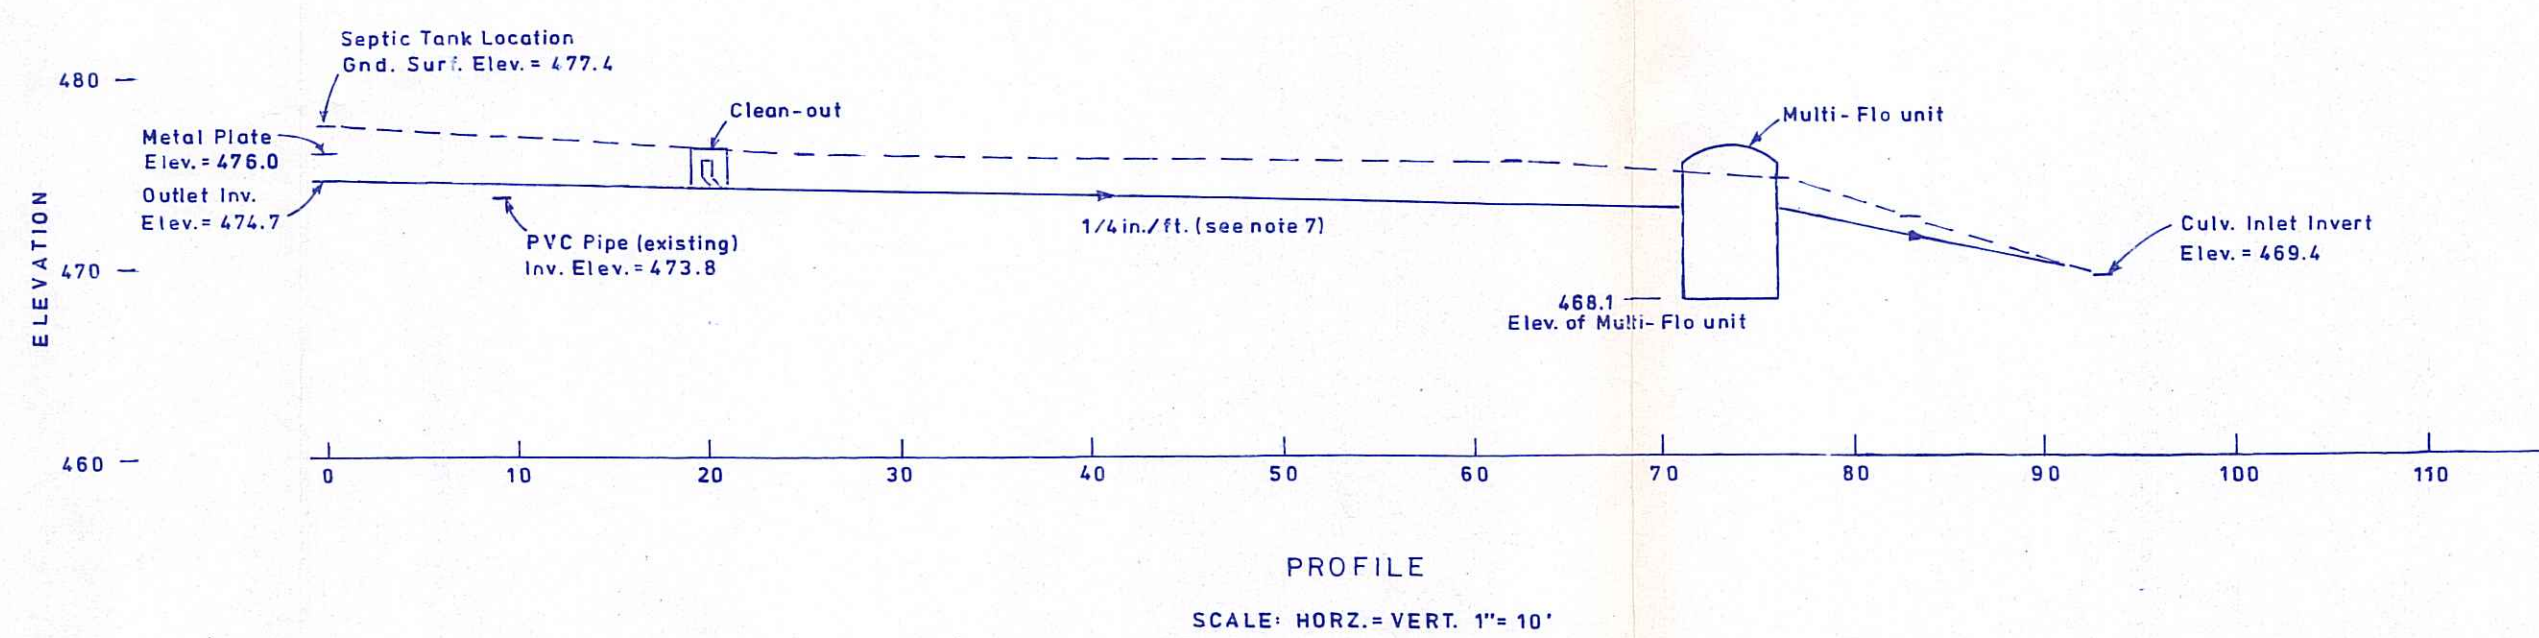
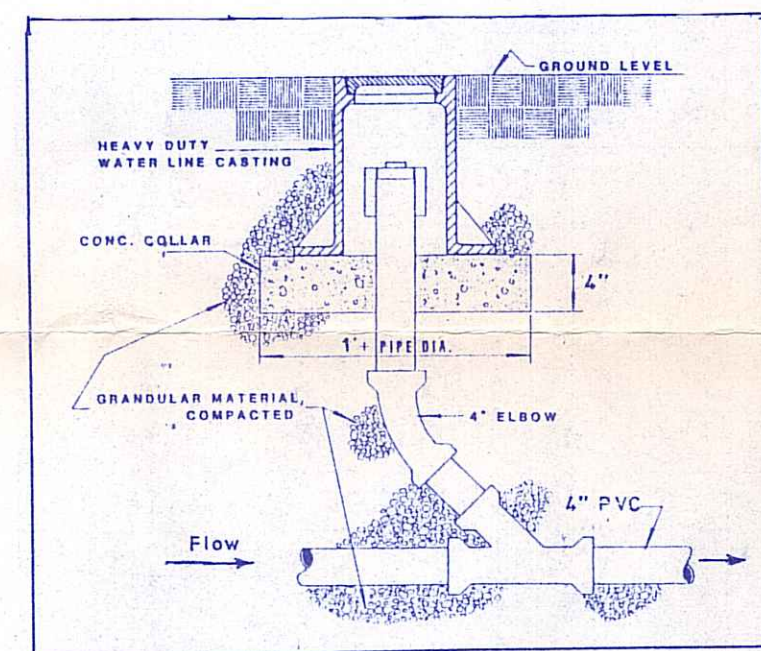


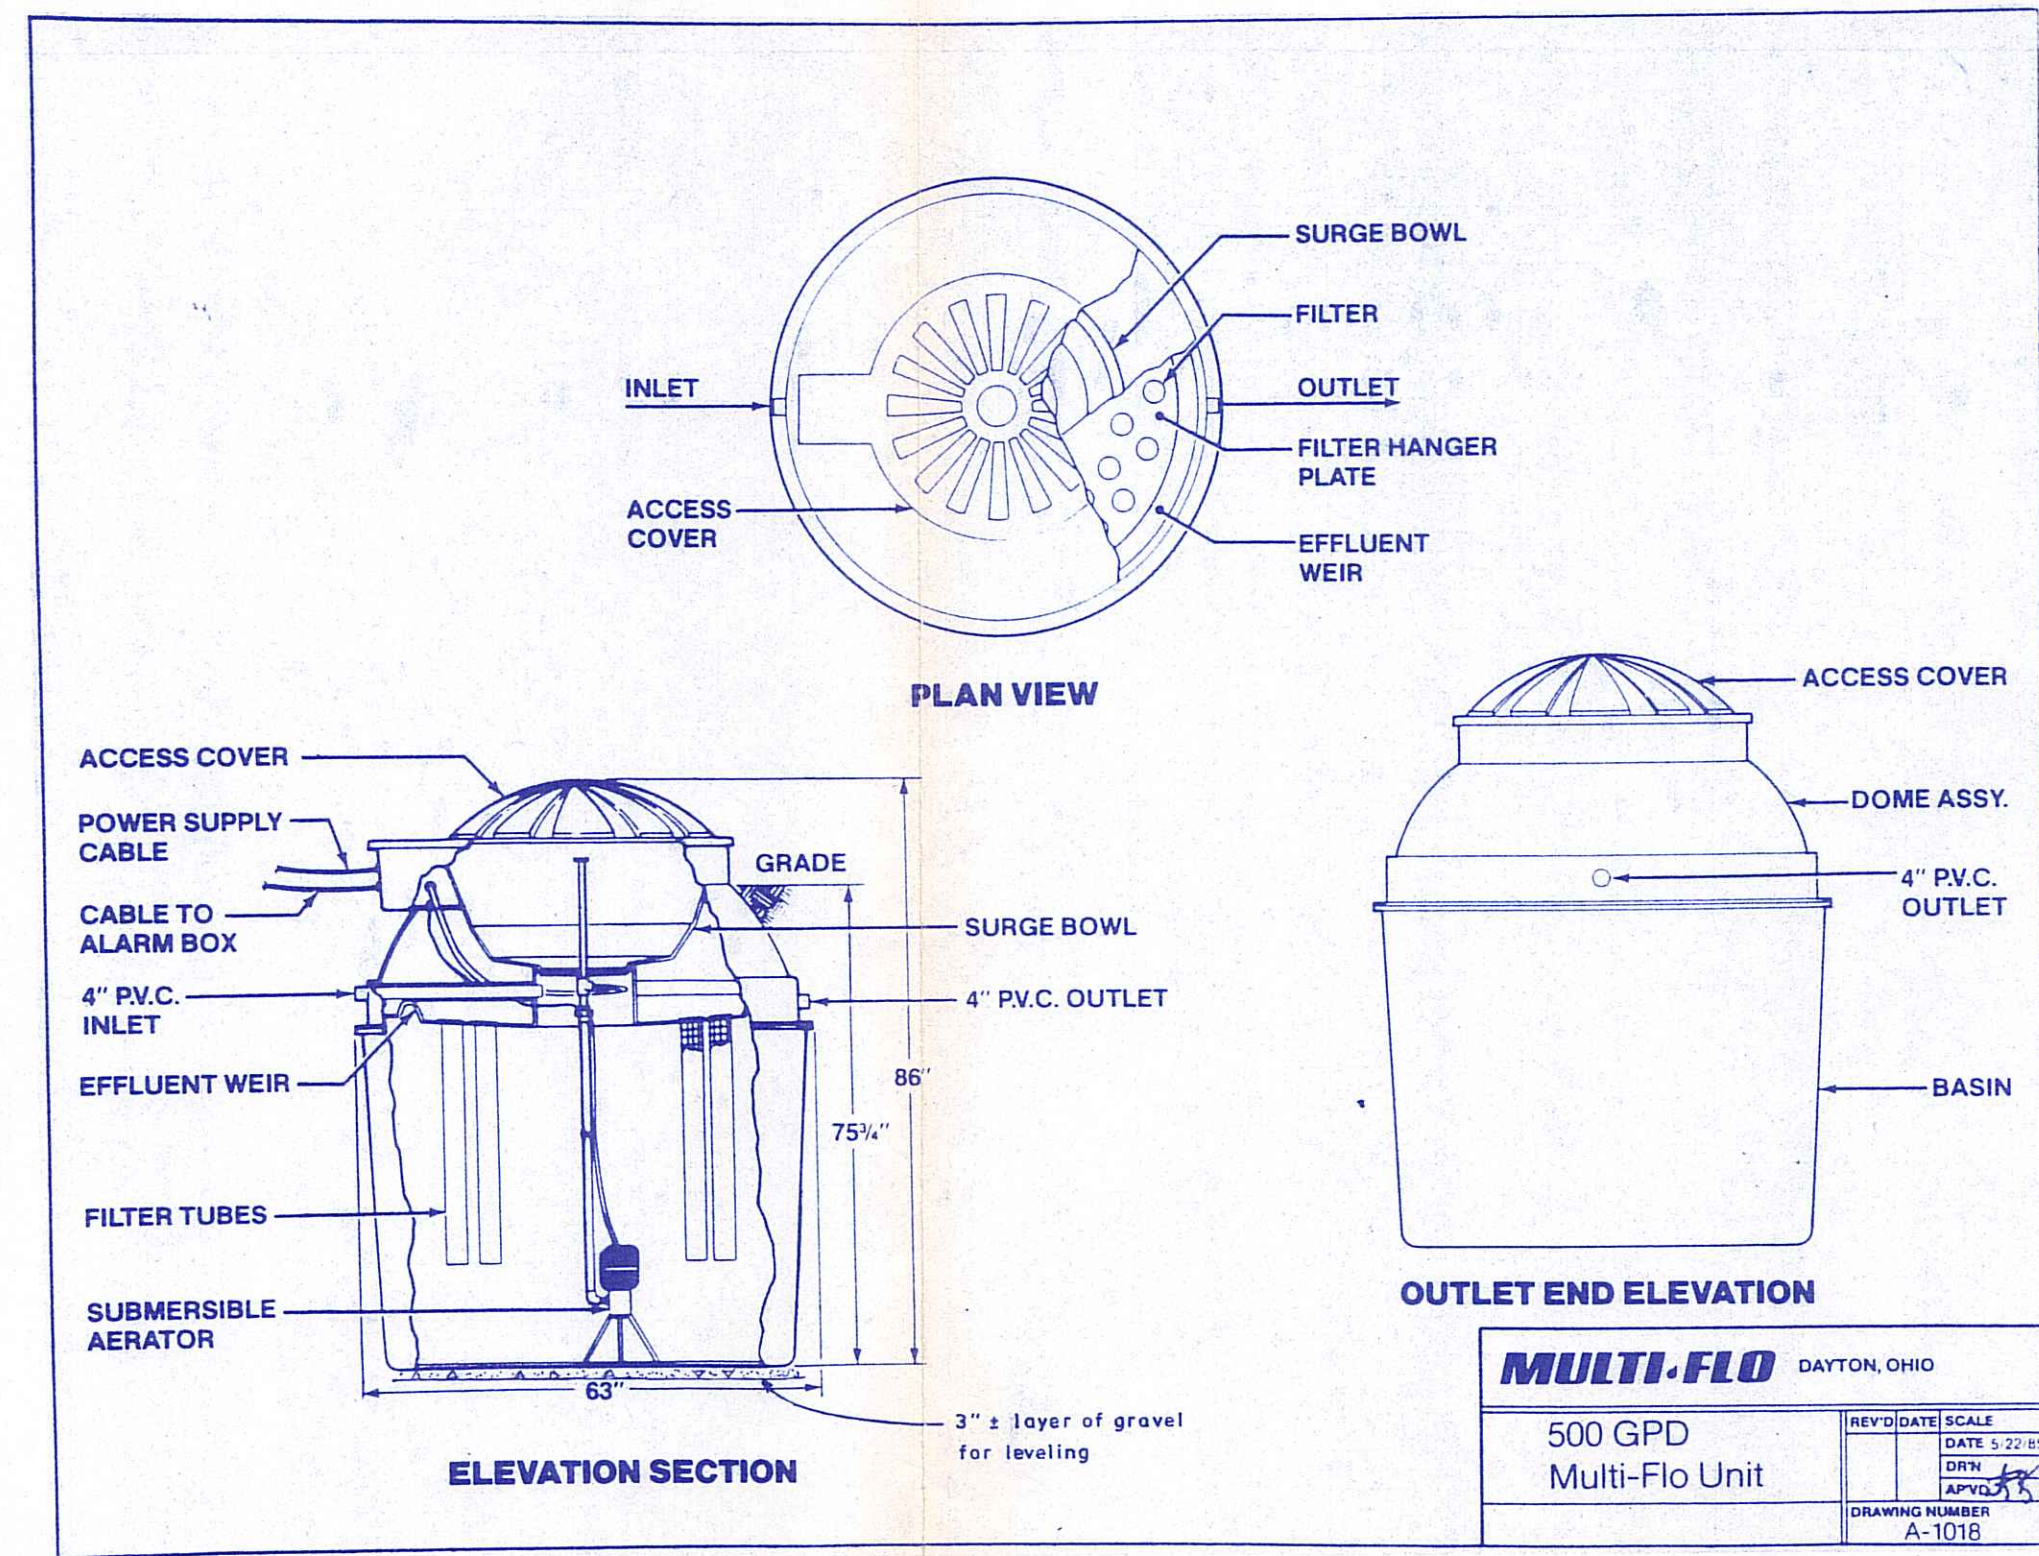

3. This print is not released for construction without approvals of the governing agencies.
2. There shall be no changes on these plans in advance of, or during construction without approval of the design engineer and the governing authorities.
3. Design is based on two (2) bedrooms in the apartment building and one full time (8 hr./day) employee in the post office. Design flow equals 350 gallons per day. **No laundry or garbage disposal unit in bldg.**
4. A licensed engineer shall supervise construction in accordance with the approved plans and supplemental data.
5. Separate circuit breaker to be provided for the Multi-Flo unit and alarm system. Alarm system to be low level audible type or equivalent.
6. Multi-Flo treatment system to be installed by authorized distributor of the system and in accordance with manufacturer's specifications.
7. Use 4 inch diameter, solid walled, schedule 40 PVC pipe from septic tanks to Multi-Flo unit graded at a minimum slope of 4 inch per foot.
8. Use 4 inch diameter, solid walled, schedule 40 PVC pipe from the Multi-Flo unit to point of discharge.
9. No roof drains, footing drains, sump pump or equivalent drains are to be connected to the sewage disposal system.
10. The owner shall ensure that faucets and toilet fixtures are not leaking as such leakage will dilute wastewater, and may result in improper treatment and filtration of the wastewater.
11. Footing drains shall either drain by gravity or be conveyed by a sump pump outlet line to runoff channels on the lot.
12. Upon installation, the disposal system shall be inspected by a representative of the Columbia County Department of Health.
13. It is recommended that the septic tank be pumped out at least every two (2) years.

1. "Lashers Cor. - Gallatinville - Ancram, Co. Rd. No. 76, Town of Ancram, Columbia County, New York." Permanent Easement, Map 1 - P.E. dated 1967.
2. "Property of Mary S. Knickerbocker, Town of Ancram, Col. Co., N.Y." Prepared by Rockefeller & Nucci, dated March 23, 1974.

SOILS INFORMATION: NO PERCOLATION TESTS WERE PERFORMED DUE TO THE LACK OF SUFFICIENT AREA FOR EITHER AN IN-GROUND OR FILL SYSTEM AND THE HIGH SILT AND CLAY CONTENT OF THE NATIVE SOIL.

SEWAGE DISPOSAL SYSTEM DESIGN	
LANDS OF	
LIZETTE J. von GAL	
TOWN OF ANCRAM	COUNTY OF COLUMBIA
STATE OF NEW YORK	
SCALE: 1" = 20'	DATE: APRIL 22, 1998
CARL S. MATUSZEK, P.E., L.S. 241 SCANNELL ROAD CHATHAM, NEW YORK 12037 PHONE: (518) 392-2425	



UNAUTHORIZED ALTERATION OR ADDITION TO THIS DRAWING IS A VIOLATION OF SECTION 7209, SUB-DIVISION 2 OF THE NEW YORK STATE EDUCATION LAW. ONLY COPIES FROM THE ORIGINAL OF THIS DRAWING BEARING AN ORIGINAL OF THE PREPARER'S INKED OR EMBOSSED SEAL AND SIGNATURE SHALL BE CONSIDERED TO BE VALID TRUE COPIES.